
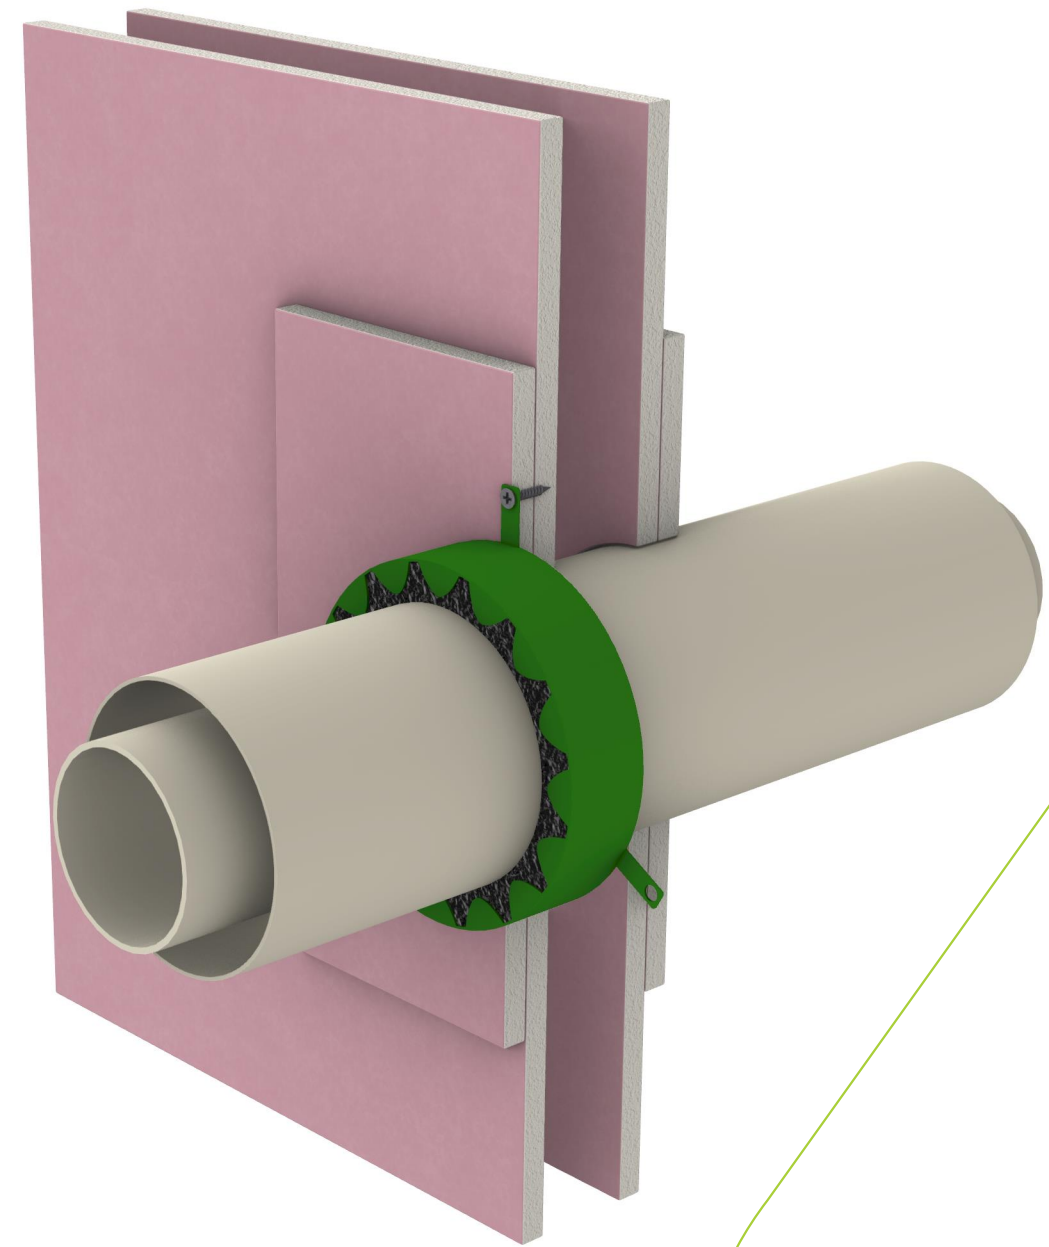


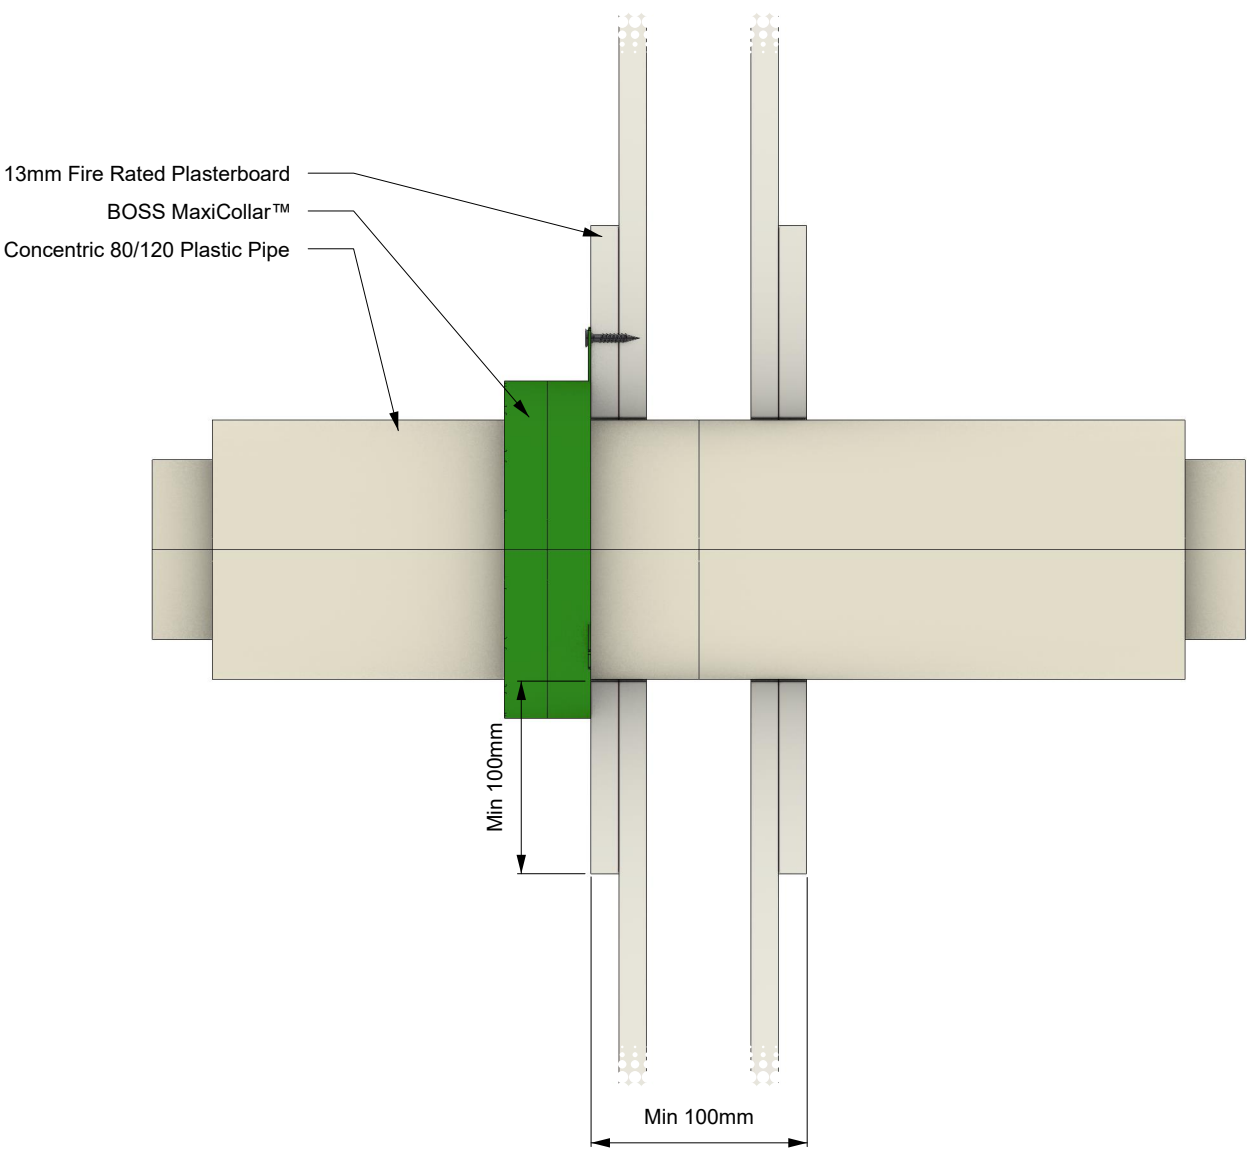

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS MaxiCollar™	-	Concentric 80/120 plastic pipe – 121 mm outer pipe with 1.5 mm wall thickness, and 82 mm inner pipe with 2.4 mm wall thickness. The system includes a 125 mm BOSS MaxiCollar™ installed to the exposed side.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Concentric c80/120 plastic pipe	-	-		Report Reference:		WF FAS 210203	
Substrate:	Single Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3088.1	
Min Substrate Thickness (mm):	100	-	0		Date:	04/09/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.