
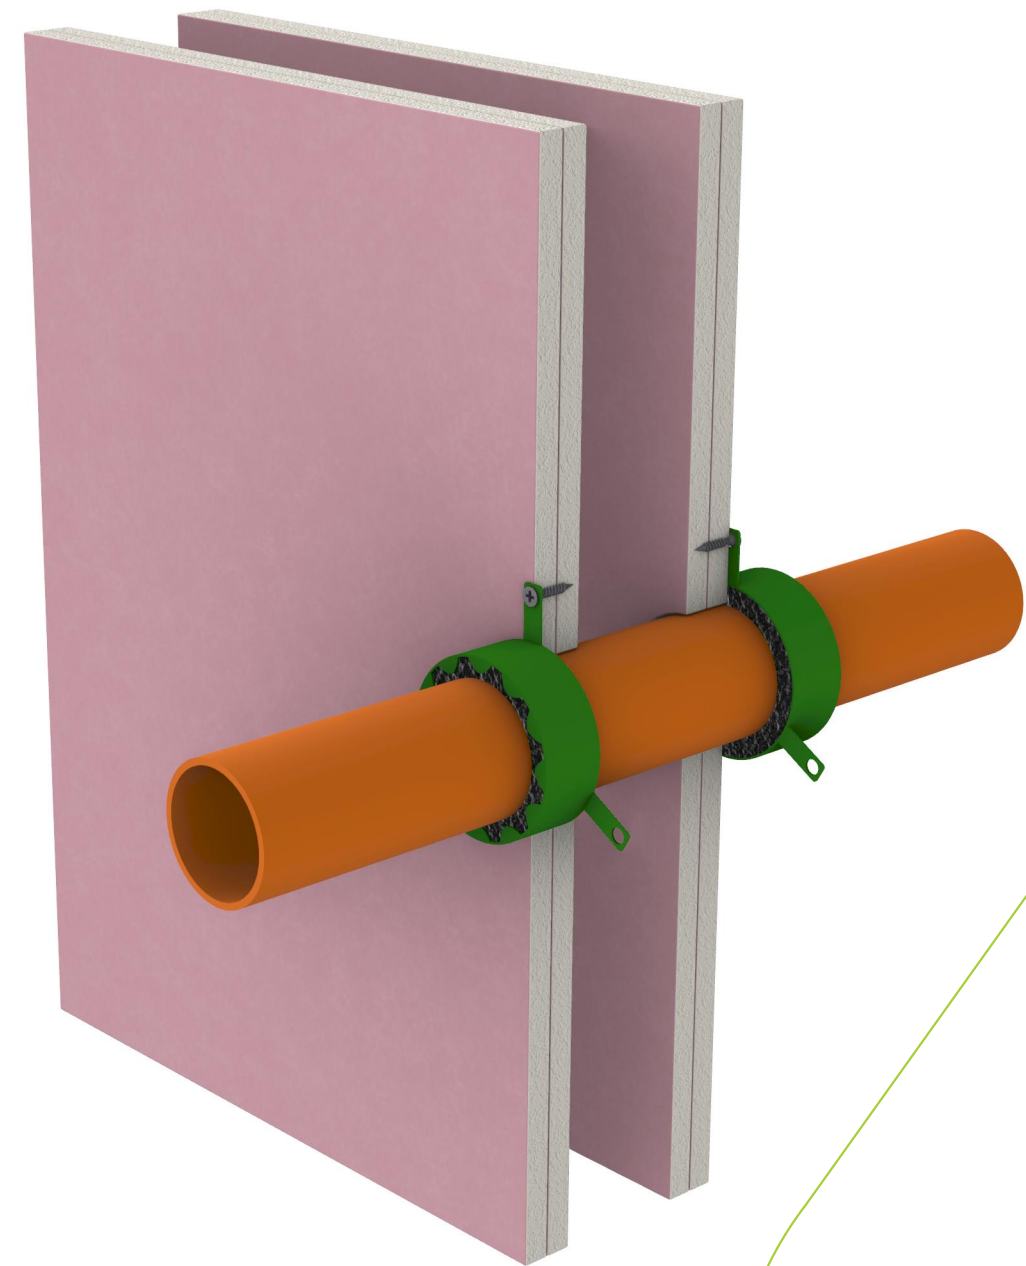


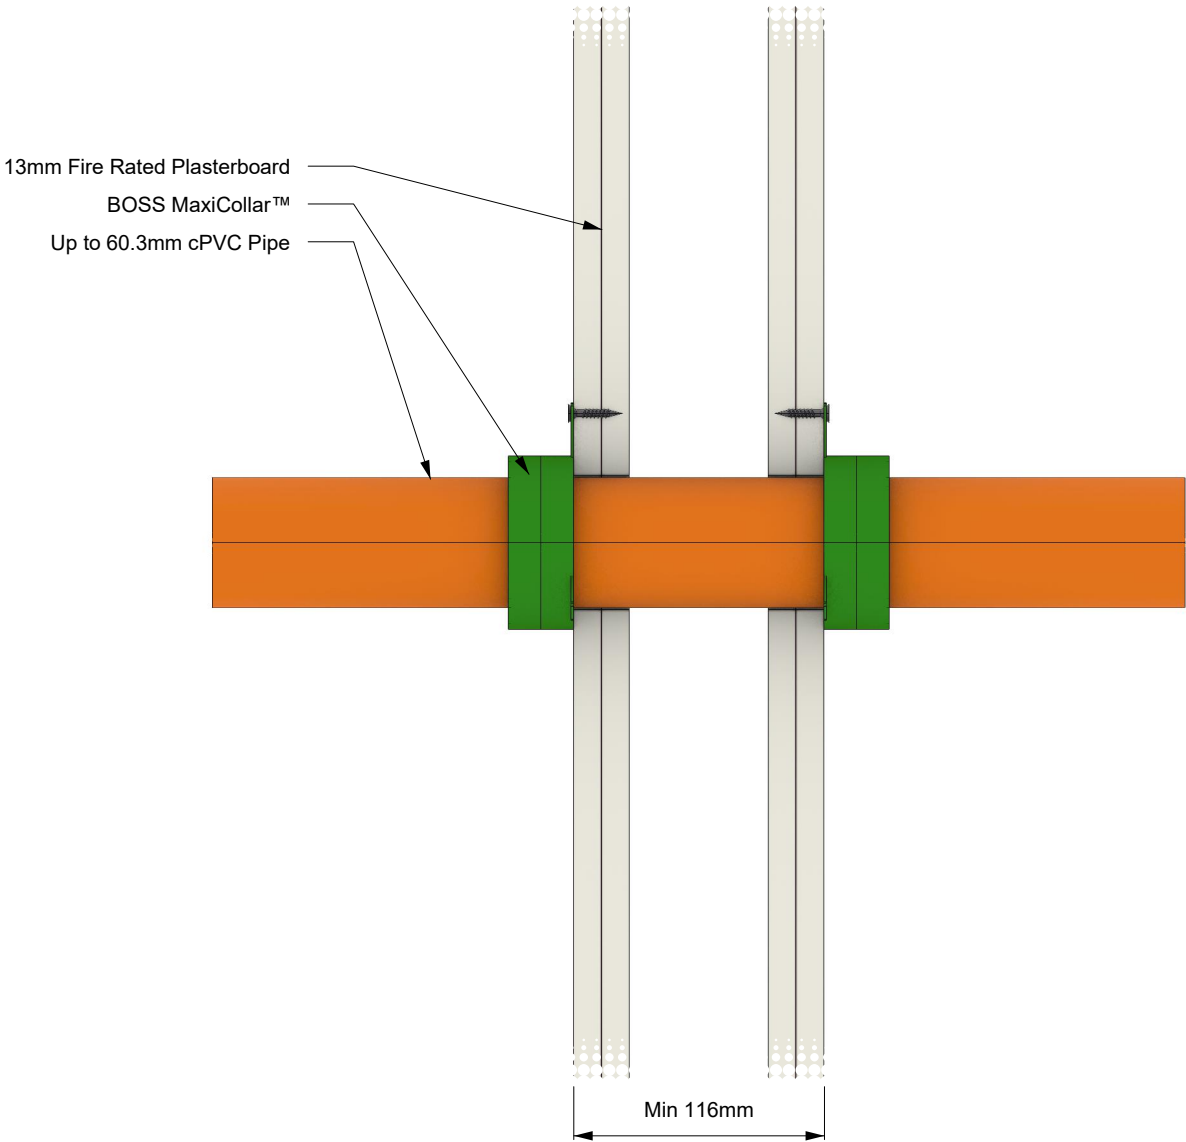

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION								
Orientation:	Wall	BOSS MaxiCollar™	-	Up to 60.3 mm cPVC pipe with 4.7 mm wall thickness. The system includes a 65 mm BOSS MaxiCollar™ installed to both sides.	Reference Standard:		AS 1530.4:2014						
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005						
Service:	CPVC	-	-		Report Reference:		WF FAS 210203						
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3092.2						
Min Substrate Thickness (mm):	116	-	0.85		Date:	04/09/25	Rev:	01					
Sealant Depth (mm):	-	ADDITIONAL INFORMATION											
Sealant Fillet (mm):	-	-											
Wrap Length (mm):	-												
FRL / FRR:	-/120/90												

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.