
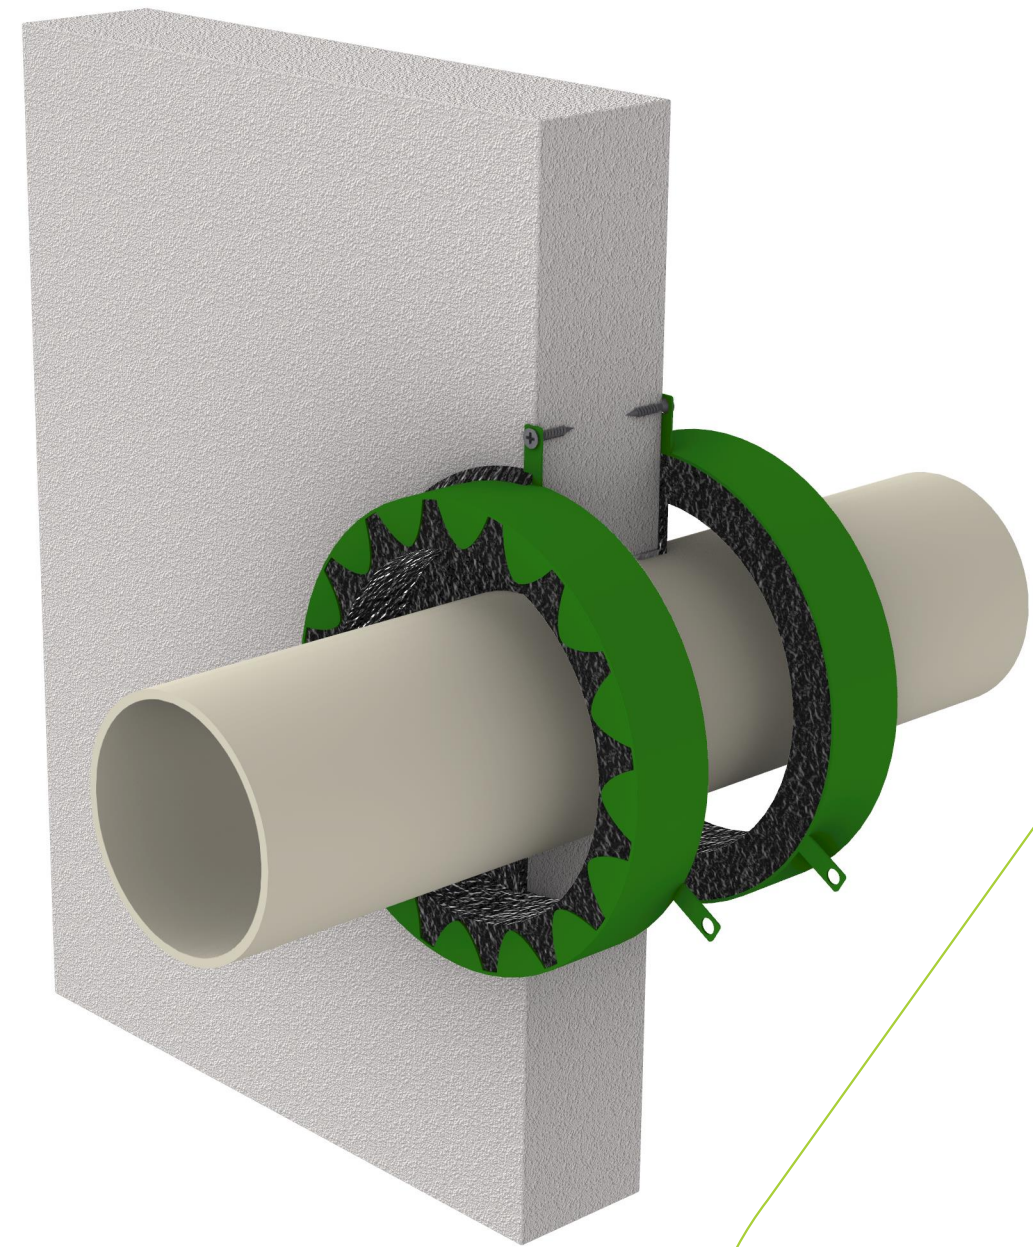


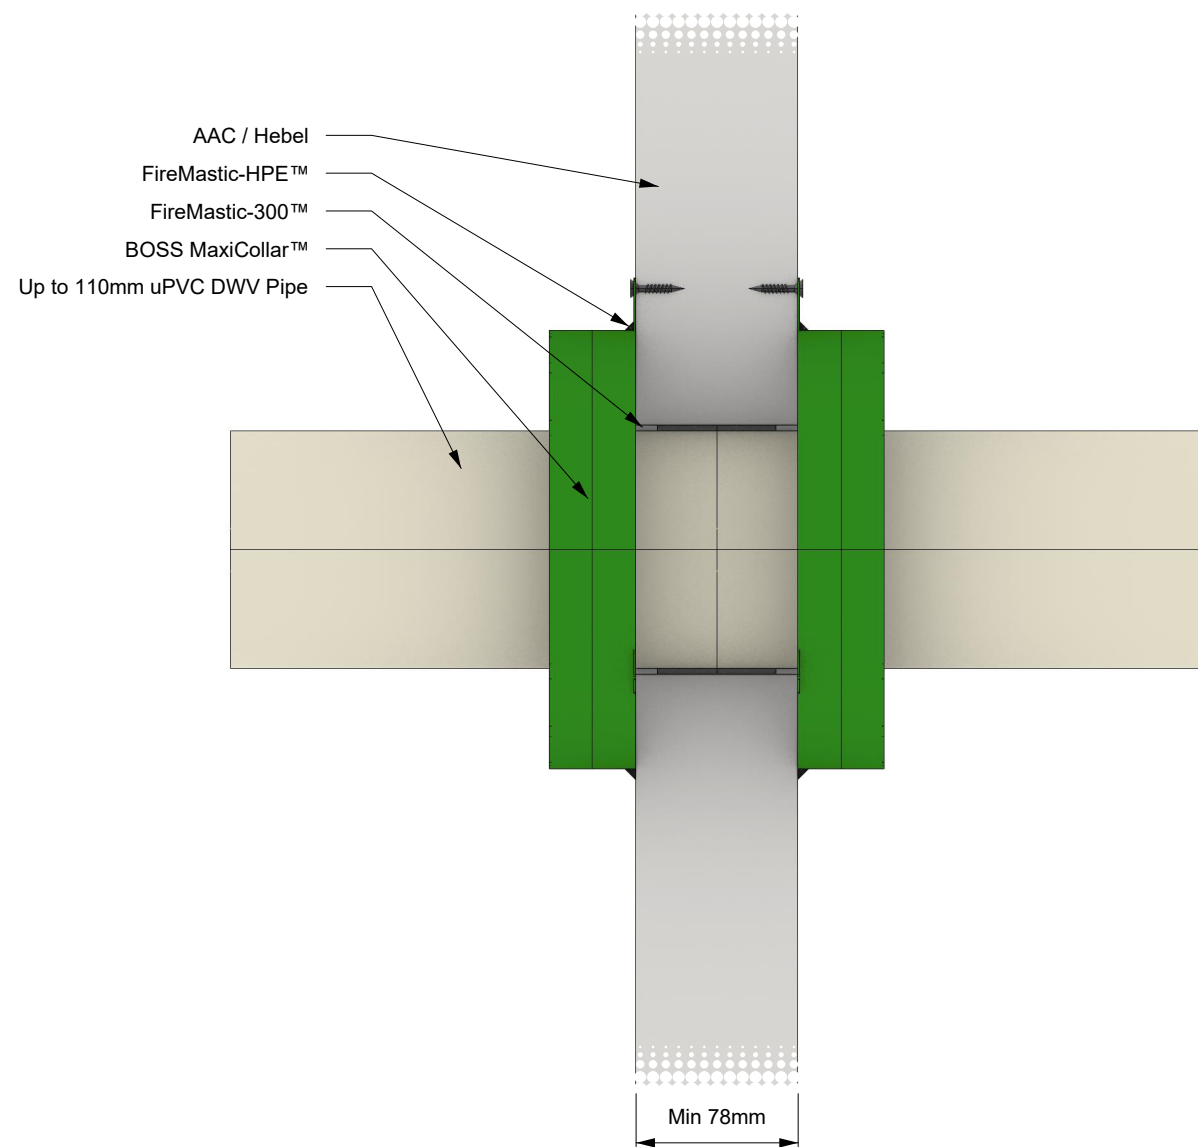

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS MaxiCollar™	-	Up to 110 mm uPVC DWV pipe with 3.5 mm wall thickness. FM-300 sealant installed around service 10 mm deep in annular gap finished flush both sides. FM-HPE sealant was also applied as a 5 mm fillet on the joint between the collar and panel both sides. The system includes a 150 mm BOSS MaxiCollar™ installed to both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS FireMastic-HPE™	-		Report Reference:		WF FAS 210203	
Substrate:	AAC / Hebel	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3098.7	
Min Substrate Thickness (mm):	78	-	2.5		Date:		04/09/25	Rev:
Sealant Depth (mm):	10	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	5							
Wrap Length (mm):	-							
FRL / FRR:	-/240/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.