
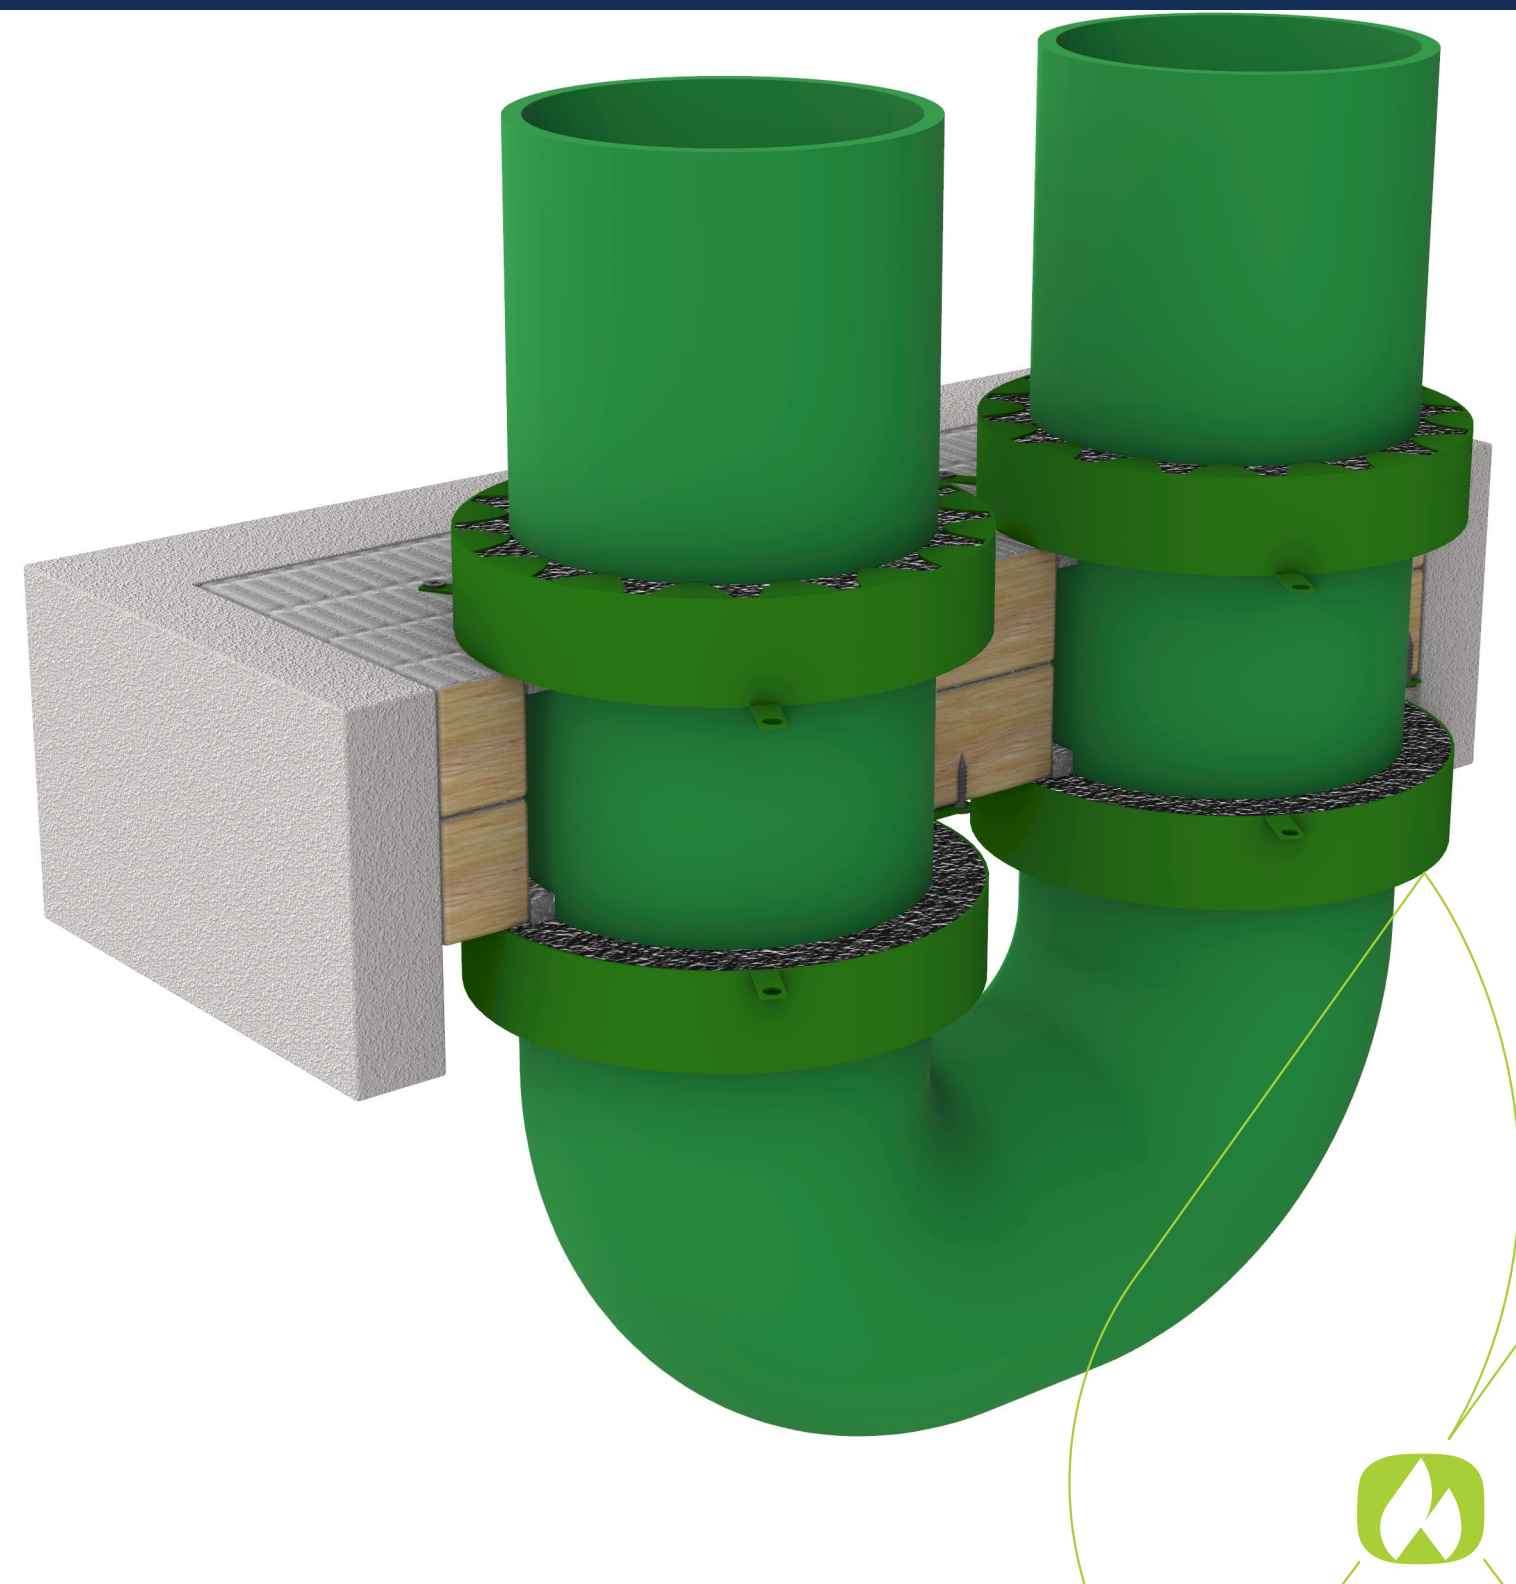


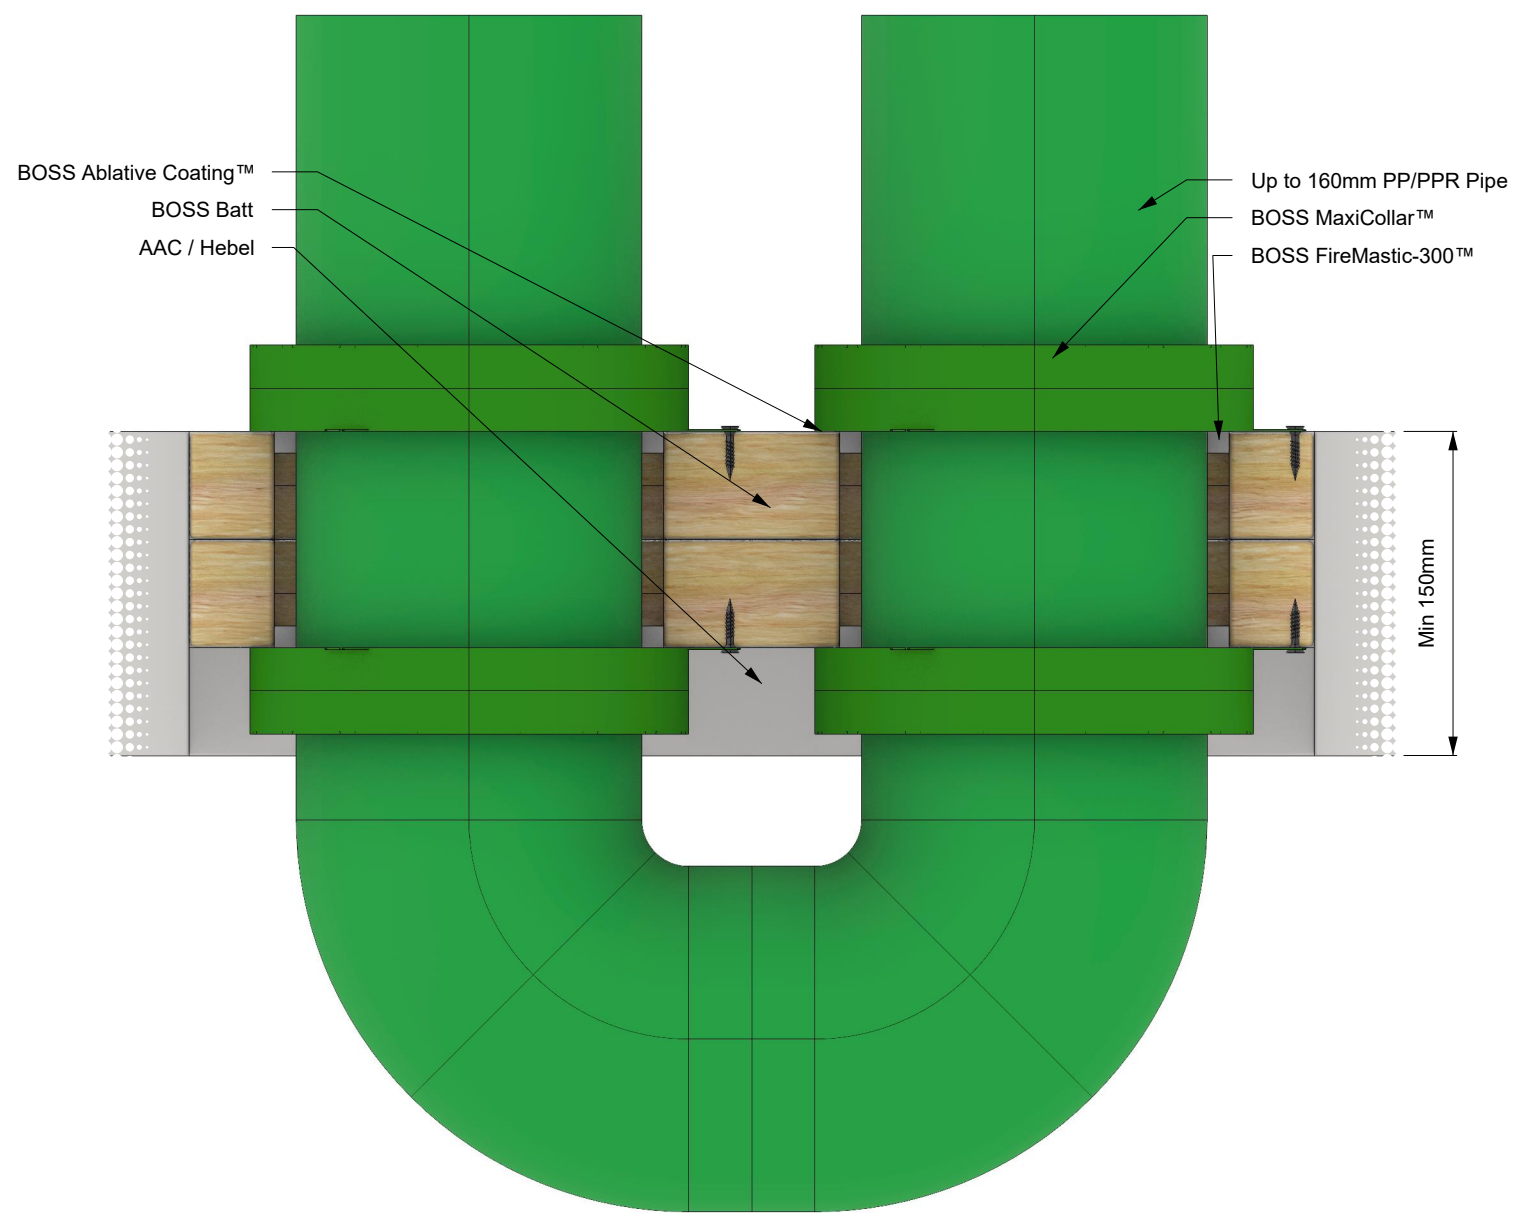

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS Batt™	BOSS FireMastic-300™	Up to 160 mm PP/PPR pipe with 4.0 mm maximum wall thickness, penetrating 2 layers of BOSS Batt™ protecting an aperture up to 1200 mm x 500 mm, installed with 2 90° fittings on the underside to form a U-bend that penetrates the separating element twice. Sealant 10.0 mm deep in 10.0 mm annular gap on both sides for each penetration point. 160 mm BOSS MaxiCollar™ installed on both sides of each penetration point.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PPR	BOSS MaxiCollar™	-		Report Reference:		WF FAS 210203	
Substrate:	AAC / Hebel Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3142.26	
Min Substrate Thickness (mm):	150	Up to 1200 x 500	10.0		Date:	25/08/25	Rev:	01
Sealant Depth (mm):	10	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/-							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.