
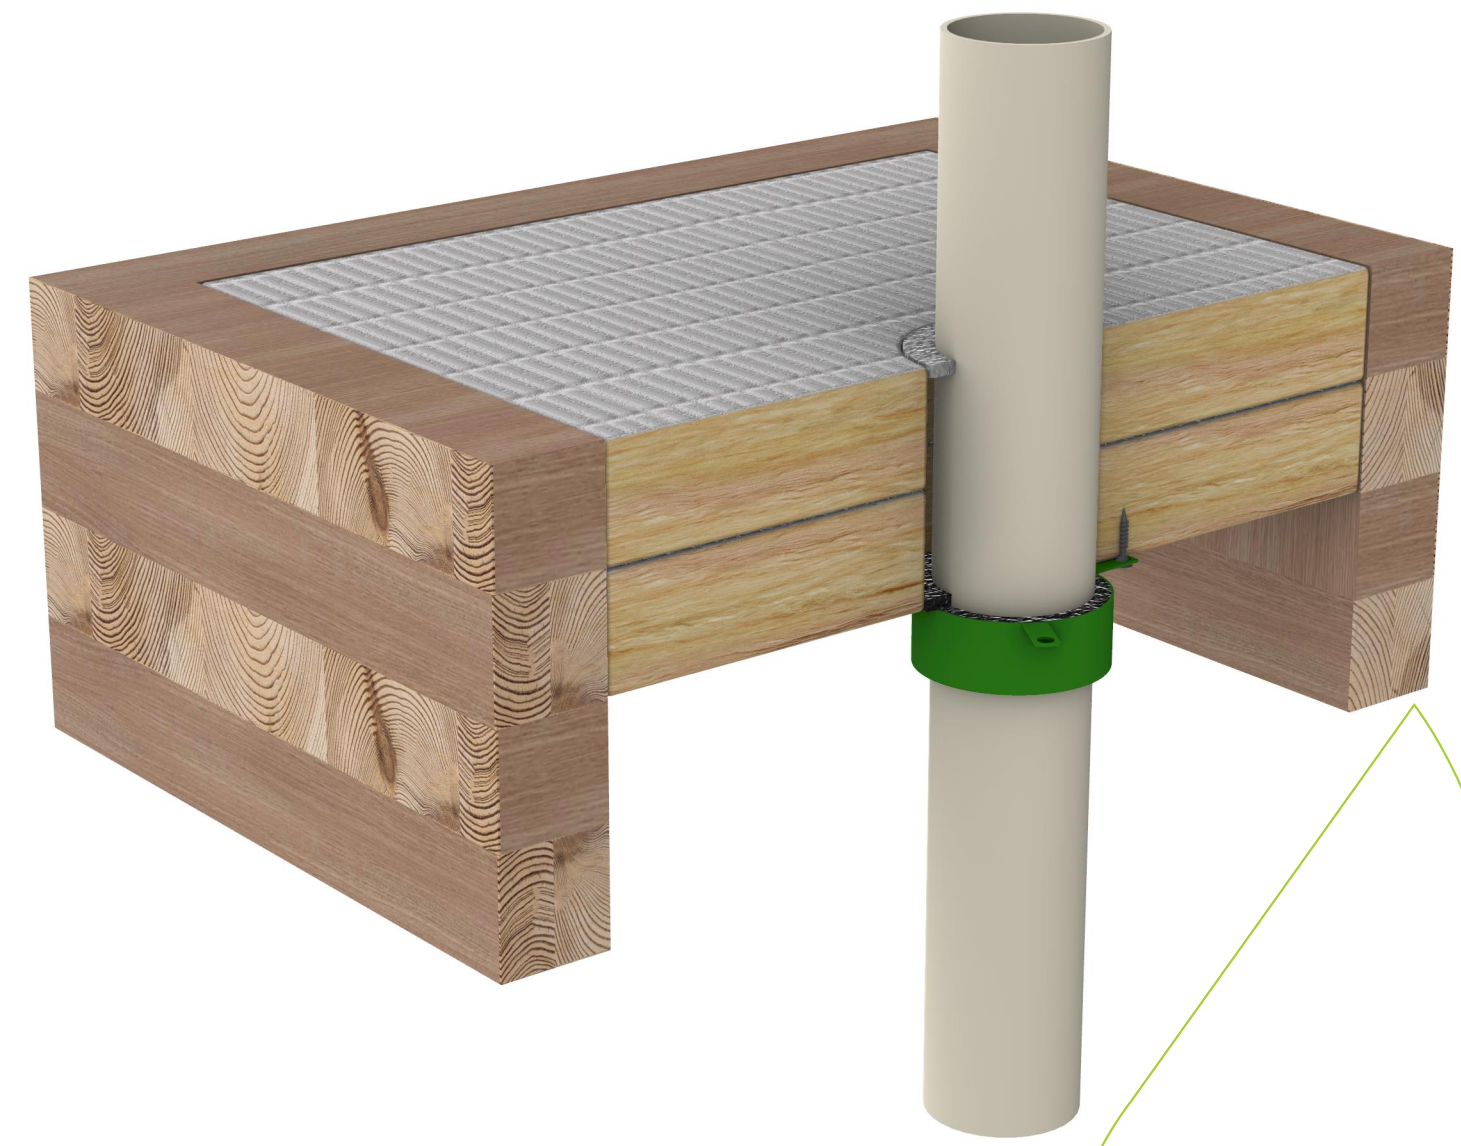


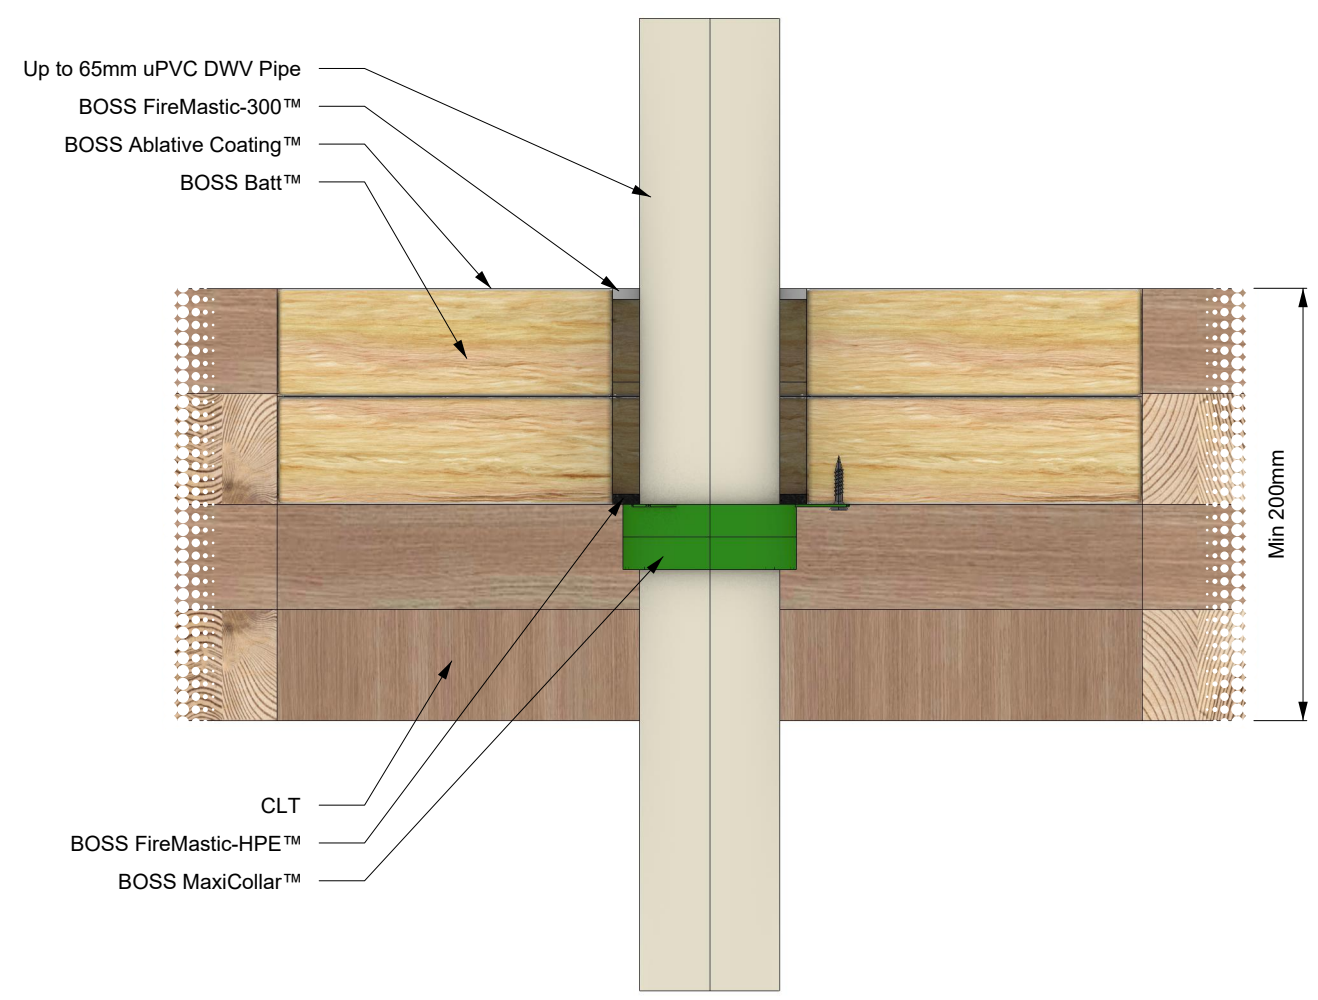

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS Batt™	BOSS FireMastic-300™	Up to 65 mm uPVC DWV pipe with 2.7 mm maximum wall thickness, penetrating 2 layers of BOSS Batt™ protecting an aperture up to 1200 mm x 500 mm. BOSS FireMastic-300™ sealant is used to the top side and BOSS FireMastic-HPE™ sealant is used to the underside. Sealant 5.0 mm deep in 12.5 mm annular gap both sides. 80 mm BOSS MaxiCollar™ installed on the underside.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	BOSS FireMastic-HPE™		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS MaxiCollar™	-		Report Reference:		WF FAS 210203	
Substrate:	CLT (Horiz)	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3155.33	
Min Substrate Thickness (mm):	200	Up to 1200 x 500	12.5		Date:	27/08/25	Rev:	01
Sealant Depth (mm):	5	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.