
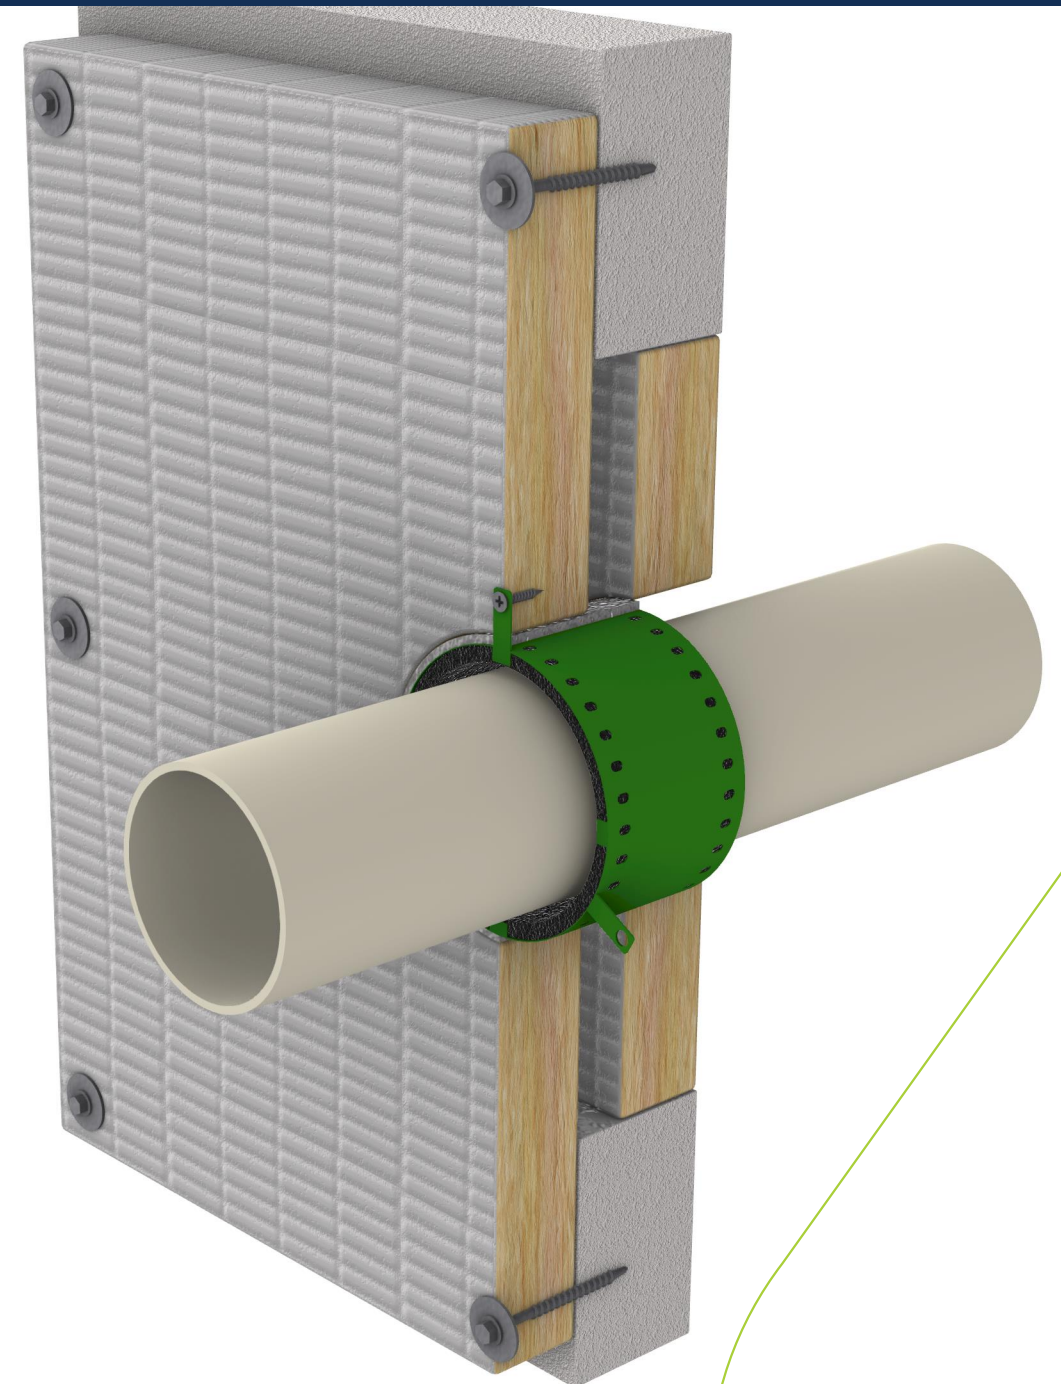


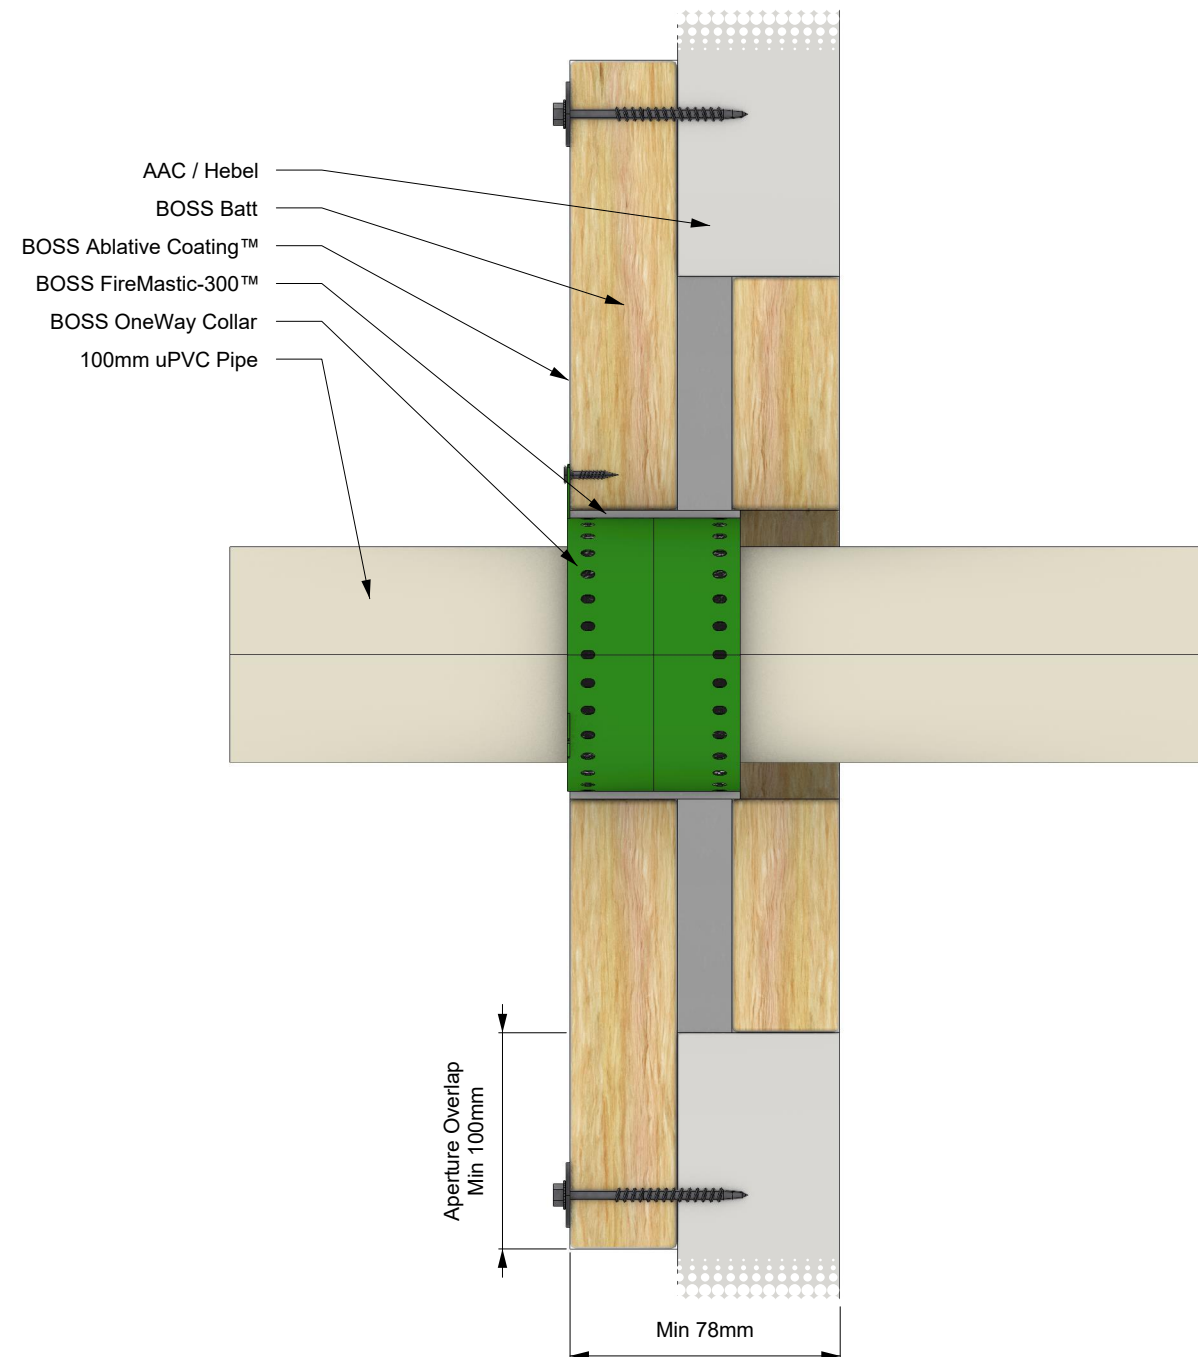

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS FireMastic-300™	100 mm uPVC pipe with 3.3 mm maximum wall thickness, penetrating 2 layers of BOSS Batt™ protecting an aperture up to 1200 mm x 500 mm, installed through a 100 mm BOSS OneWay collar centrally located through the separating element. Sealant installed full depth in 15.0 mm annular gap between the 130 mm aperture and the in-wall collar.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS OneWay collar	-		Report Reference:		WF FAS 210203	
Substrate:	AAC / Hebel	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3161.7	
Min Substrate Thickness (mm):	78	Up to 1200 x 500	15.0		Date:		27/08/25	Rev:
Sealant Depth (mm):	Full depth	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.