
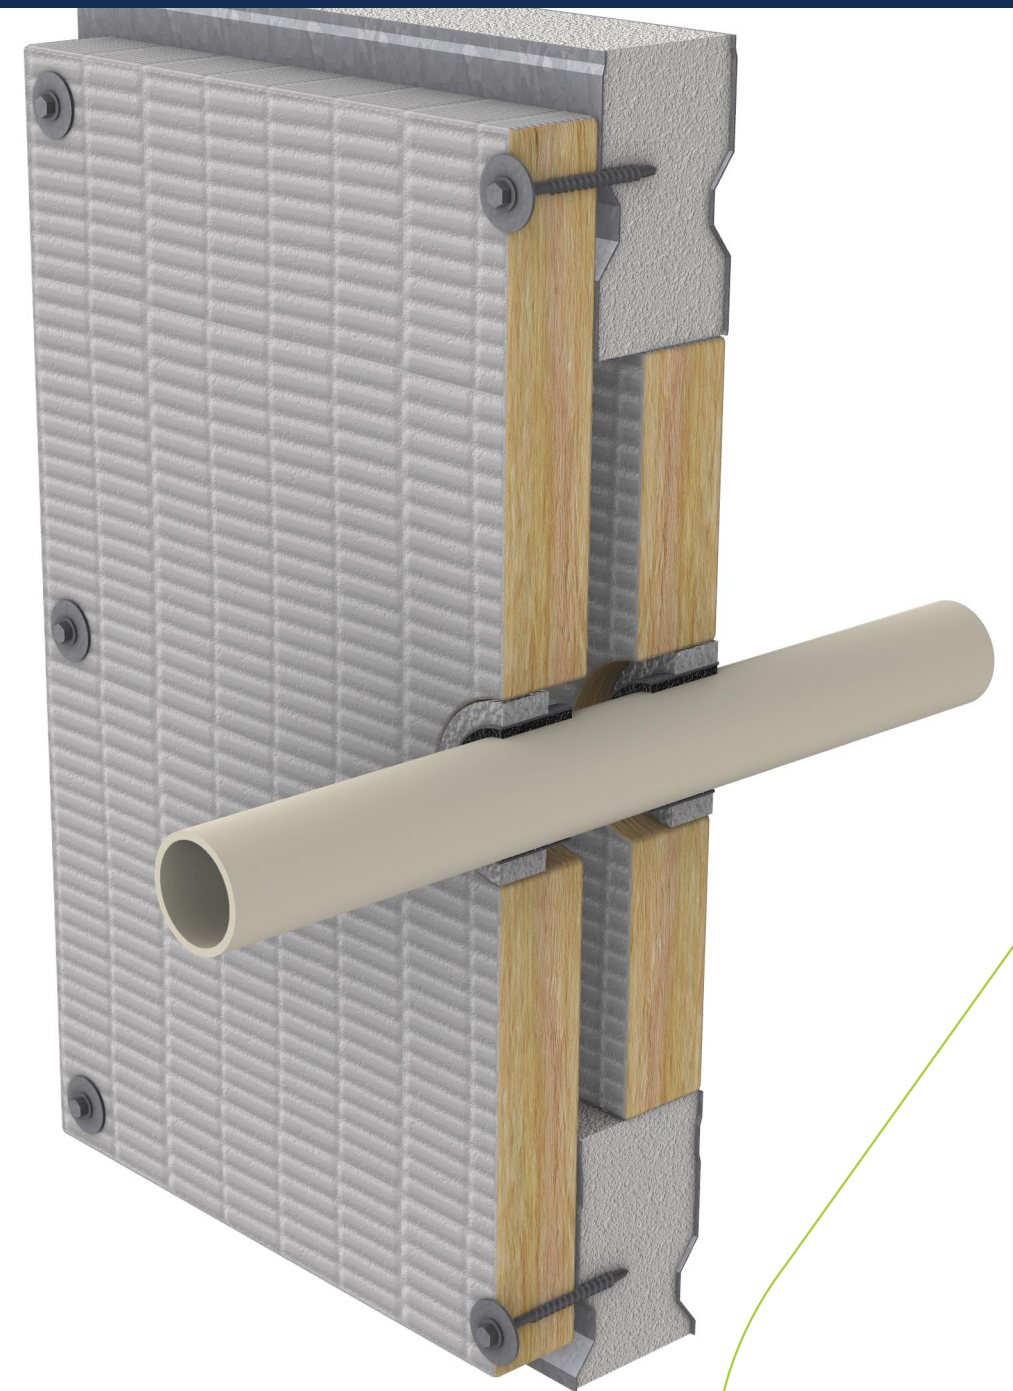


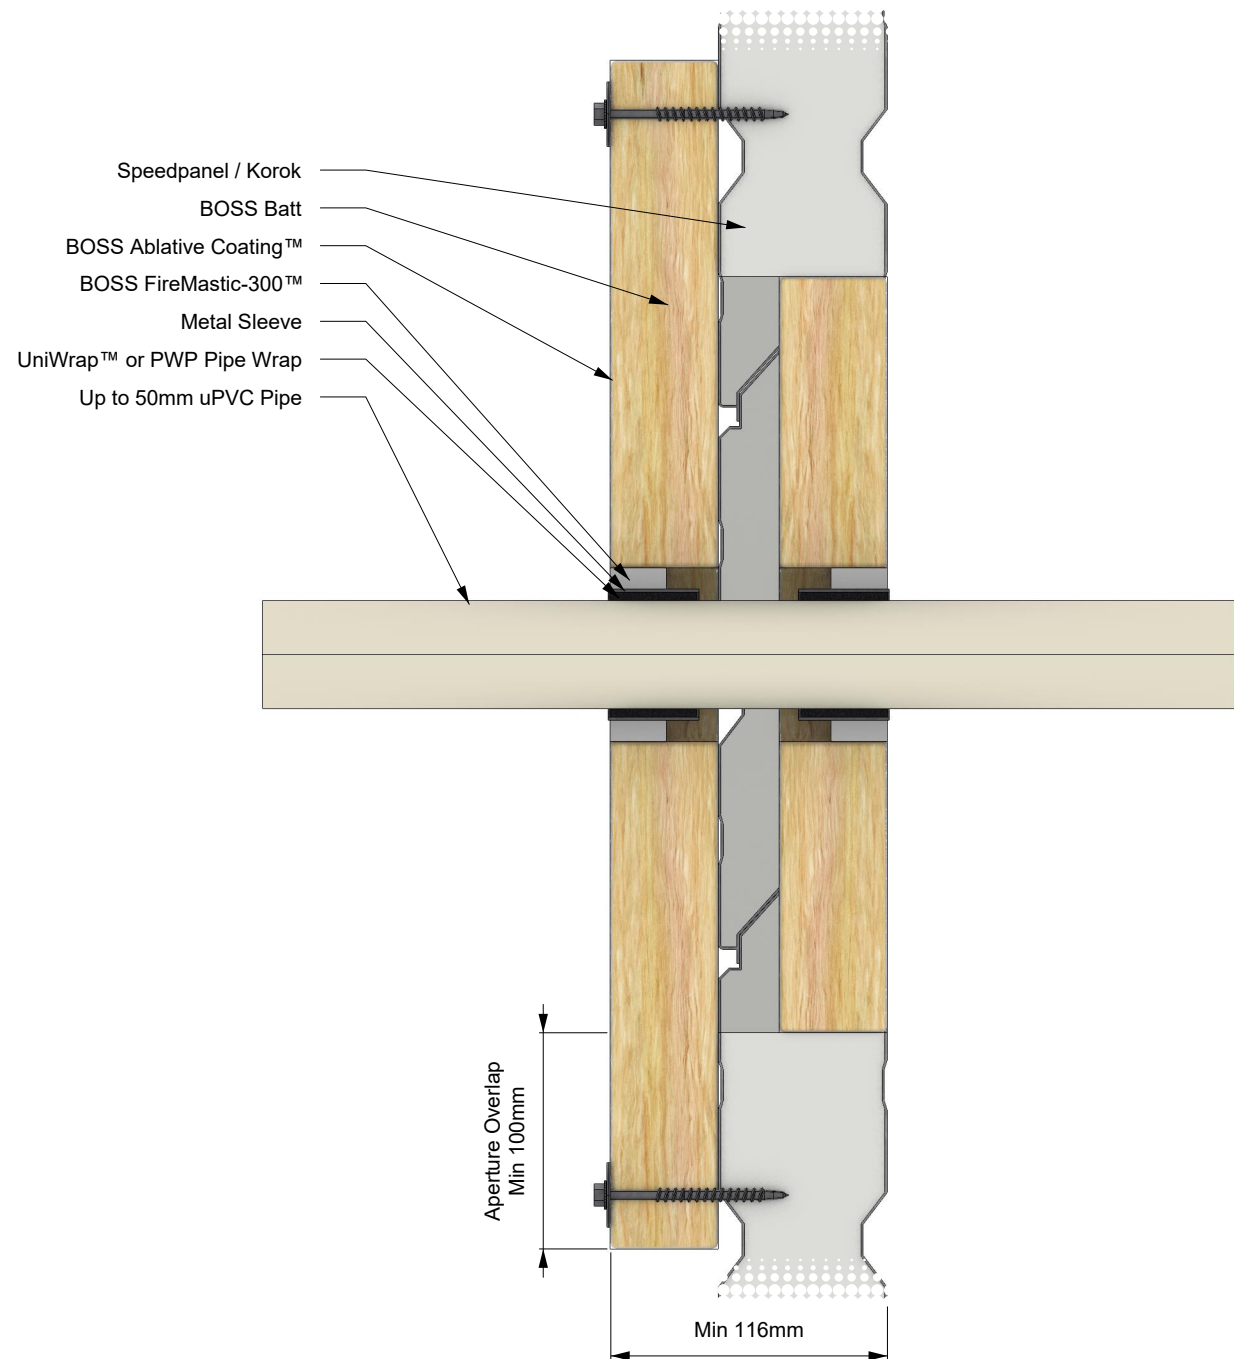

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS PWP Pipe Wrap	Up to 50 mm uPVC pipe with 3.5 mm maximum wall thickness, penetrating 2 layers of BOSS Batt™ protecting an aperture up to 600 mm x 600 mm. 2 layers of BOSS UniWrap™ or BOSS PWP Pipe Wrap encased in a metal sleeve, flush with the face of the separating element on both sides. Sealant 26 mm deep in 10.0 mm annular gap between the wall, service and metal sleeve, finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	BOSS FireMastic-300™		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS UniWrap™	-		Report Reference:		WF FAS 210203	
Substrate:	Speedpanel / Korok	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3168.6	
Min Substrate Thickness (mm):	116	Up to 600 x 600	10		Date:		01/09/25	Rev:
Sealant Depth (mm):	26	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.