
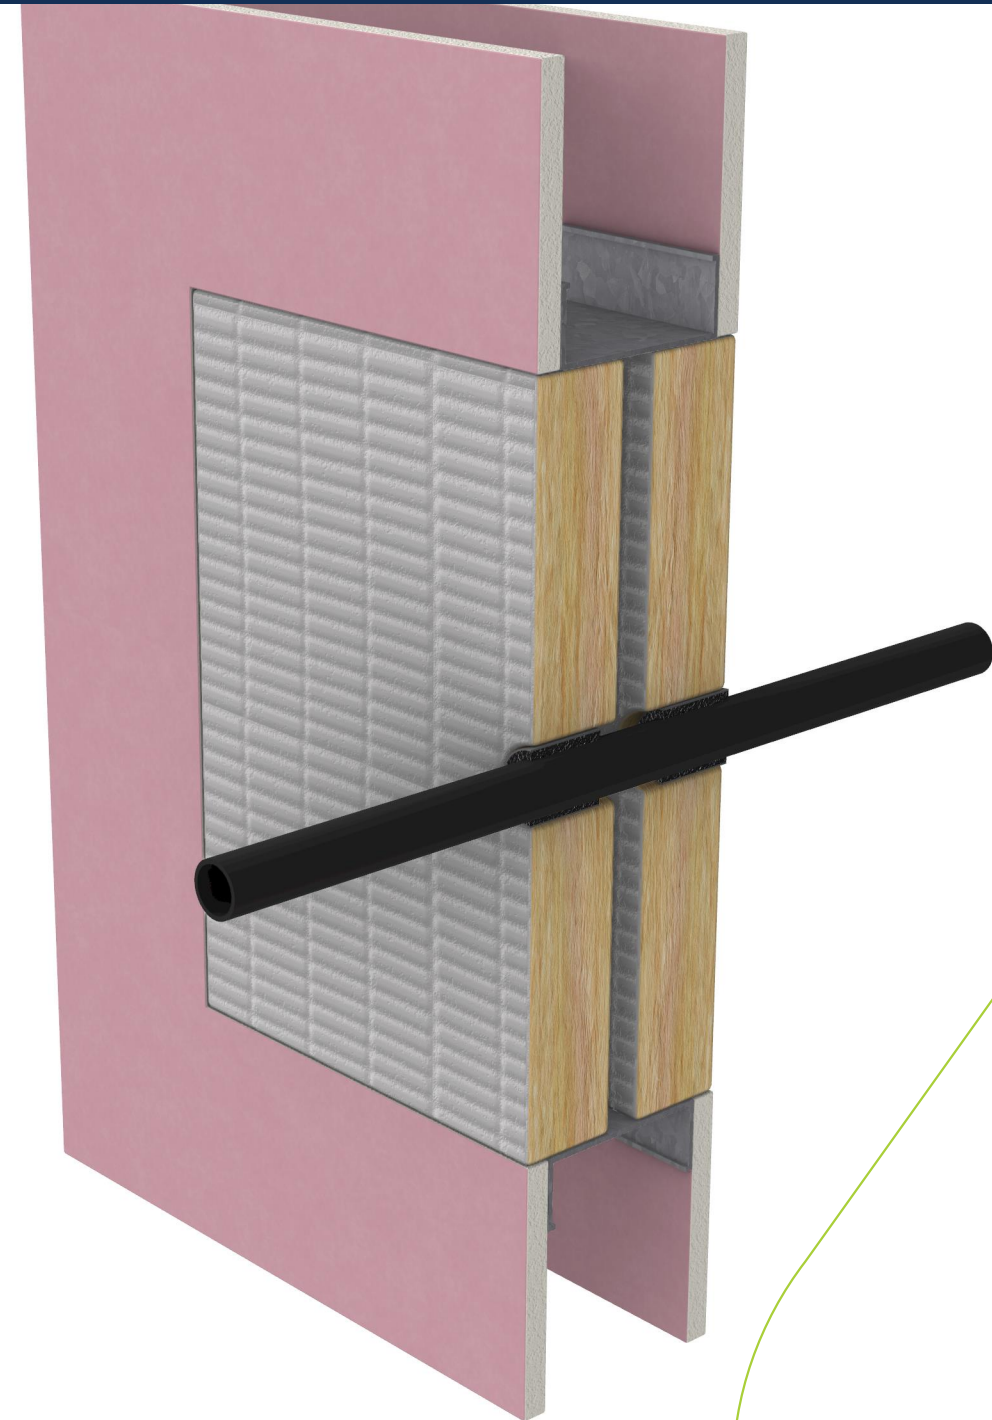


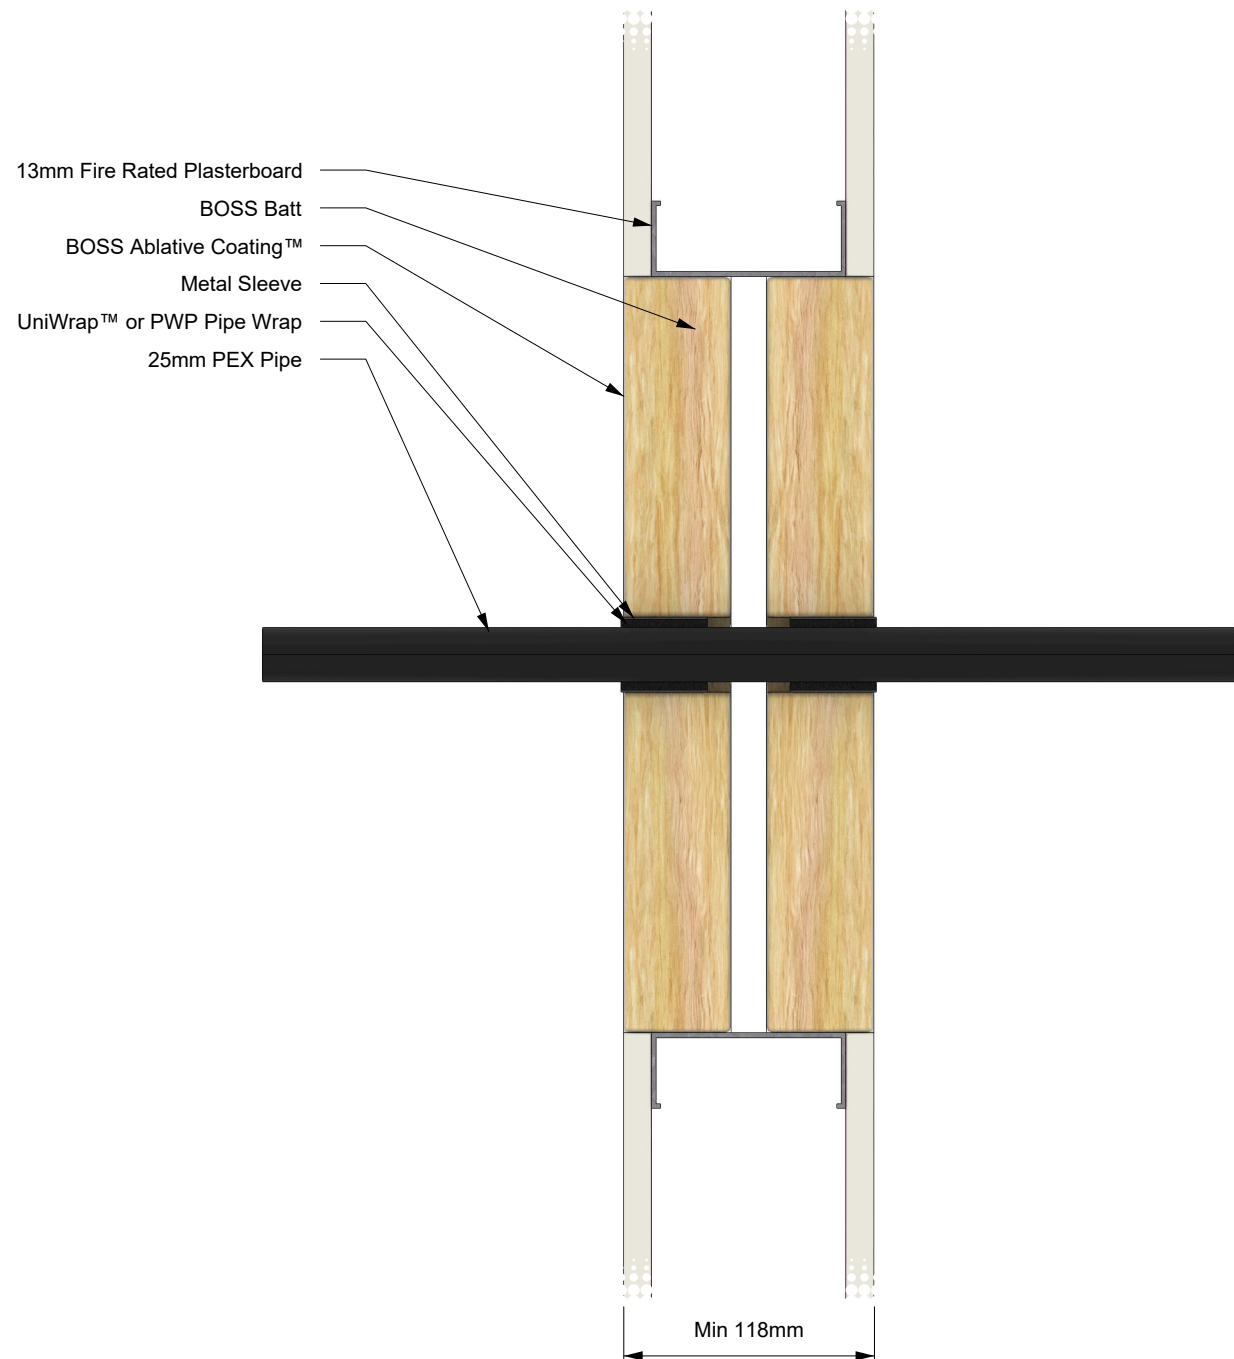

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS PWP Pipe Wrap	Up to 25 mm PEX pipe with 6.2 mm maximum wall thickness, penetrating 2 layers of BOSS Batt™ protecting an aperture up to 600 mm x 600 mm. 2 layers of BOSS UniWrap™ or BOSS PWP Pipe Wrap encased in a metal sleeve, flush with the face of the separating element on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PEX	BOSS UniWrap™	-		Report Reference:		WF FAS 210203	
Substrate:	Single Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3173.1	
Min Substrate Thickness (mm):	118	Up to 600 x 600	5		Date:	01/09/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-	-						
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							