
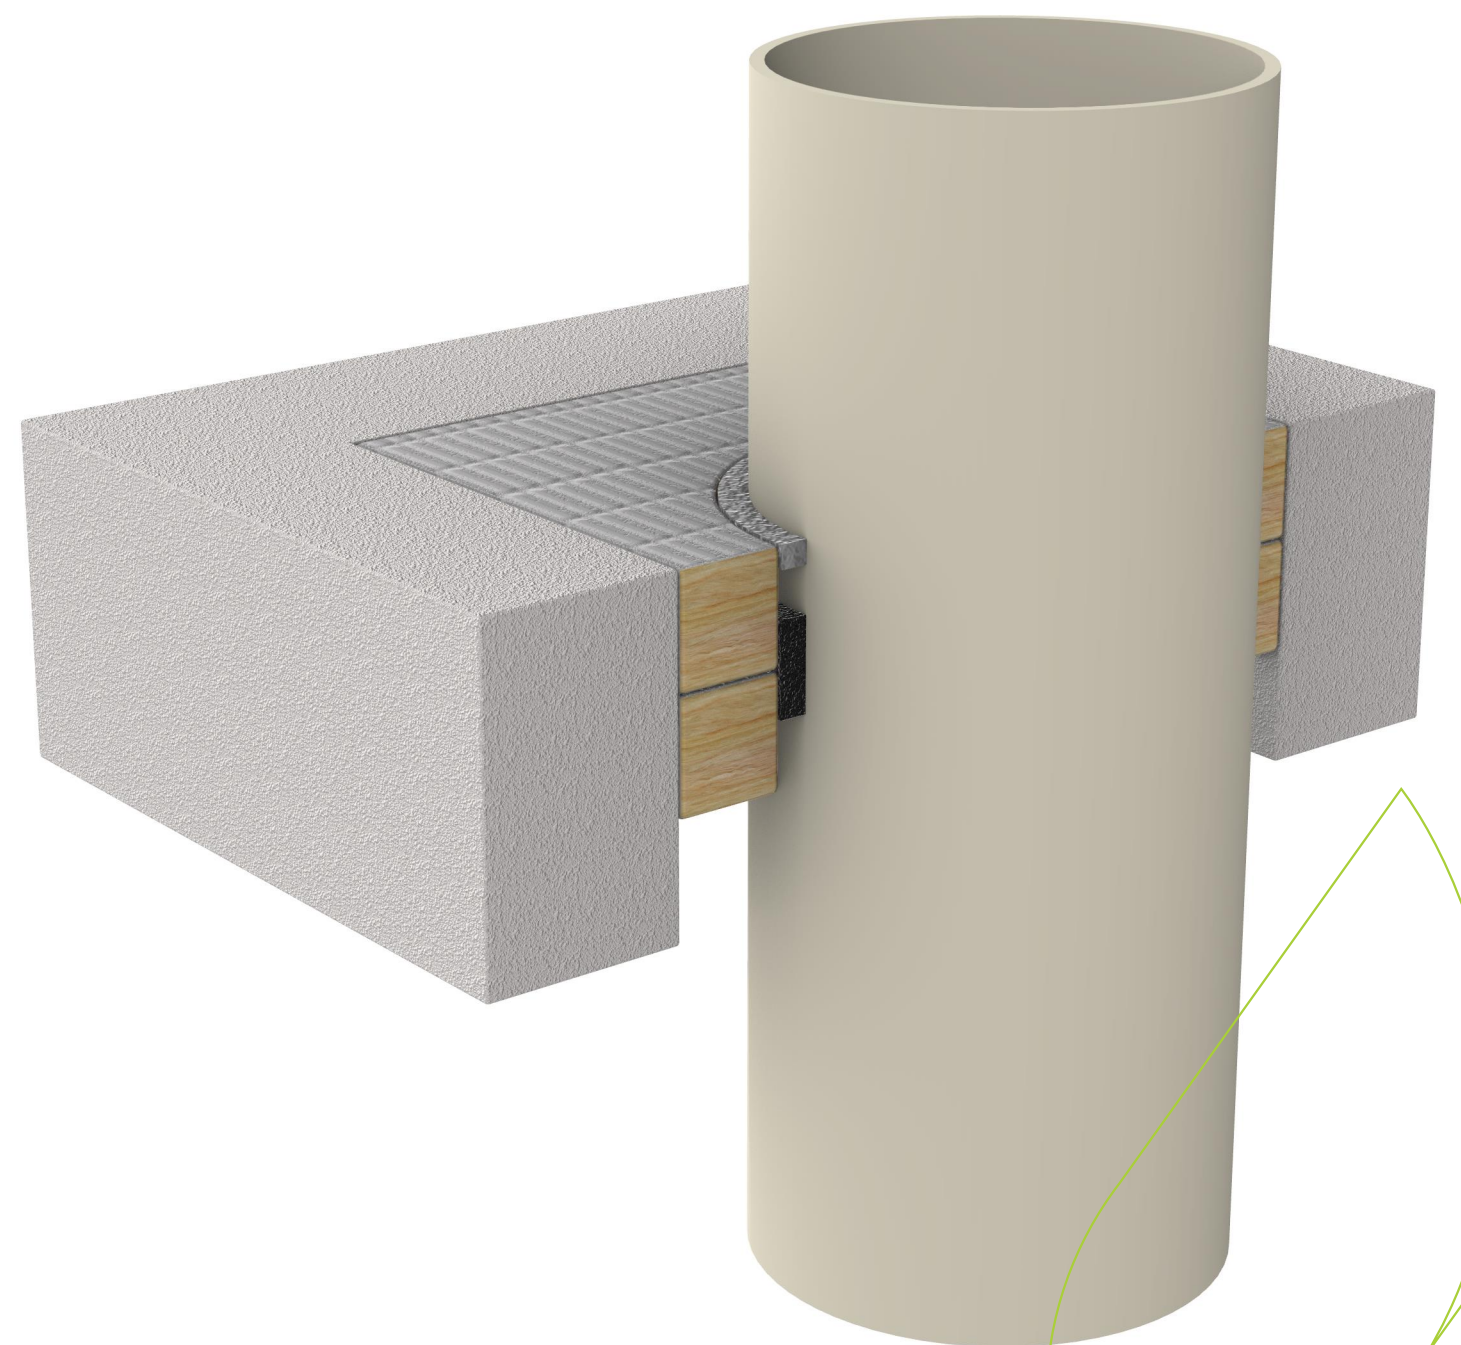


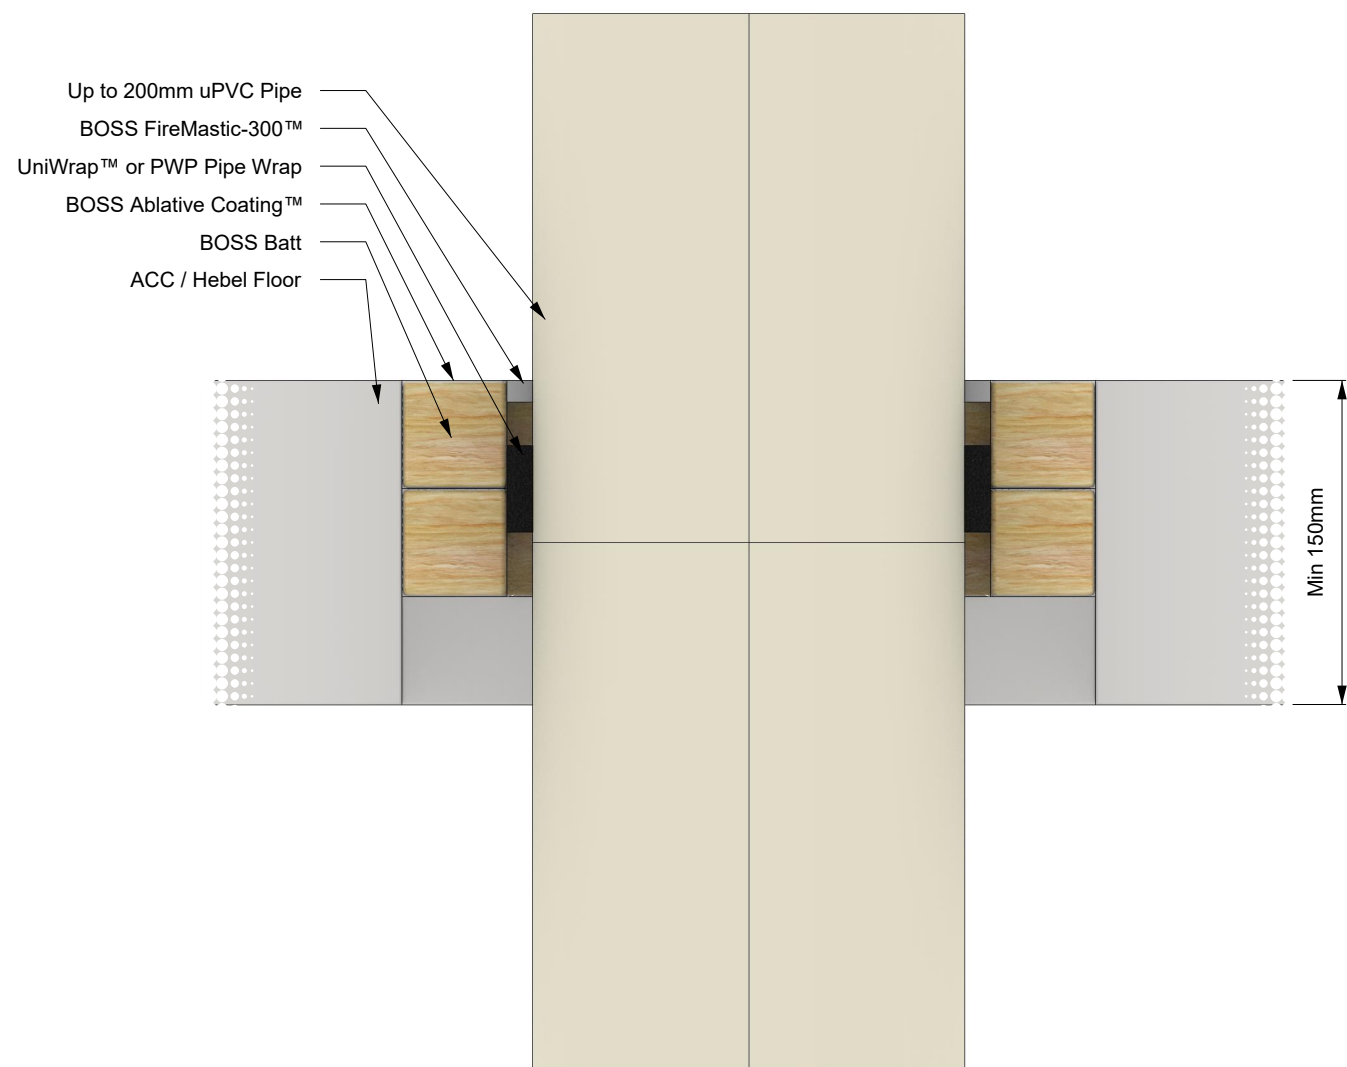

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS Batt™	BOSS PWP Pipe Wrap	Up to 200 mm uPVC pipe with 7.7 mm – 9.6 mm wall thickness, penetrating 1 layer of BOSS Batt™ protecting an aperture up to 600 mm x 600 mm. 10 layers of BOSS UniWrap™ or BOSS PWP Pipe Wrap mid-depth of the floor. Sealant 10.0 mm deep in 12.0 mm annular gap to the top side.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	BOSS FireMastic-300™		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS UniWrap™	-		Report Reference:		WF FAS 210203	
Substrate:	AAC / Hebel Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3180.26	
Min Substrate Thickness (mm):	150	Up to 600 x 600	12		Date:	01/09/25	Rev:	01
Sealant Depth (mm):	10	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							