
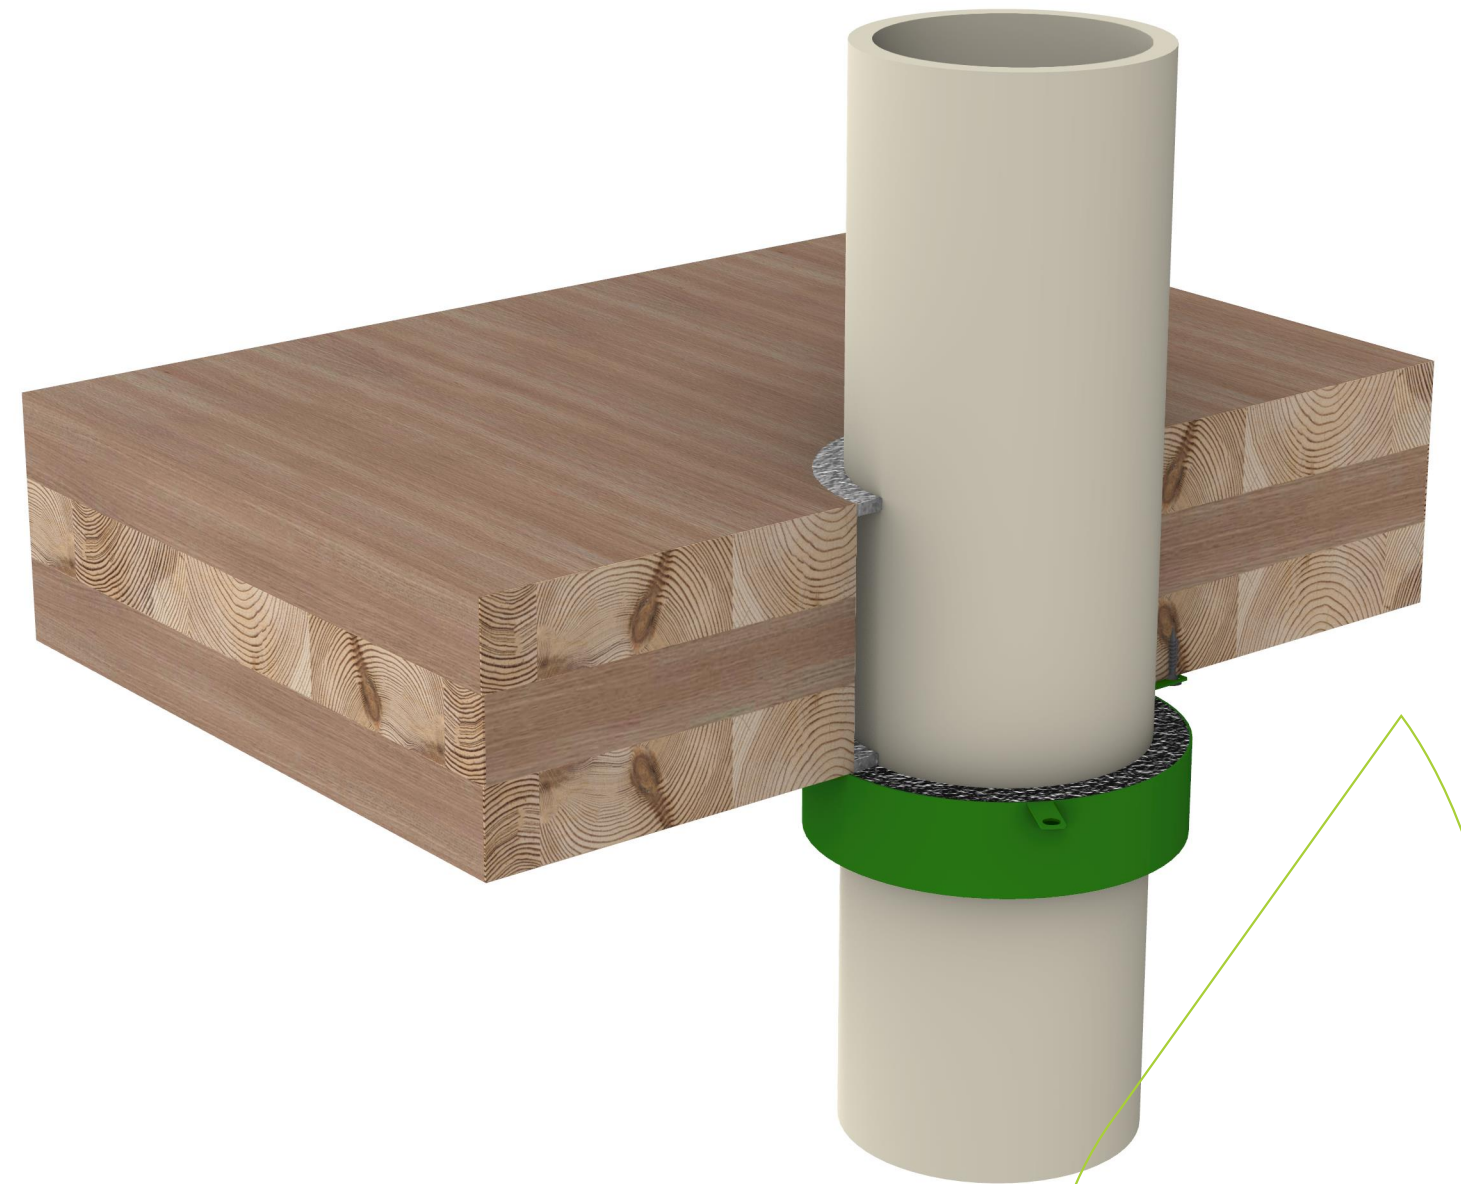


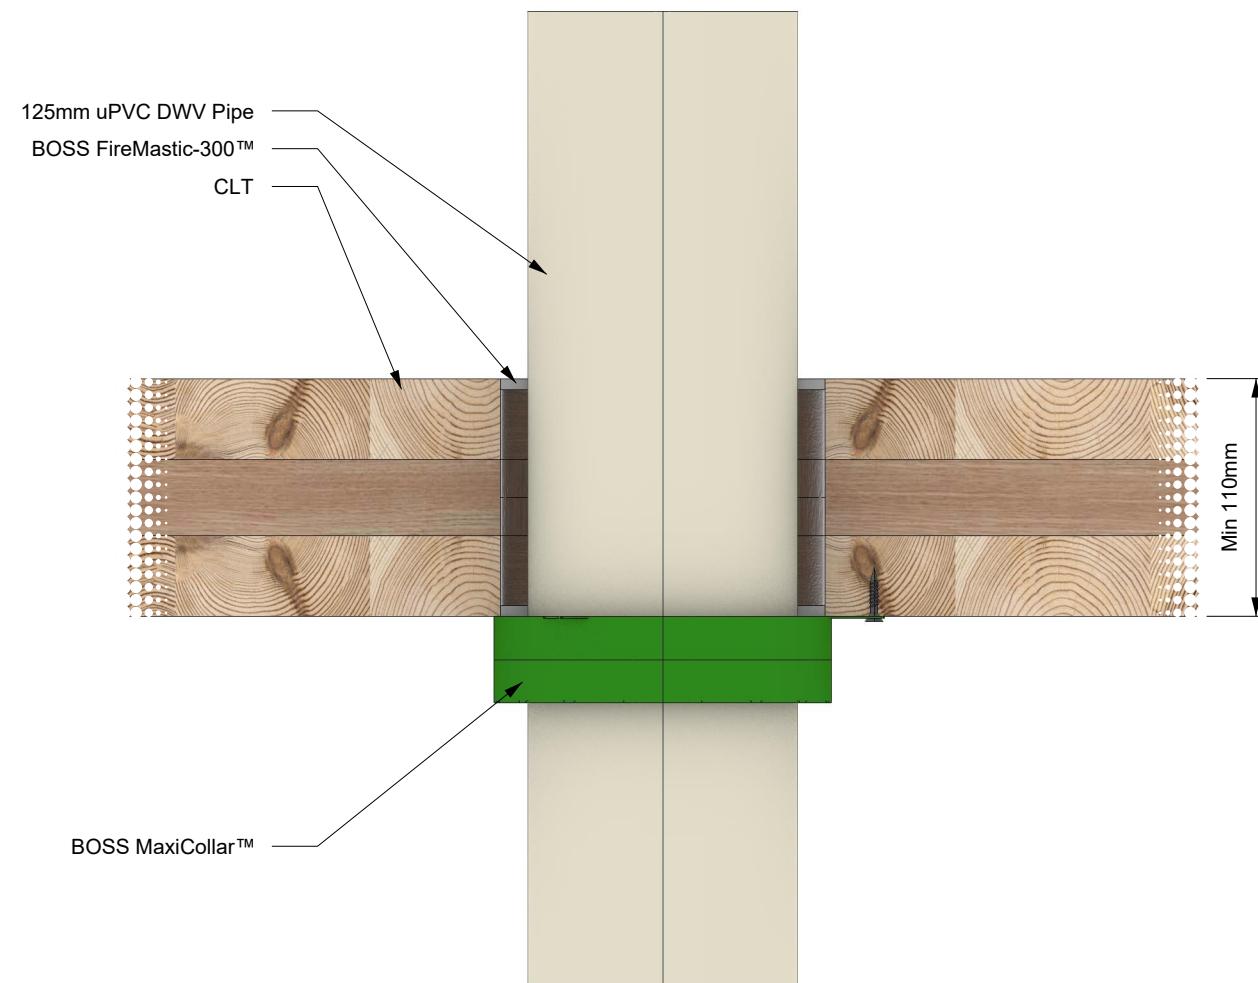

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS MaxiCollar™	-	125 mm uPVC DWV pipe. BOSS FireMastic-300™ sealant 5.0 mm deep in annular gap both sides. 125 mm BOSS MaxiCollar™ installed on the under-side.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	-	-		Report Reference:		147941.00FTR 1024	
Substrate:	CLT (Horiz)	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3207.33	
Min Substrate Thickness (mm):	110	150	-		Date:		25/07/25	Rev:
Sealant Depth (mm):	5	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.