


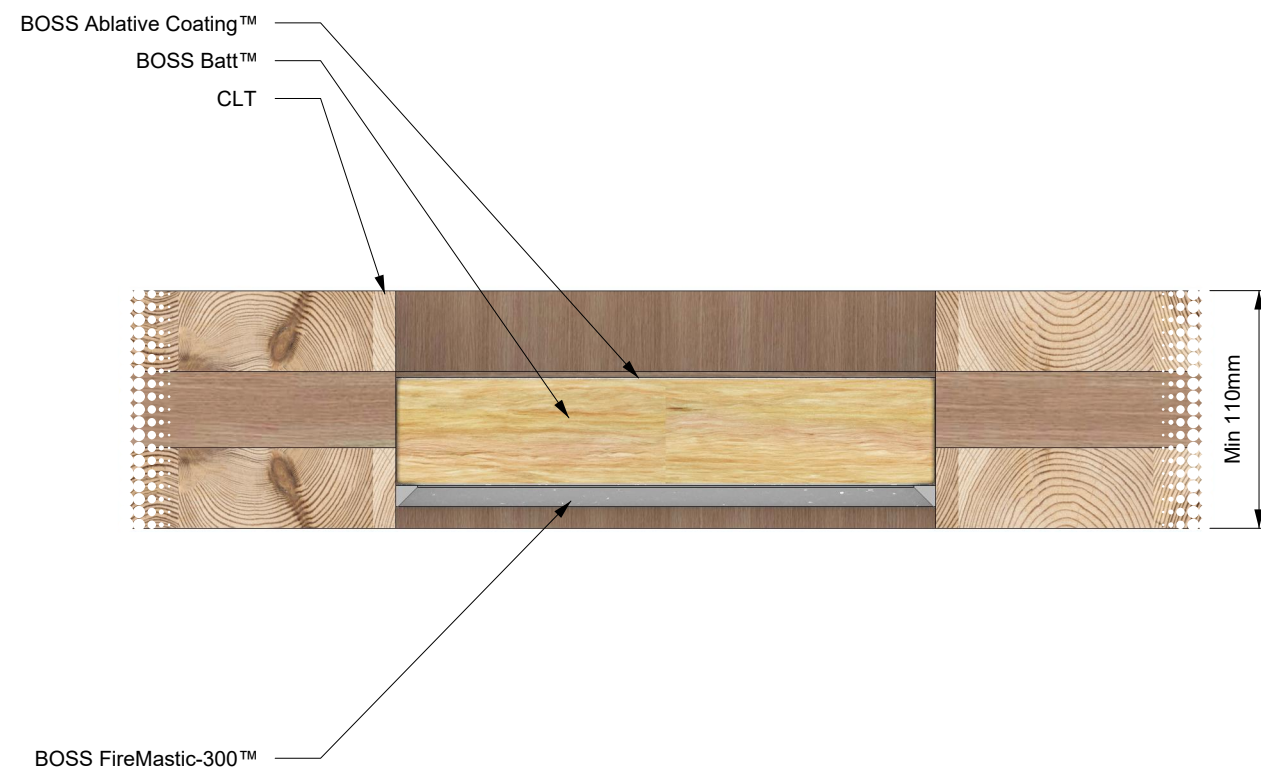

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS Batt™	-	Aperture size of 250 mm x 250 mm in the CLT slab. A 252 mm x 252 mm BOSS Batt™ friction fitted into the opening. The BOSS batt is to be recessed 20 mm from the bottom edge of the slab, with a 10 mm x 10 mm fillet of BOSS FireMastic-300™ around the edges on the underside.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Construction (Linear Gaps / Blank Seals)	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	BOSS FireMastic-300™	-		Report Reference:		147941.00FTR 1024	
Substrate:	CLT (Horiz)	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3210.33	
Min Substrate Thickness (mm):	110	250 x 250	-		Date:		25/07/25	Rev:
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	10							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.