
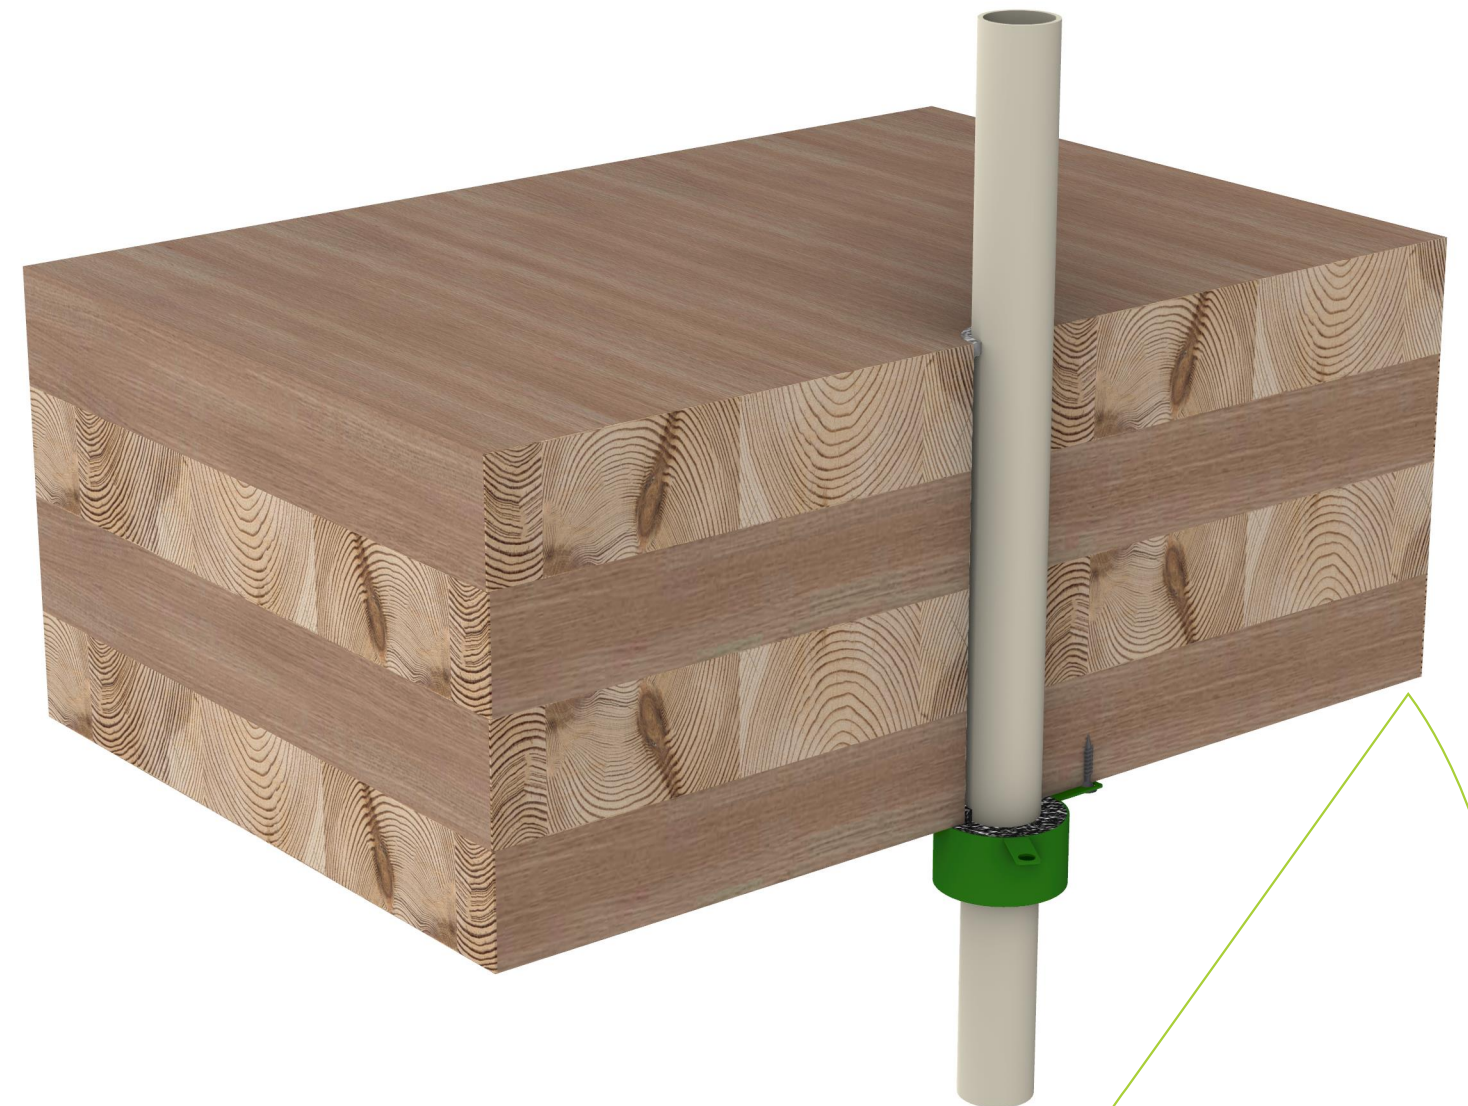


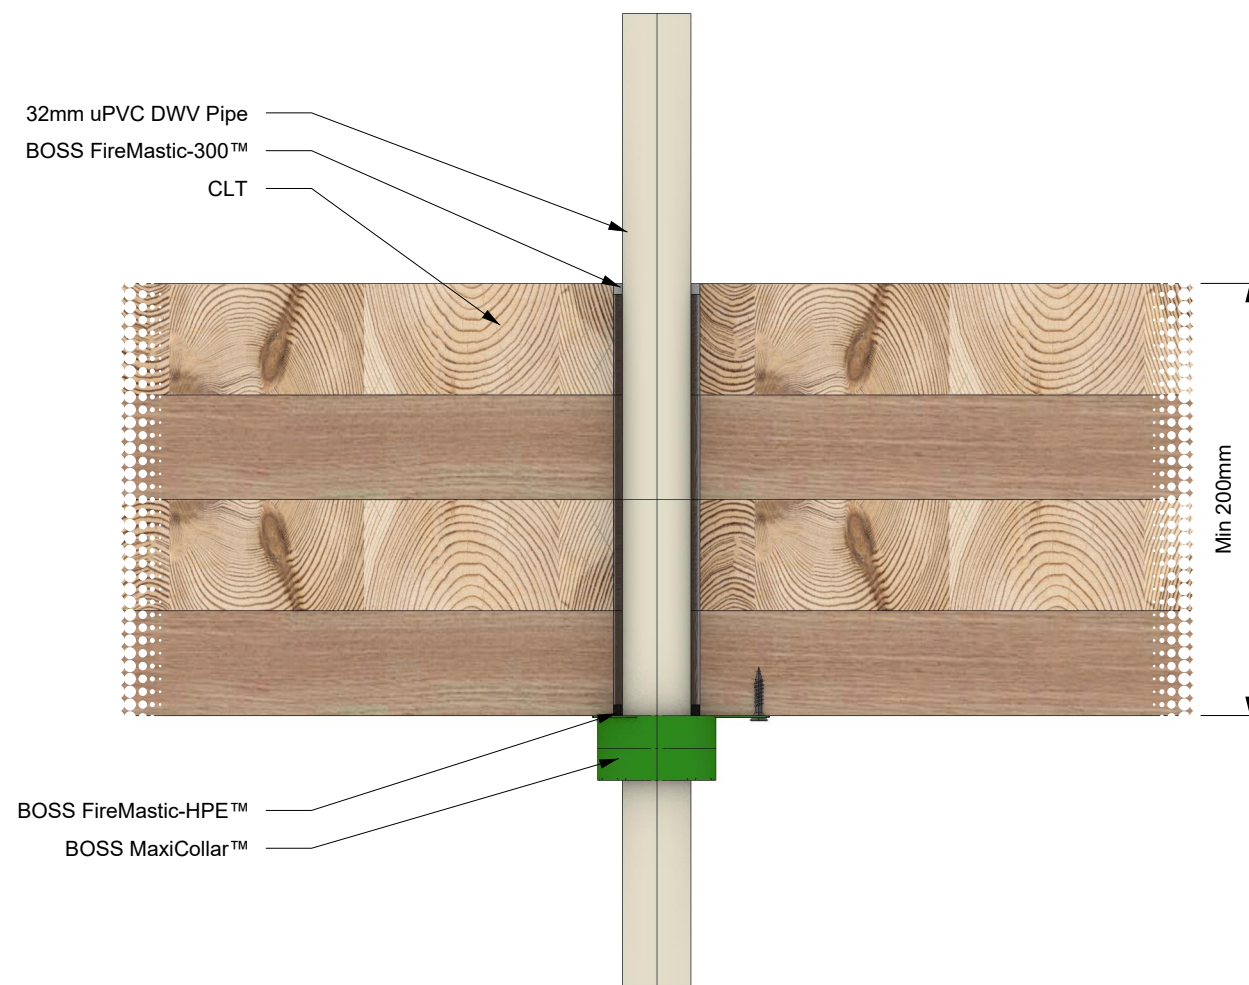

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS MaxiCollar™	-	32 mm uPVC DWV pipe. BOSS FireMastic-300™ sealant 5.0 mm deep in annular gap on the top side. BOSS FireMastic-HPE™ sealant 5.0 mm deep in annular gap on the underside. 40 mm BOSS MaxiCollar™ installed on the underside.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS FireMastic-HPE™	-		Report Reference:		147942.00FTR 1024	
Substrate:	CLT (Horiz)	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3212.33	
Min Substrate Thickness (mm):	200	40	-		Date:	25/07/25	Rev:	01
Sealant Depth (mm):	5	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.