
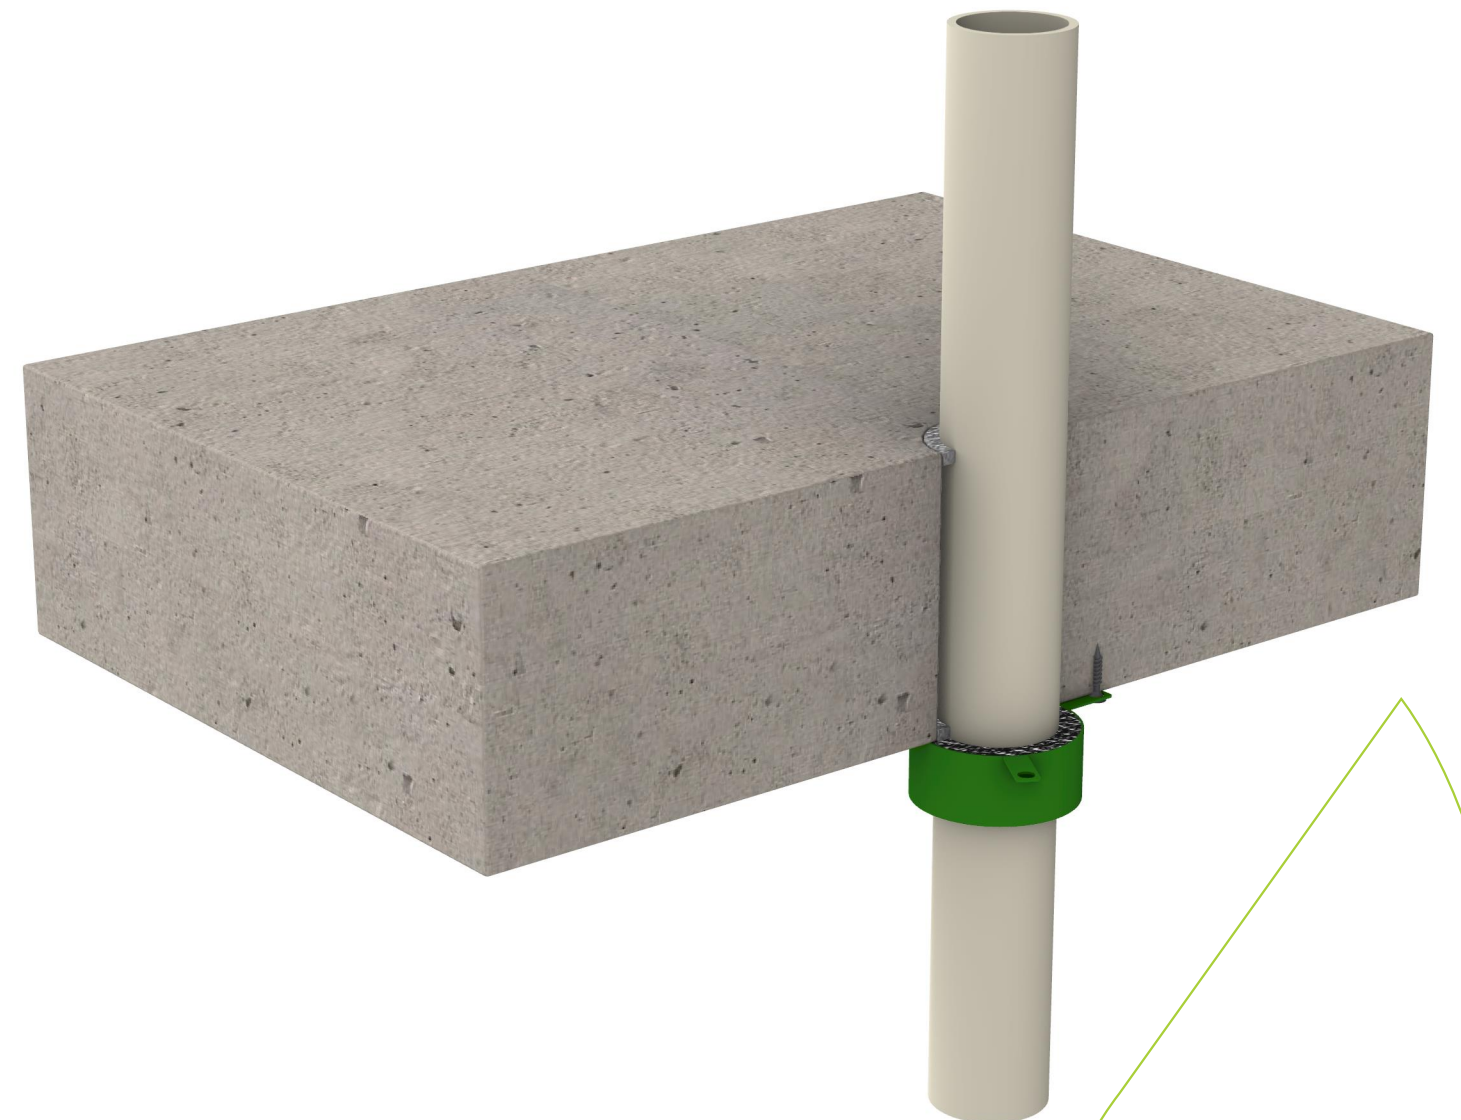


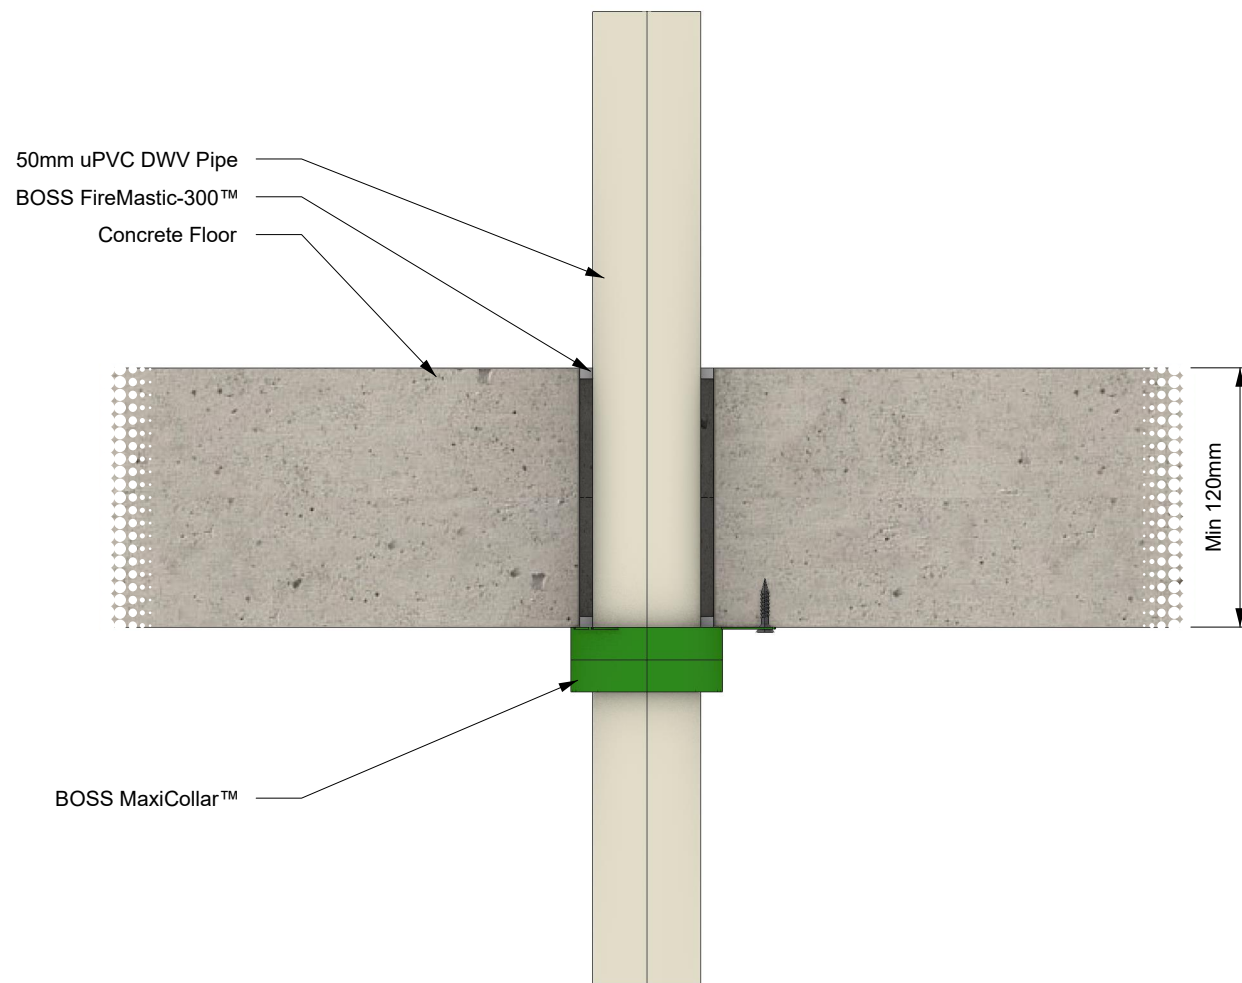

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS MaxiCollar™	-	50 mm uPVC DWV pipe. BOSS FireMastic-300™ sealant 5.0 mm deep in annular gap on both sides. 50 mm BOSS MaxiCollar™ installed on the under-side.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	-	-		Report Reference:		148693.00 FTR V2.3	
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3236.25	
Min Substrate Thickness (mm):	120	62	-		Date:	25/07/25	Rev:	01
Sealant Depth (mm):	5	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/240/180							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.