


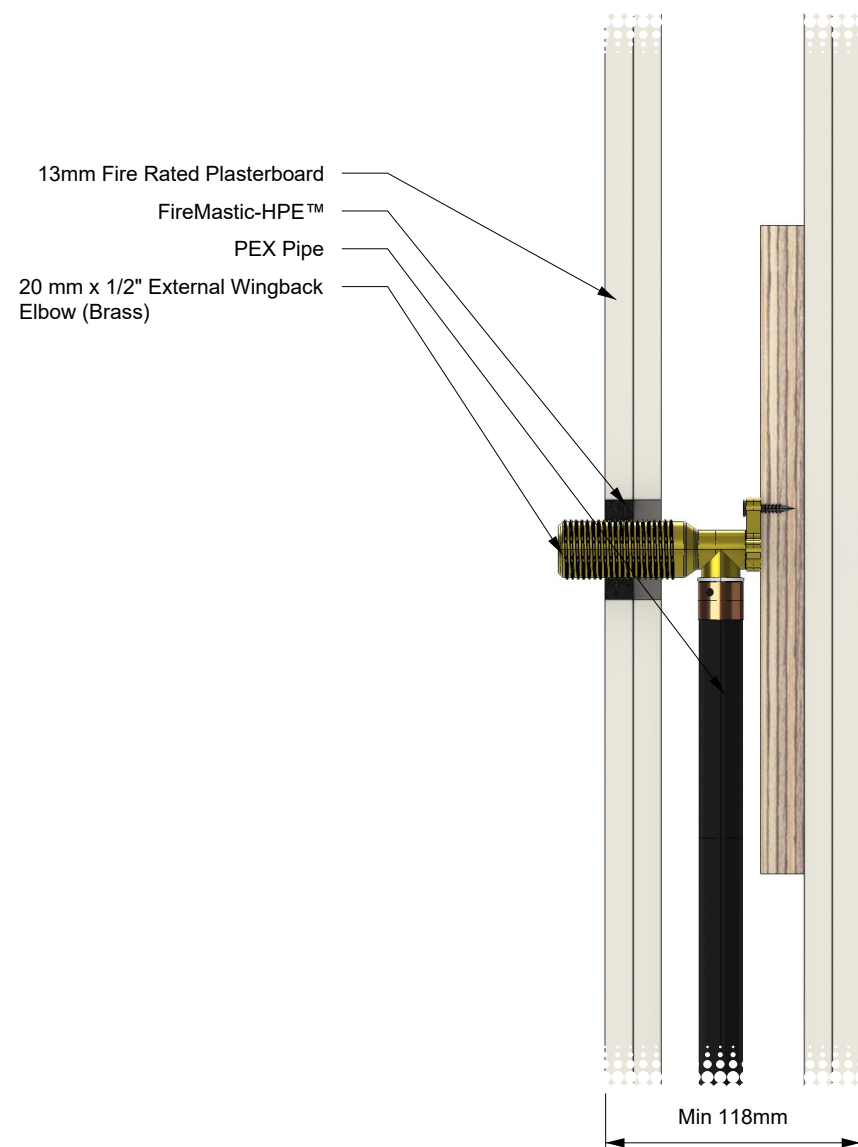

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	1 - sided penetration. 20 mm x 1/2" External Wingback Elbow (Brass) penetrating the wall from either direction. Wingback fixed to a 300 mm wide x 200 mm high x 20 mm thick plywood backing. BOSS FireMastic-HPE™ sealant 13 mm deep in the annular gap finished flush.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		FTSL-PF25011-R2	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3247.2	
Min Substrate Thickness (mm):	118	45.2	11.1 - 13.1		Date:		21/07/25	Rev:
Sealant Depth (mm):	13	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							