


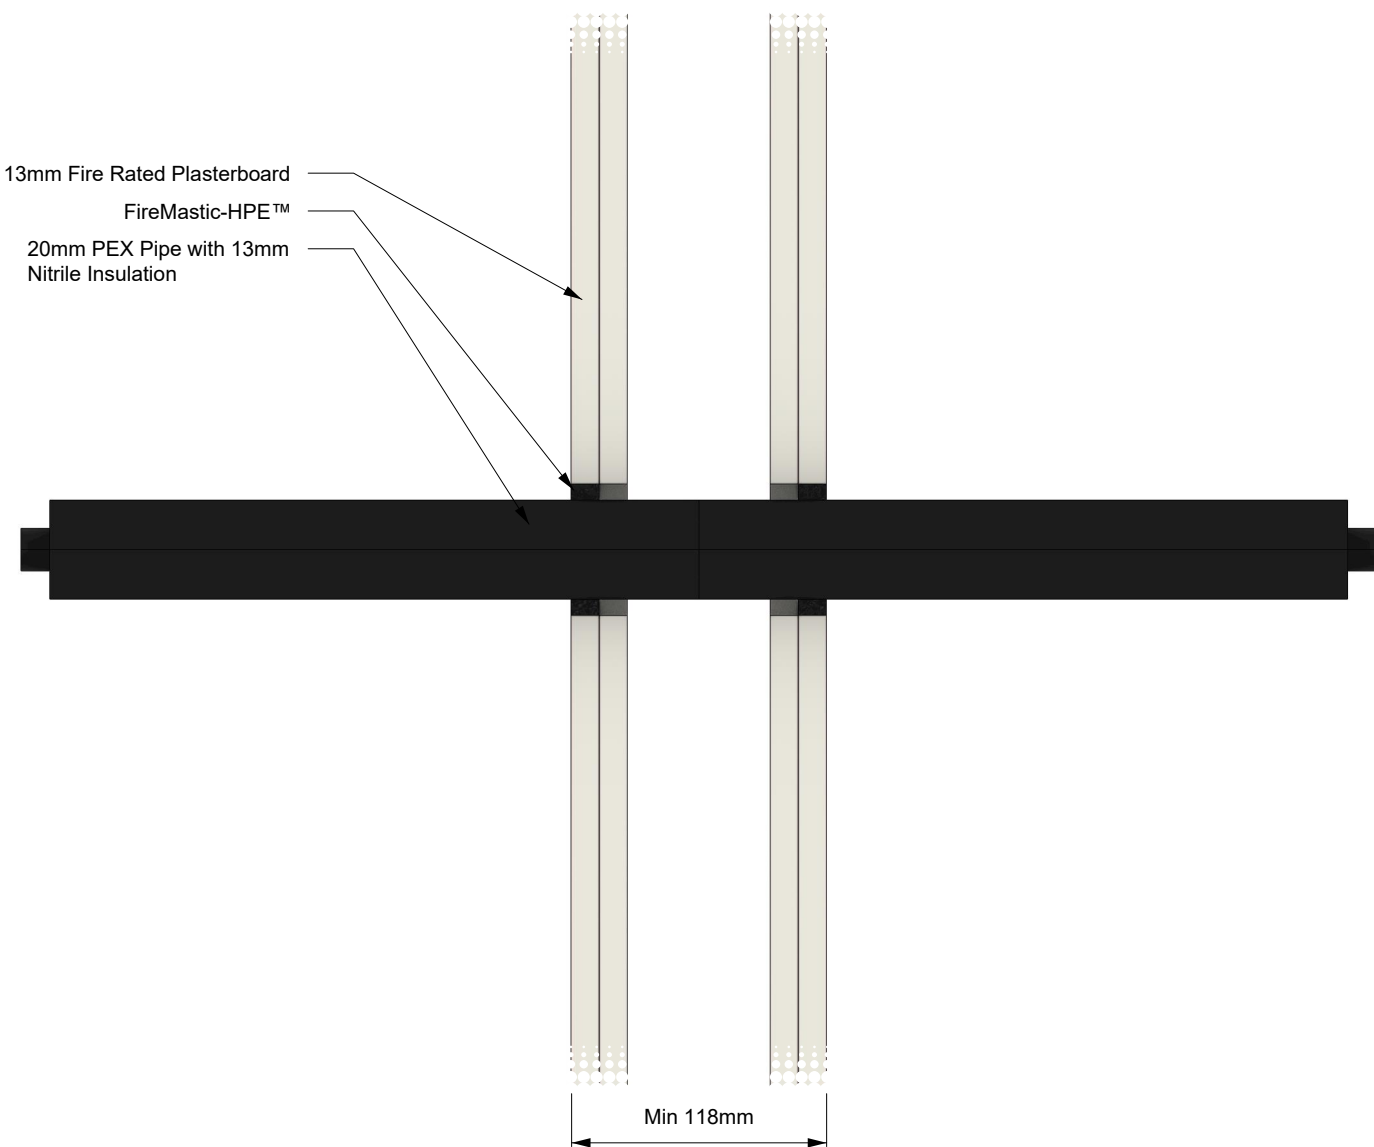

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	20 mm PEX pipe with 3.05 mm wall thickness, insulated with 13 mm thick nitrile insulation. BOSS FireMastic-HPE™ sealant 13 mm deep in annular gap finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PEX	-	-		Report Reference:		FTSL-PF25012-R2	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3256.2	
Min Substrate Thickness (mm):	118	60.5	5.7 - 8.3		Date:	21/07/25	Rev:	01
Sealant Depth (mm):	13	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							