
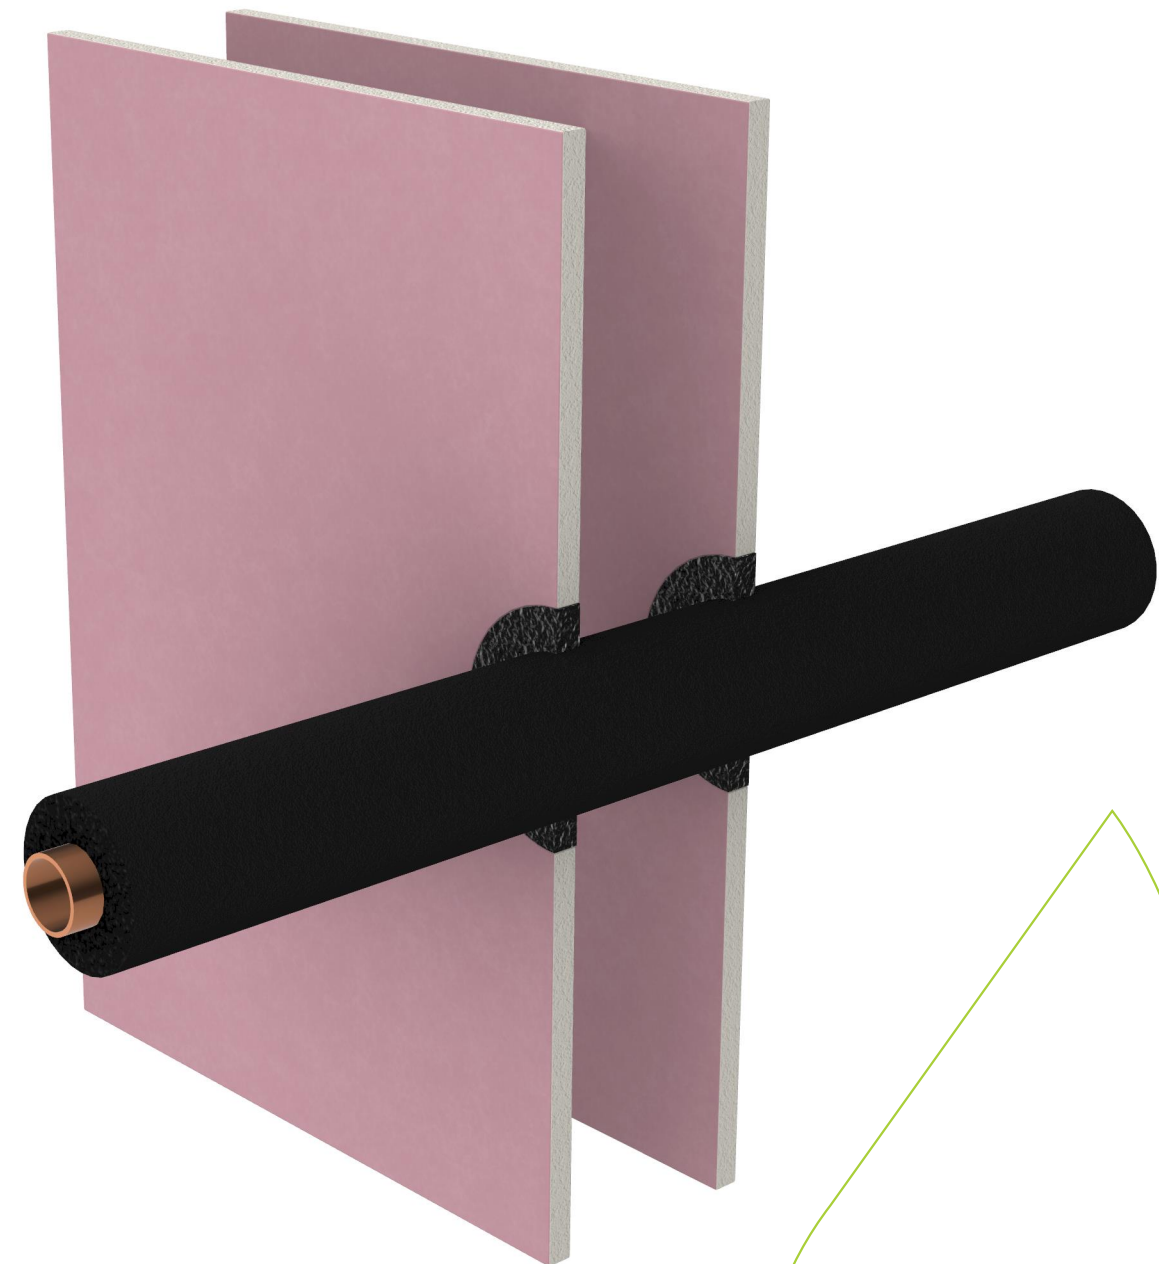


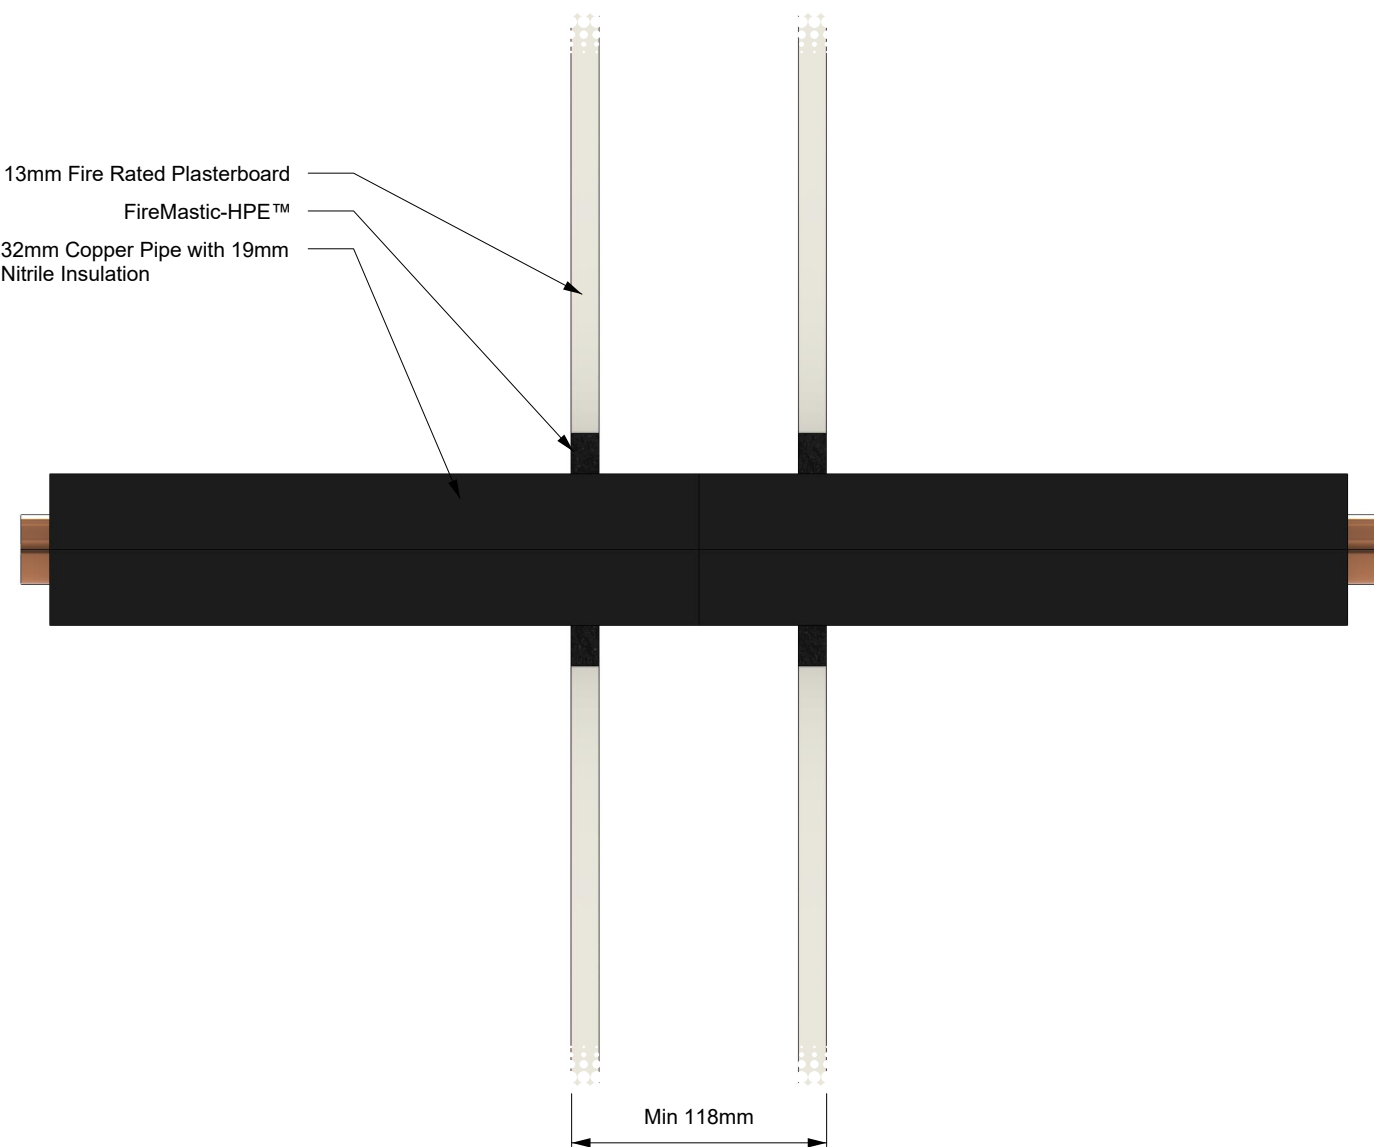

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Wall	BOSS FireMastic-HPE™	-	32 mm copper pipe with 1.65 mm wall thickness, insulated with 19 mm thick nitrile insulation. BOSS FireMastic-HPE™ sealant 13 mm deep in annular gap finished flush both sides.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005		
Service:	Insulated Copper Pipes	-	-		Report Reference:		FTSL-PF25014-R2		
Substrate:	Single Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3278.1		
Min Substrate Thickness (mm):	118	107.5	16.8 - 18.5		Date:	21/07/25	Rev:	01	
Sealant Depth (mm):	13	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	-	-							
Wrap Length (mm):	-								
FRL / FRR:	-/60/60								

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.