
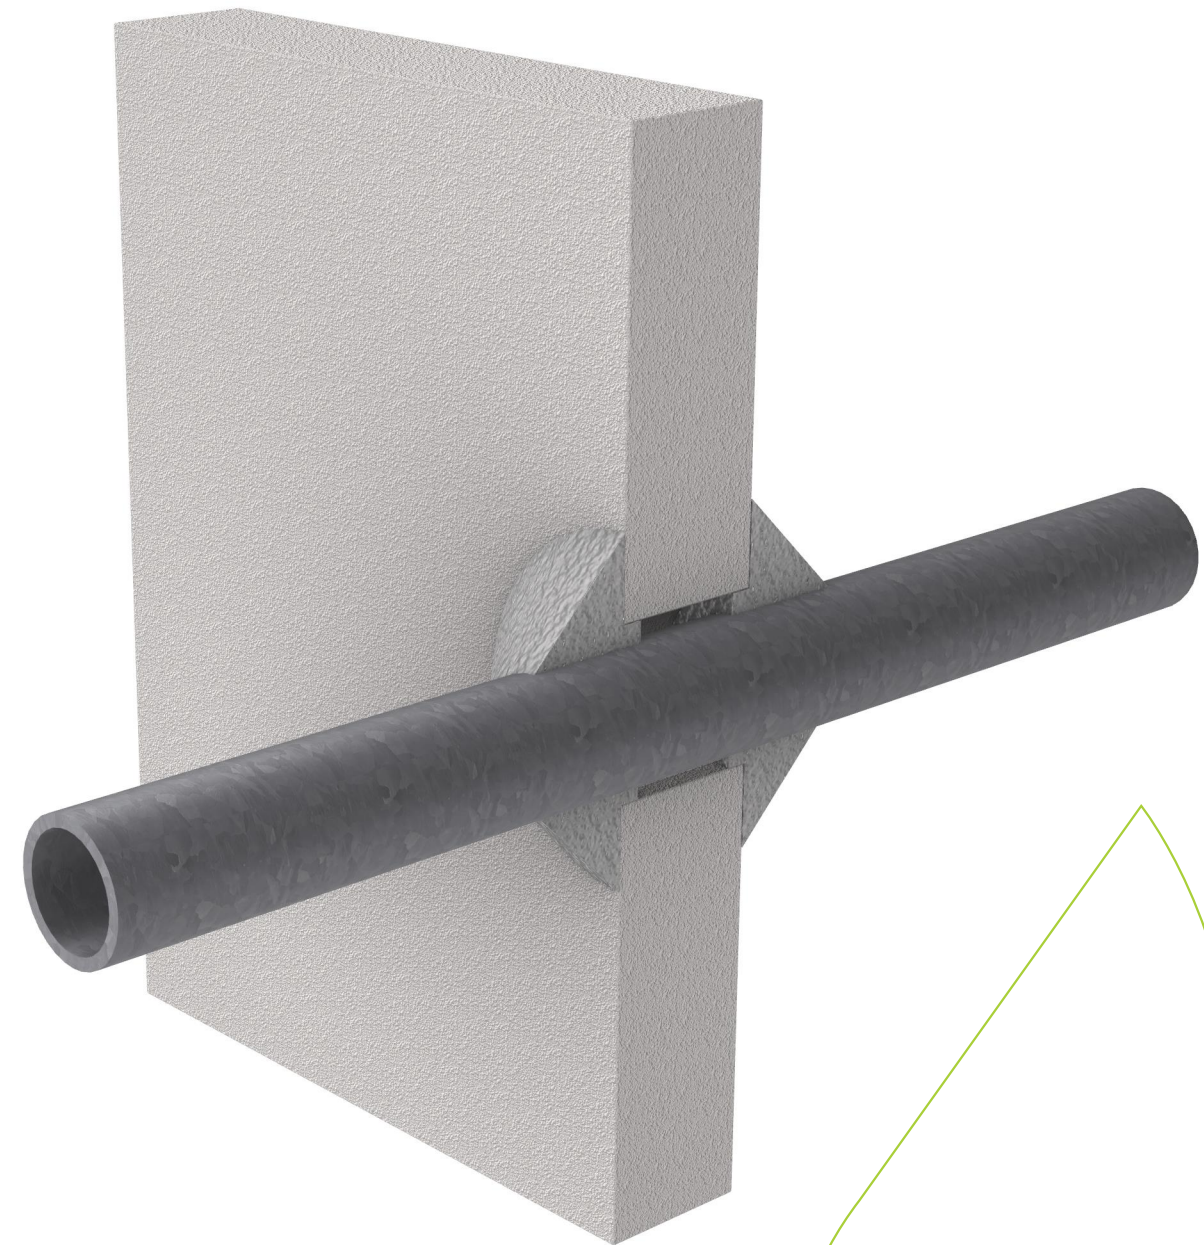


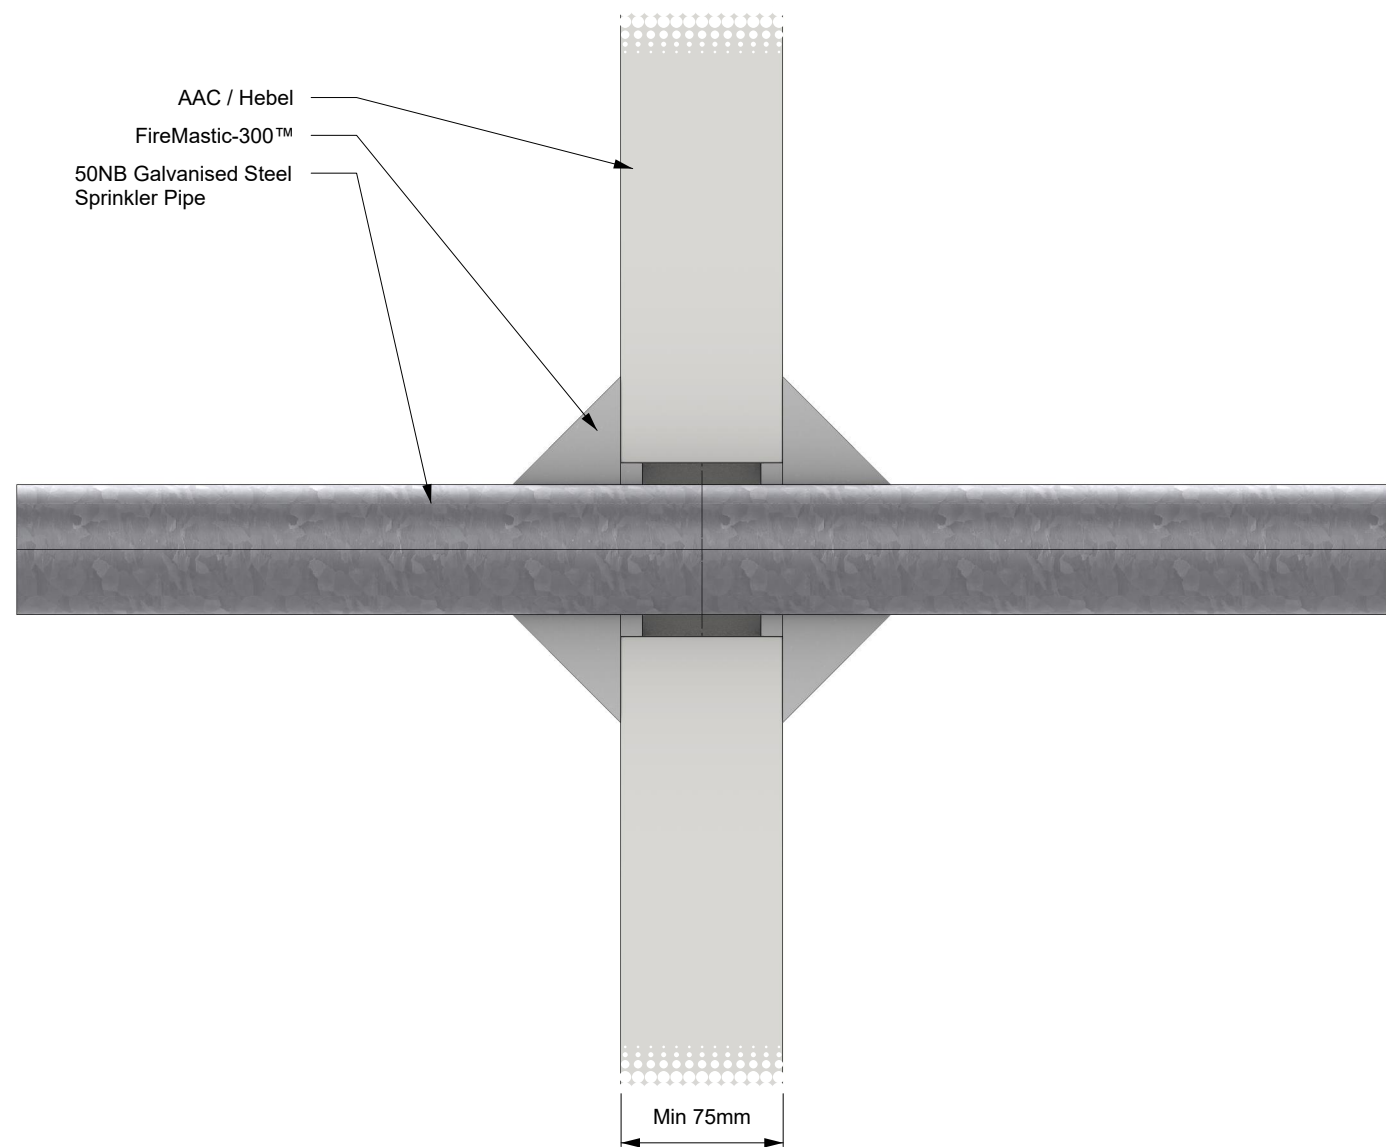

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-300™	-	50NB Galvanised steel sprinkler pipe with 3.7 mm wall thickness. BOSS FireMastic-300™ sealant 10 mm deep in annular gap with 50 mm x 50 mm fillet of sealant applied both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Sprinkler pipe	-	-		Report Reference:		FRT180473 R1.0	
Substrate:	AAC / Hebel	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3287.7	
Min Substrate Thickness (mm):	75	80	10		Date:		05/08/25	Rev:
Sealant Depth (mm):	10	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	50							
Wrap Length (mm):	-							
FRL / FRR:	-/120/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.