BOSS BF-3291-27

AU: 1300 502 677 | NZ: 0800 502 677 www.bossfire.com

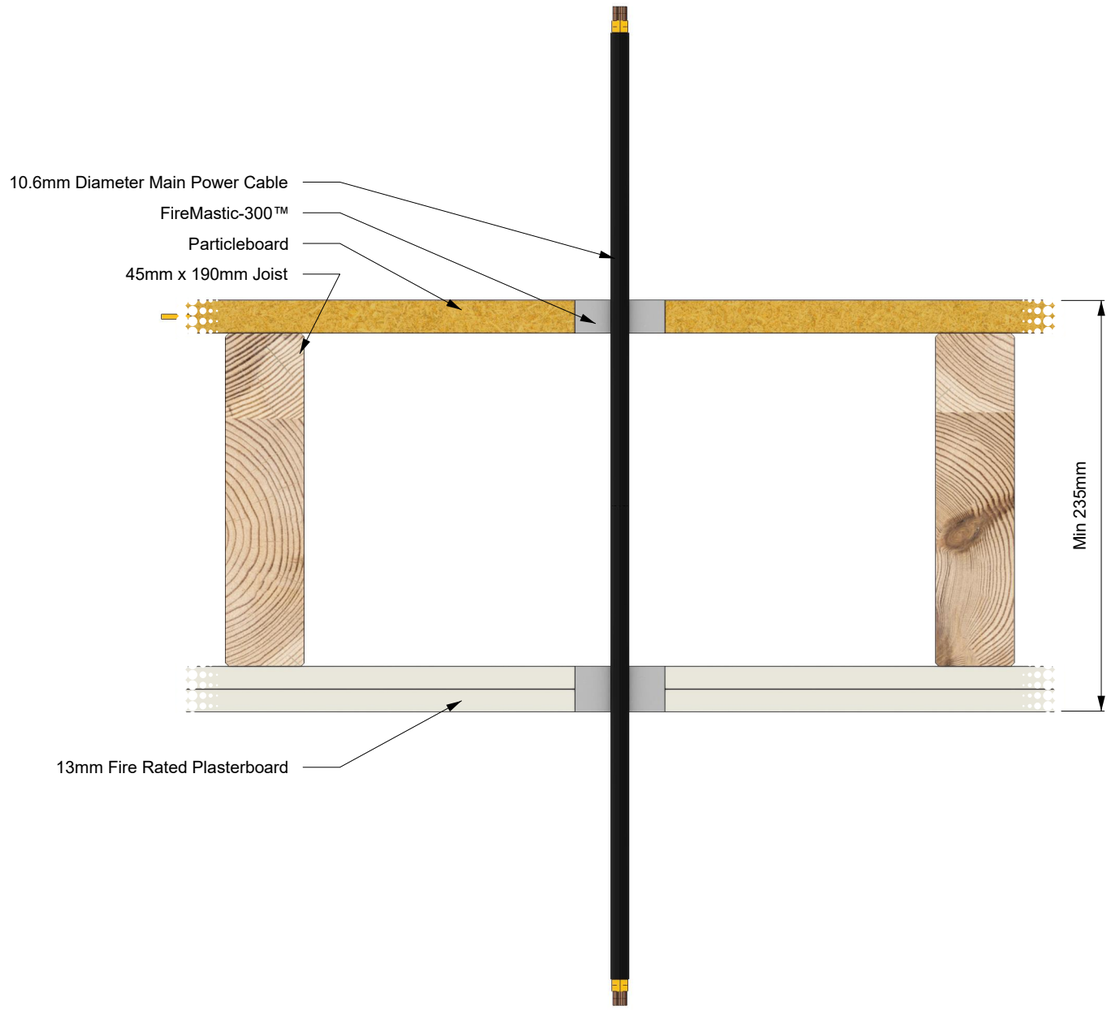

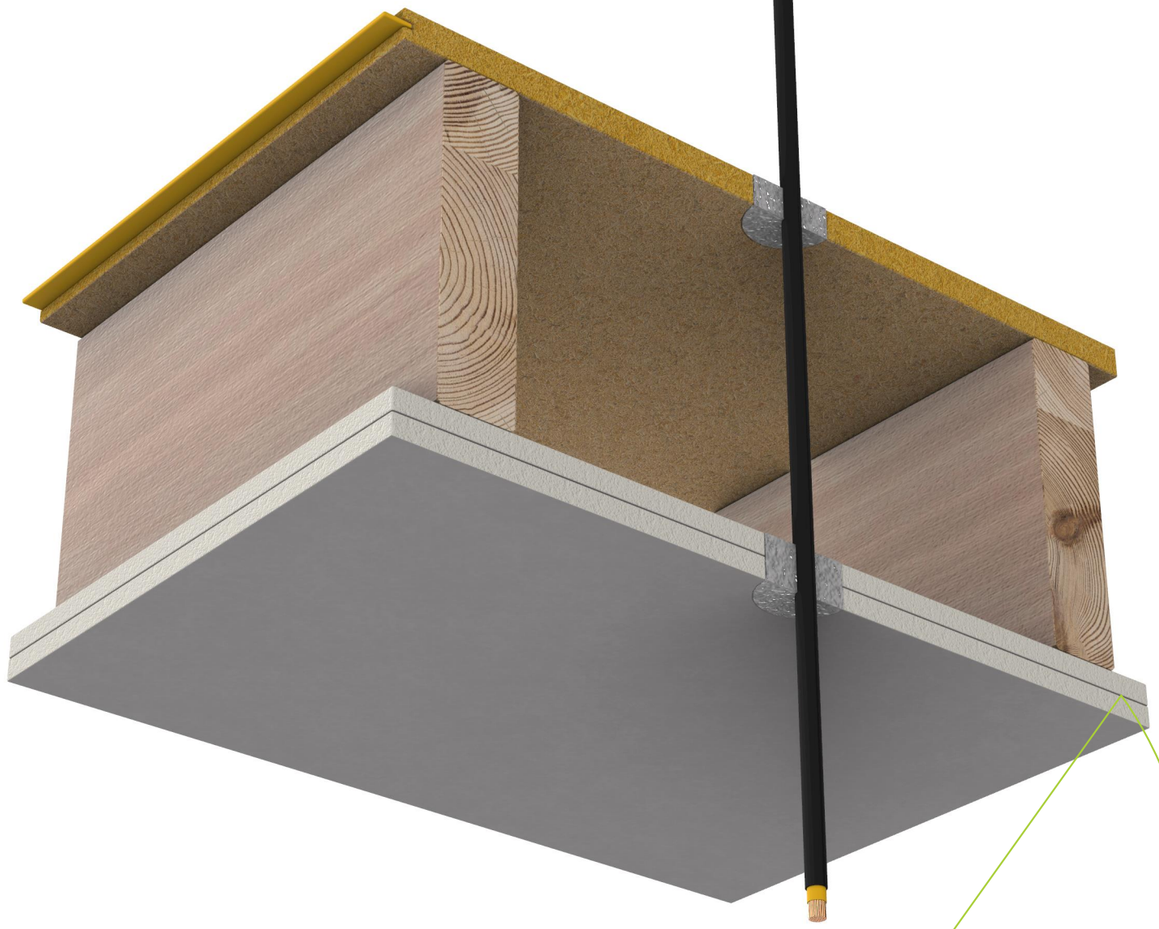

SYSTEM DESCRIPTION	
Orientation:	Ceiling
Trade / Type:	Electrical
Service:	Multi Core / Orange Circular / Mains
Substrate:	Plasterboard ceiling systems
Min Substrate Thickness (mm):	235
Sealant Depth (mm):	Top 19
Sealant Fillet (mm):	-
Wrap Length (mm):	-
FRL / FRR:	-/90/90 - RISF 54 min

FIRE STOPPING INFORMATION	
BOSS FireMastic-300™	-
-	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
51	-
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

10.6 mm diameter Main power cable. BOSS FireMastic-HPE™ sealant 26 mm deep in annular gap of plasterboard finished flush on the underside. BOSS FireMastic-300™ sealant 19 mm deep in annular gap of particle board flooring on the top side, finished flush.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	FRT180474 R3.0		
Drawing Number:	BF-3291.27		
Date:	05/08/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.