
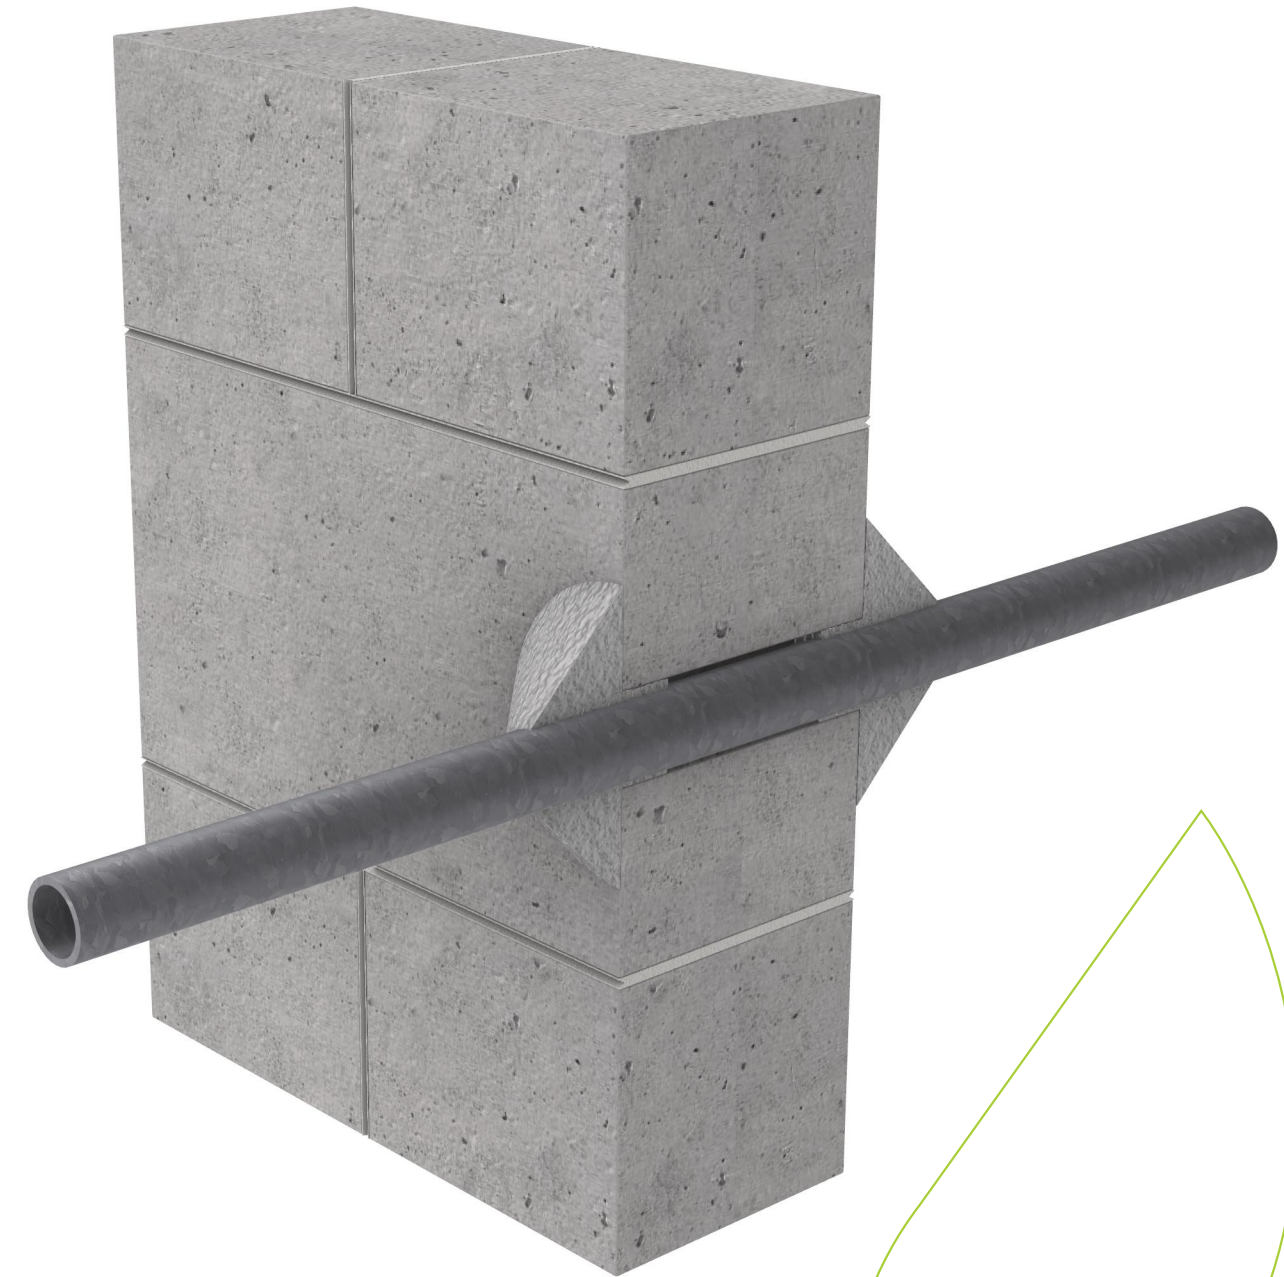


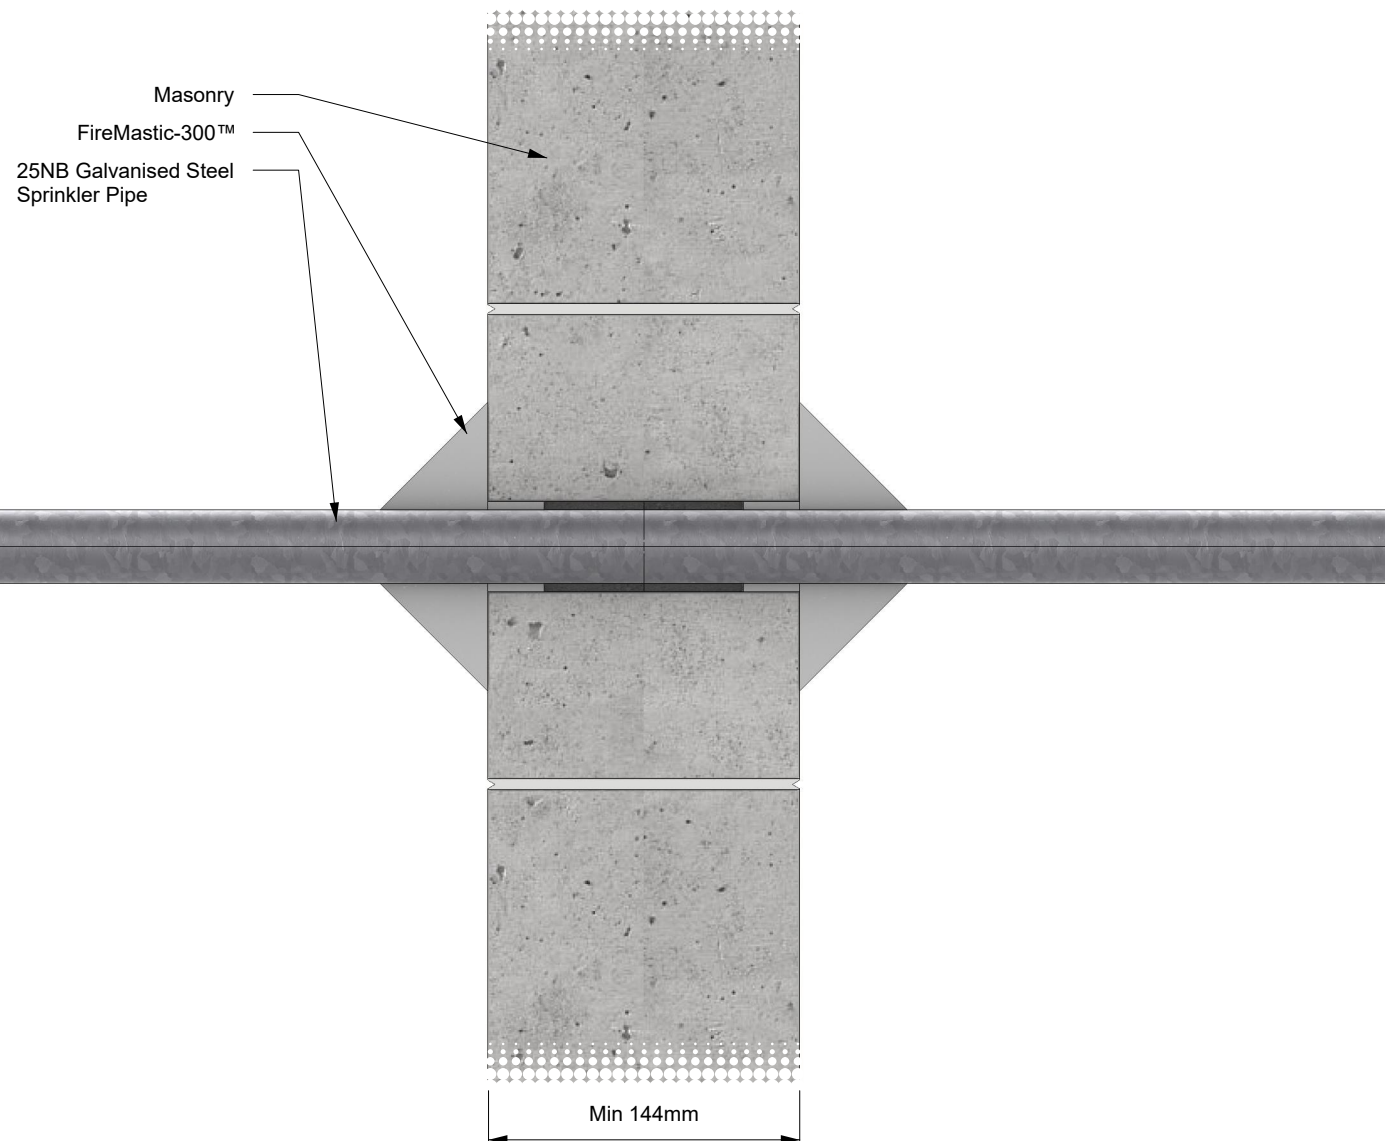

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-300™	-	34 mm diameter (25NB) galvanised steel sprinkler pipe with 3.5 mm wall thickness. BOSS FireMastic-300™ sealant 26 mm deep in the annular gap with 50 mm x 50 mm fillet of sealant applied both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Sprinkler pipe	-	-		Report Reference:		FRT180474 R3.0	
Substrate:	Masonry	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3298.5	
Min Substrate Thickness (mm):	144	42	4		Date:	05/08/25	Rev:	01
Sealant Depth (mm):	26	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	50	-						
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.