
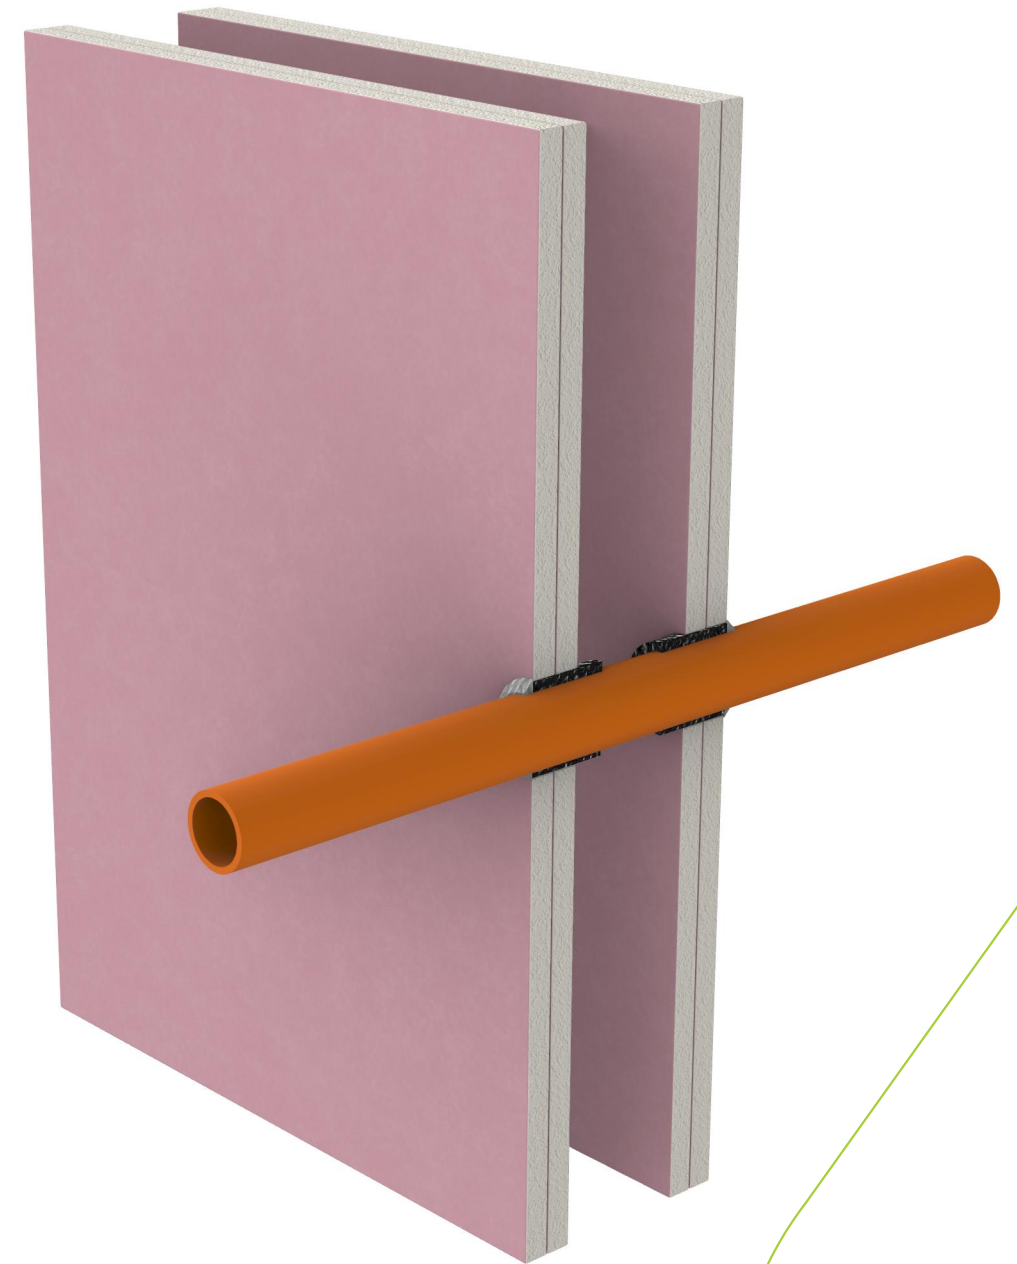


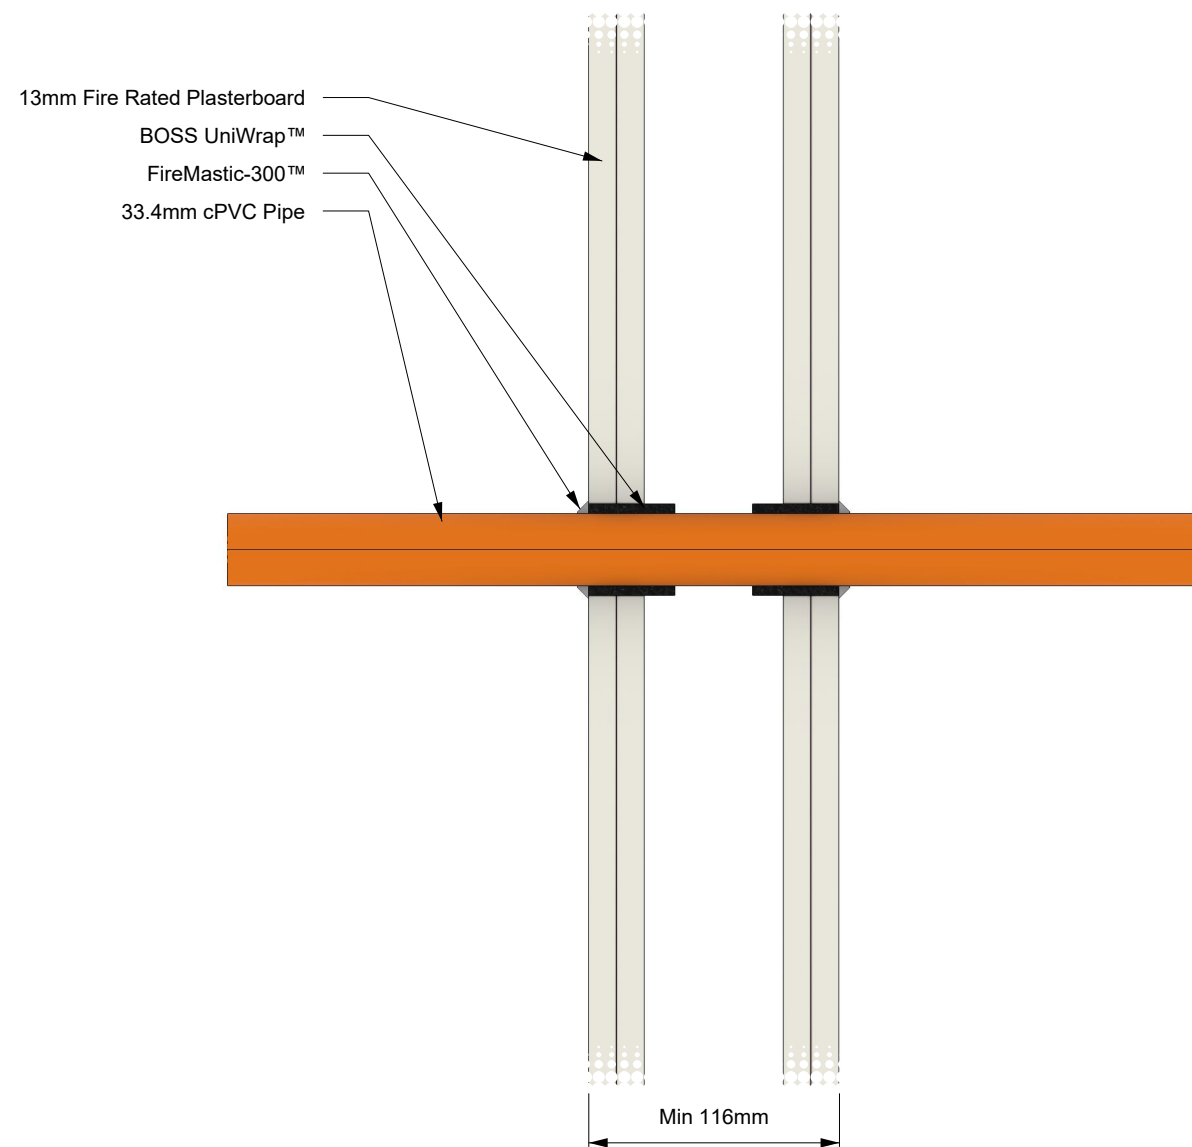

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS UniWrap™	-	33.4 mm cPVC pipe with 2.6 mm wall thickness. 2 layers of BOSS UniWrap™ flush with the face of the separating element on both sides. BOSS FireMastic-300™ sealant applied to the resulting gap with a 5 mm x 5 mm fillet on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	CPVC	-	-		Report Reference:		FSP 1846 Rev B	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3307.2	
Min Substrate Thickness (mm):	116	58	-		Date:	05/08/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	5							
Wrap Length (mm):	-							
FRL / FRR:	-/120/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.