


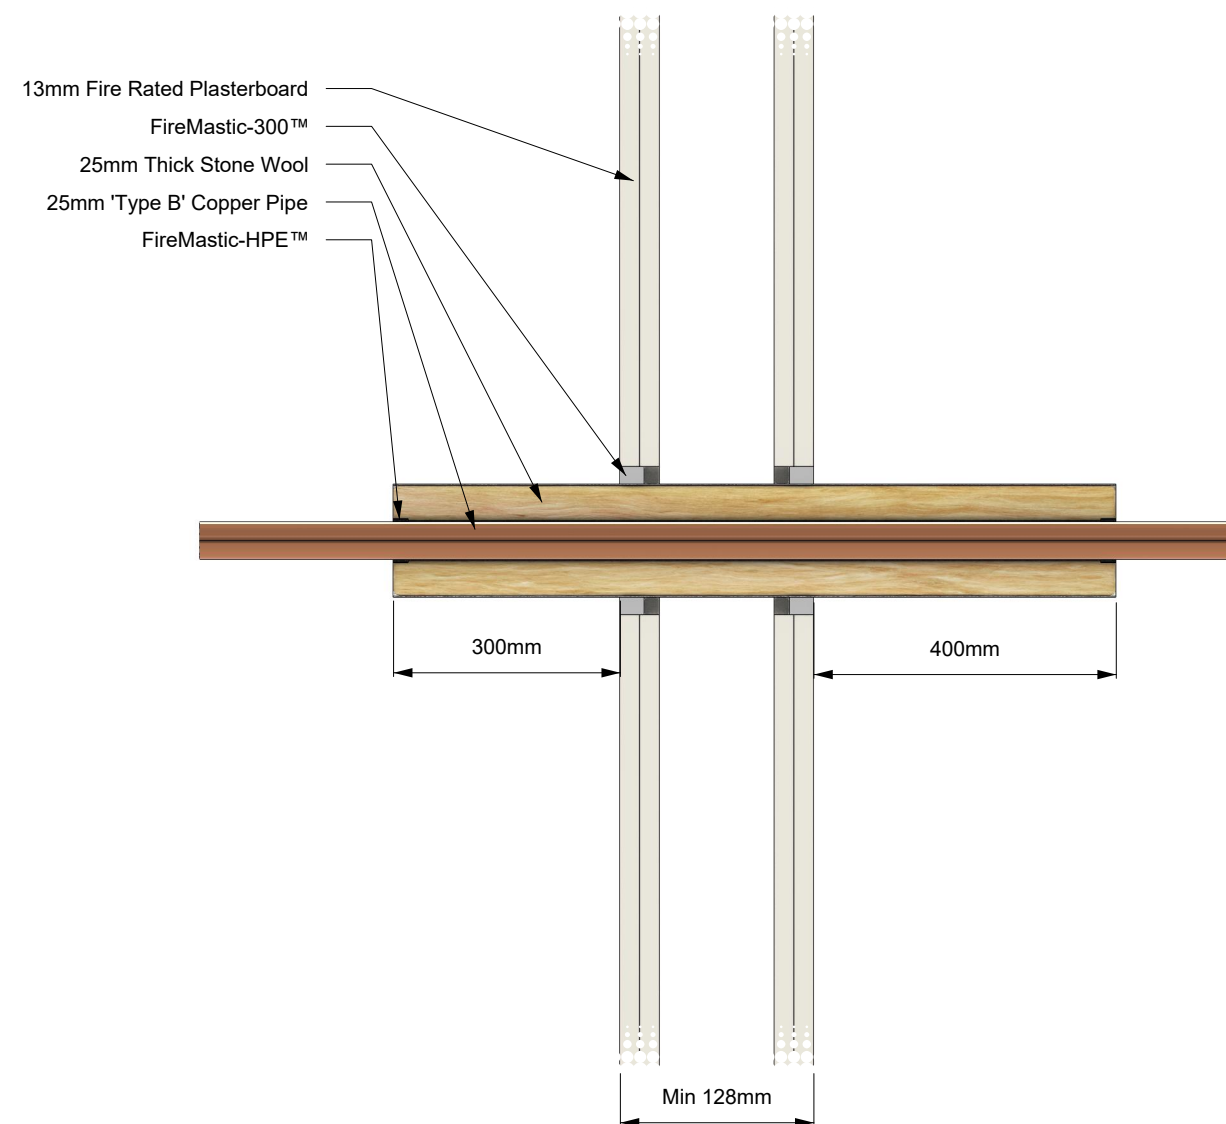

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-300™	-	25 mm x 1.22 mm 'Type B' copper pipe, with 25 mm thick stone wool insulation. BOSS FireMastic-300™ sealant 16 mm deep in annular gap both sides. BOSS FireMastic-HPE™ sealant applied 10 mm deep where the insulation finishes at its junction with the pipe on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-HPE™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Insulated Copper Pipes	-	-		Report Reference:		FP10422-001 Issue 2	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3319.2	
Min Substrate Thickness (mm):	128	98	-		Date:	05/08/25	Rev:	01
Sealant Depth (mm):	16	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	Exposed 300, Unexposed 400							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.