
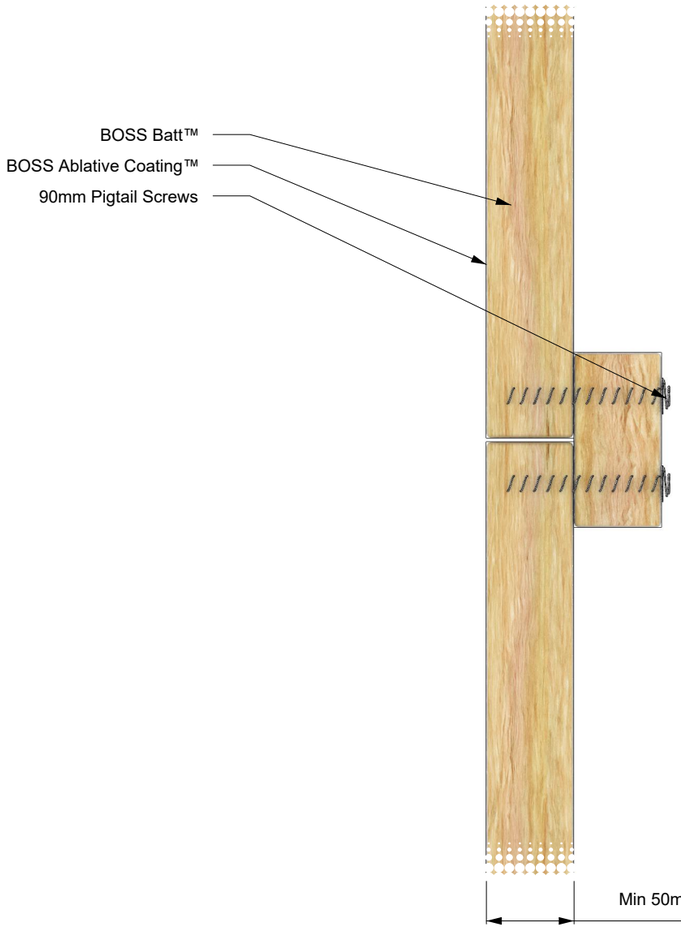


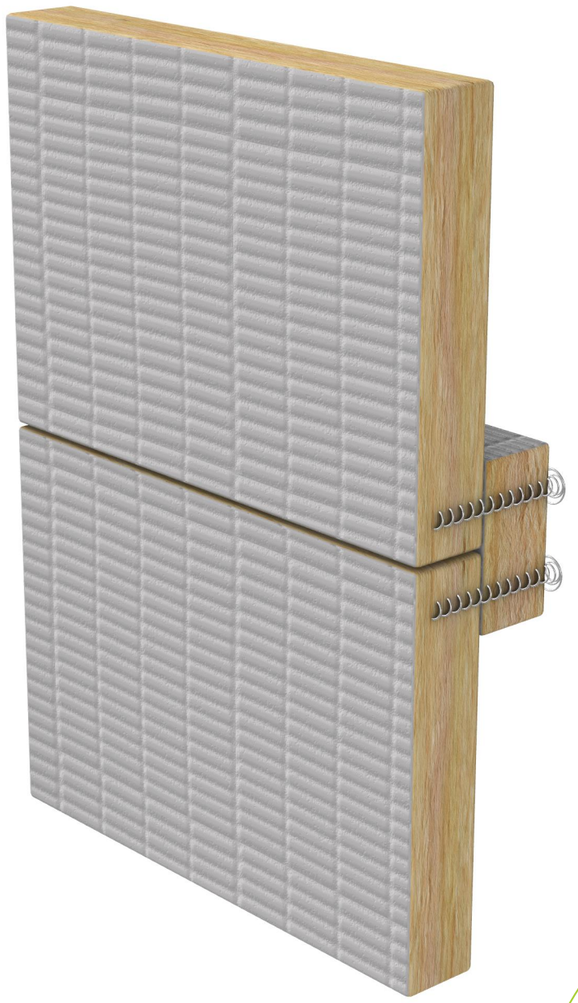

SYSTEM DESCRIPTION	
Orientation:	Wall
Trade / Type:	Construction (Linear Gaps / Blank Seals)
Service:	-
Substrate:	Single layer BOSS Batt
Min Substrate Thickness (mm):	50
Sealant Depth (mm):	-
Sealant Fillet (mm):	-
Wrap Length (mm):	-
FRL / FRR:	-/120/120

FIRE STOPPING INFORMATION	
BOSS Batt™	-
BOSS Ablative Coating™	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
-	-
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

Control joint. 1 strip of 100 mm wide BOSS Batt™ installed over a joint in the main BOSS Batt™ substrate on the unexposed side. Cut edges to be coated with layer of BOSS Ablative Coating™. The batt strips were fixed to the separating element with 90 mm pigtail screws, approximately 25 mm from the top and bottom edge of the batt strip, at 300 mm centres.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	148412.00 FTRR V2.0		
Drawing Number:	BF-3342.23		
Date:	07/08/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.