
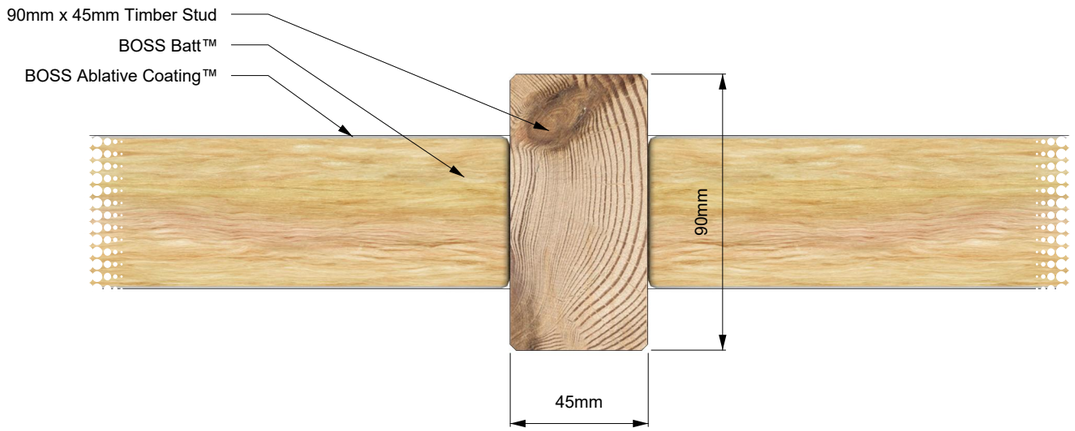


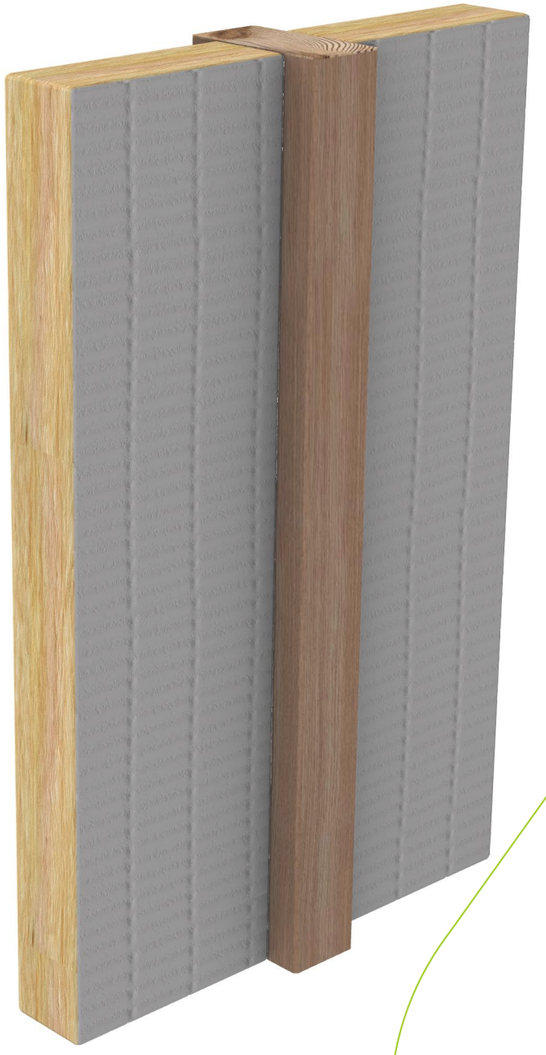

SYSTEM DESCRIPTION	
Orientation:	Wall
Trade / Type:	Construction (Linear Gaps / Blank Seals)
Service:	-
Substrate:	Single layer BOSS Batt
Min Substrate Thickness (mm):	50
Sealant Depth (mm):	-
Sealant Fillet (mm):	-
Wrap Length (mm):	-
FRL / FRR:	-/60/60

FIRE STOPPING INFORMATION	
BOSS Batt™	-
BOSS Ablative Coating™	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
-	-
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

Vertical linear gap seal. A 90 mm x 45 mm timber stud with BOSS Batt™ butting up either side. BOSS Ablative Coating™ to all cut edges of the BOSS Batt™. BOSS Ablative Coating™ between the timber stud and the BOSS Batt™ to seal the junction on both sides.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	148597.00 FTR V3.1		
Drawing Number:	BF-3343.23		
Date:	07/08/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.