
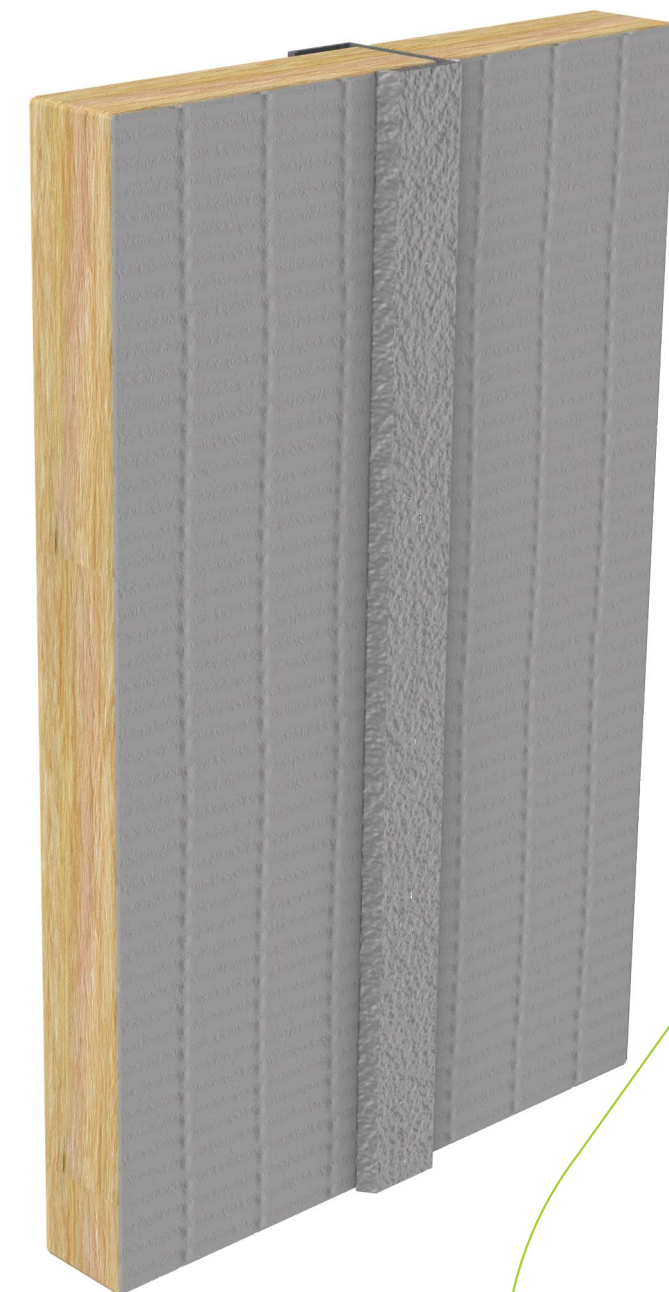


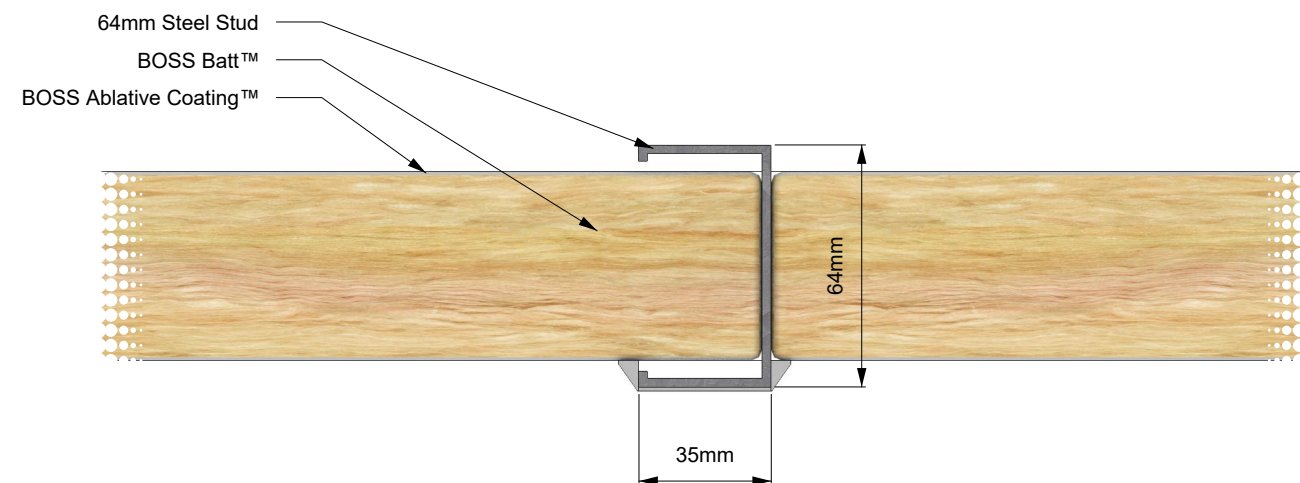

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	-	Vertical linear gap seal. A 64 mm steel stud with BOSS Batt™ butting up either side. BOSS Ablative Coating™ to all cut edges of the BOSS Batt™. BOSS Ablative Coating™ between the steel stud and the BOSS Batt™ to seal the junction on both sides. BOSS Ablative Coating™ to exposed faces of the steel stud.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Construction (Linear Gaps / Blank Seals)	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		148597.00 FTR V3.1	
Substrate:	Single layer BOSS Batt	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3344.23	
Min Substrate Thickness (mm):	50	-	-		Date:	07/08/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-	-						
Wrap Length (mm):	-							
FRL / FRR:	-/60/30							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.