


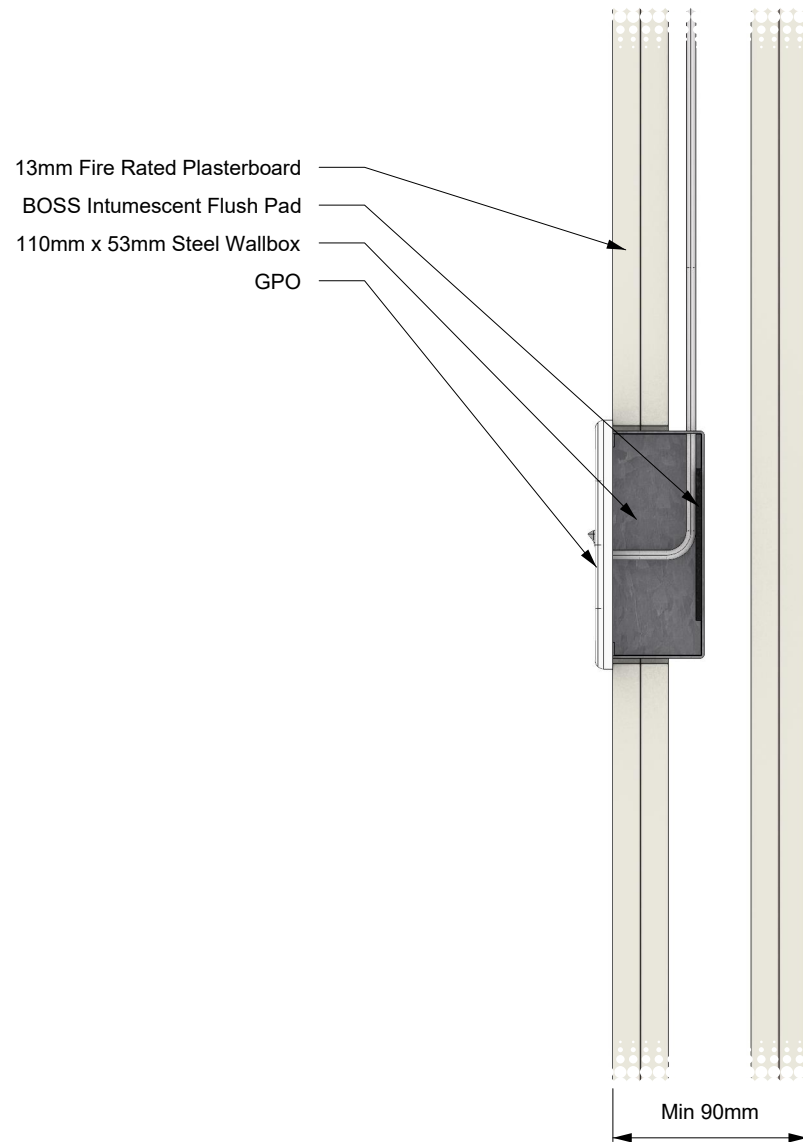

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Intumescent Flush	-	110 mm high x 53 mm wide steel wallbox with switch, installed within a 110 mm high x 53 mm aperture to the exposed side of the wall system. The wallbox incorporated 4 mm thick x 70 mm long x 40 mm wide BOSS Intumescent Flush Pad friction fitted to the back of the wallbox.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	GPO	-	-		Report Reference:		148597.00 FTR V3.1	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3346.2	
Min Substrate Thickness (mm):	90	110 x 53	-		Date:	07/08/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/45							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.