


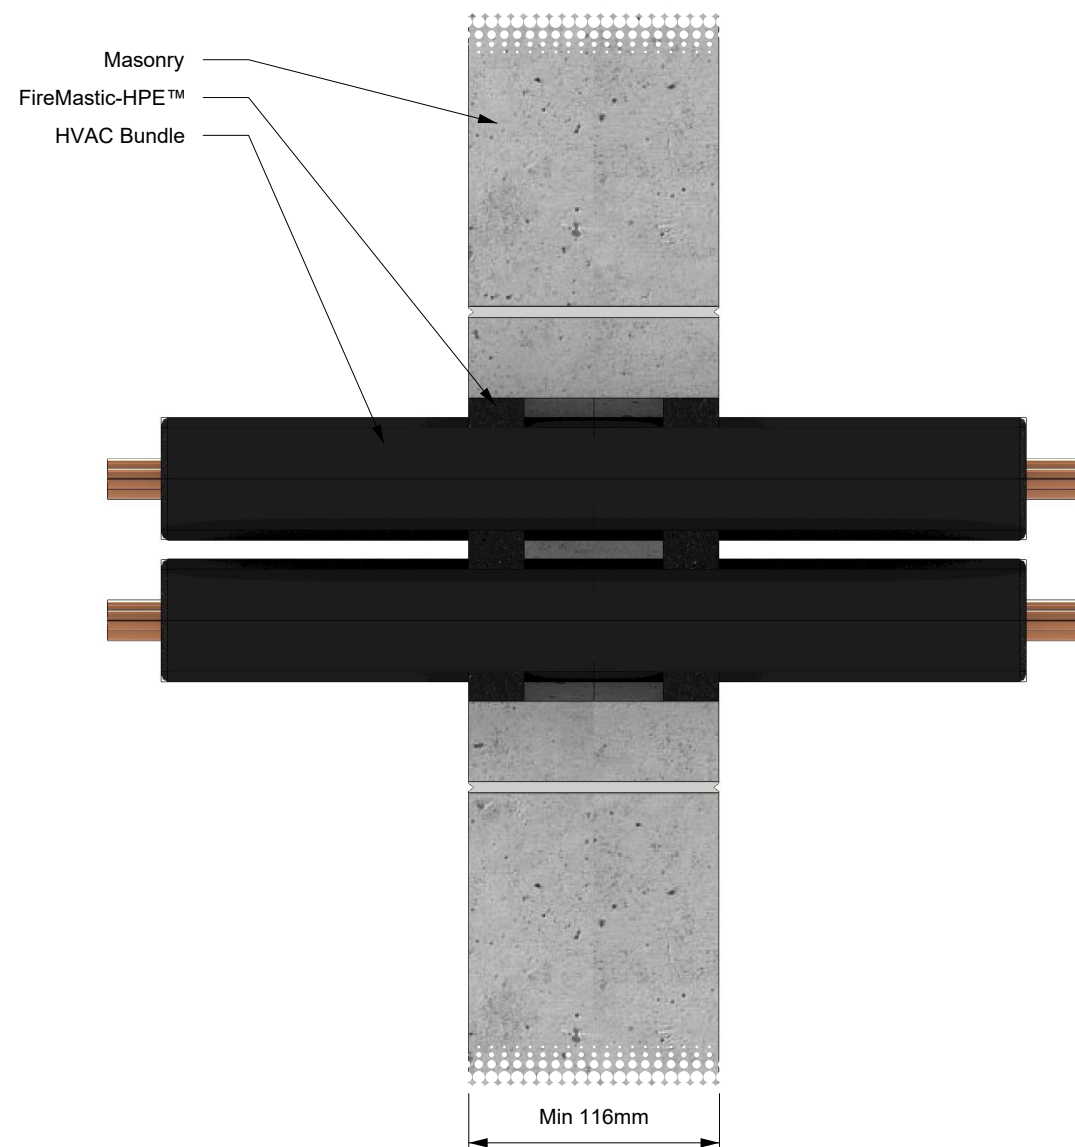

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	HVAC Bundle: • 2 sets of 19.05 mm + 9.52 mm copper pipes with 19 mm thick nitrile rubber insulation penetrating a 140 mm aperture. BOSS FireMastic-HPE™ sealant 26 mm deep in annular gap finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	HVAC	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		148815.00 FTR V2.0	
Substrate:	Masonry	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3352.5	
Min Substrate Thickness (mm):	116	140	-		Date:	07/08/25	Rev:	01
Sealant Depth (mm):	26	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.