


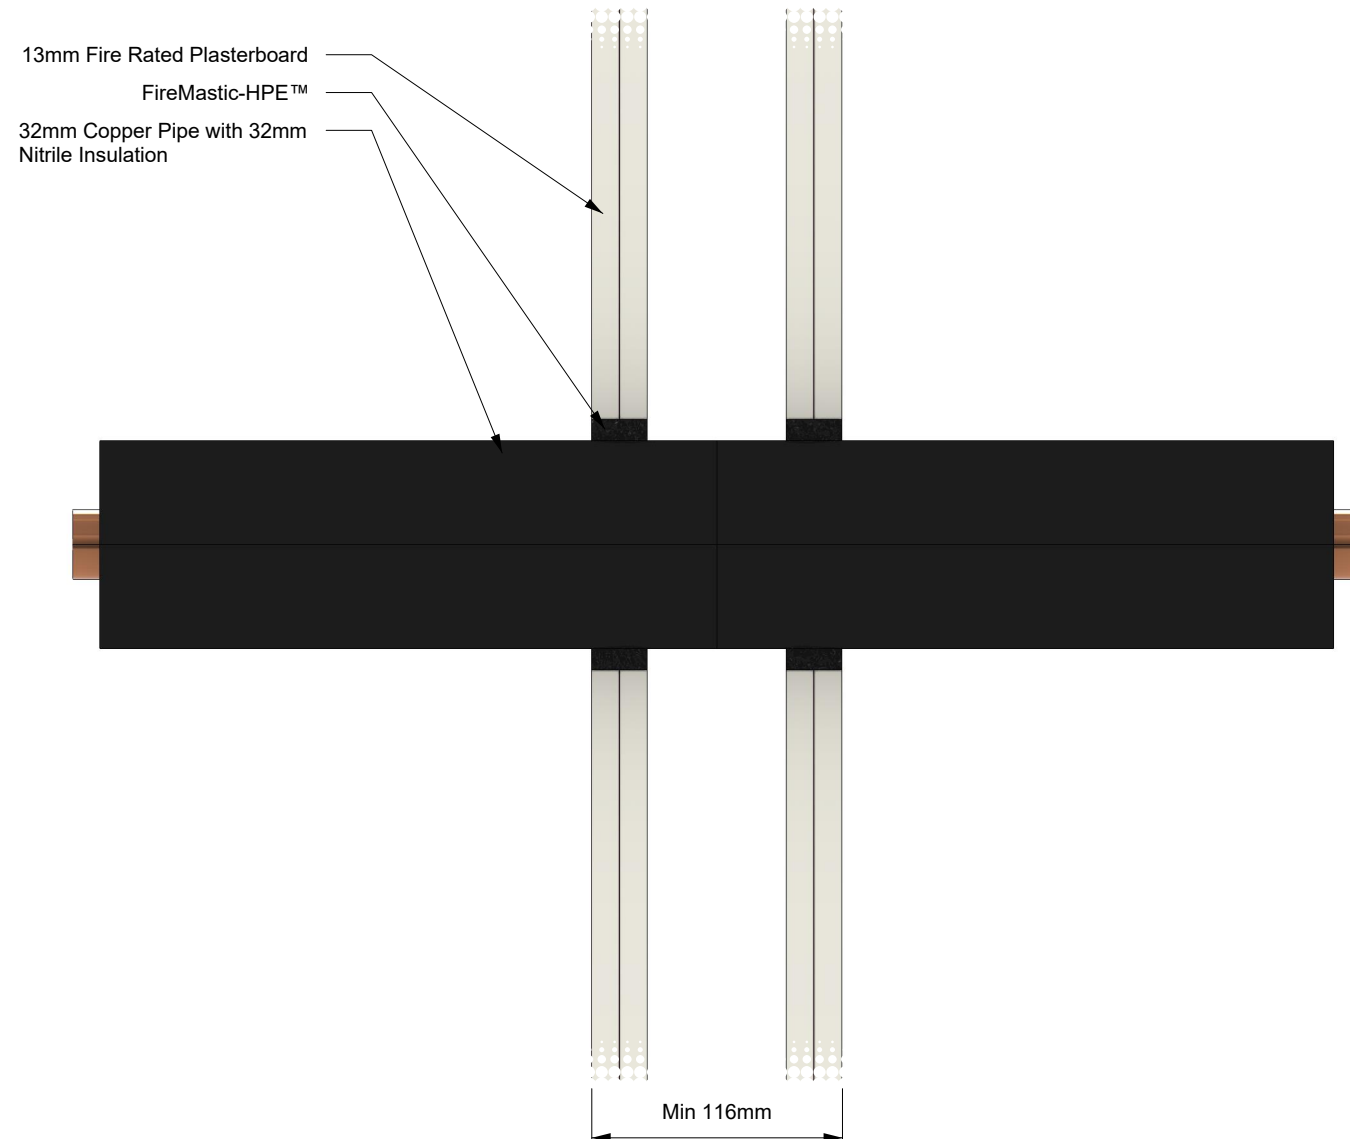

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Wall	BOSS FireMastic-HPE™	-		32 mm copper pipe with 32 mm thick nitrile rubber insulation penetrating a 116 mm aperture. BOSS FireMastic-HPE™ sealant 26 mm deep in annular gap finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-			Supplementary Standard:		AS 4072.1-2005	
Service:	Insulated Copper Pipes	-	-			Report Reference:		148816.00 FTR V2.0	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3362.2		
Min Substrate Thickness (mm):	116	116	-		Date:	07/08/25	Rev:	01	
Sealant Depth (mm):	26	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	-								
Wrap Length (mm):	-								
FRL / FRR:	-/120/120								

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.