
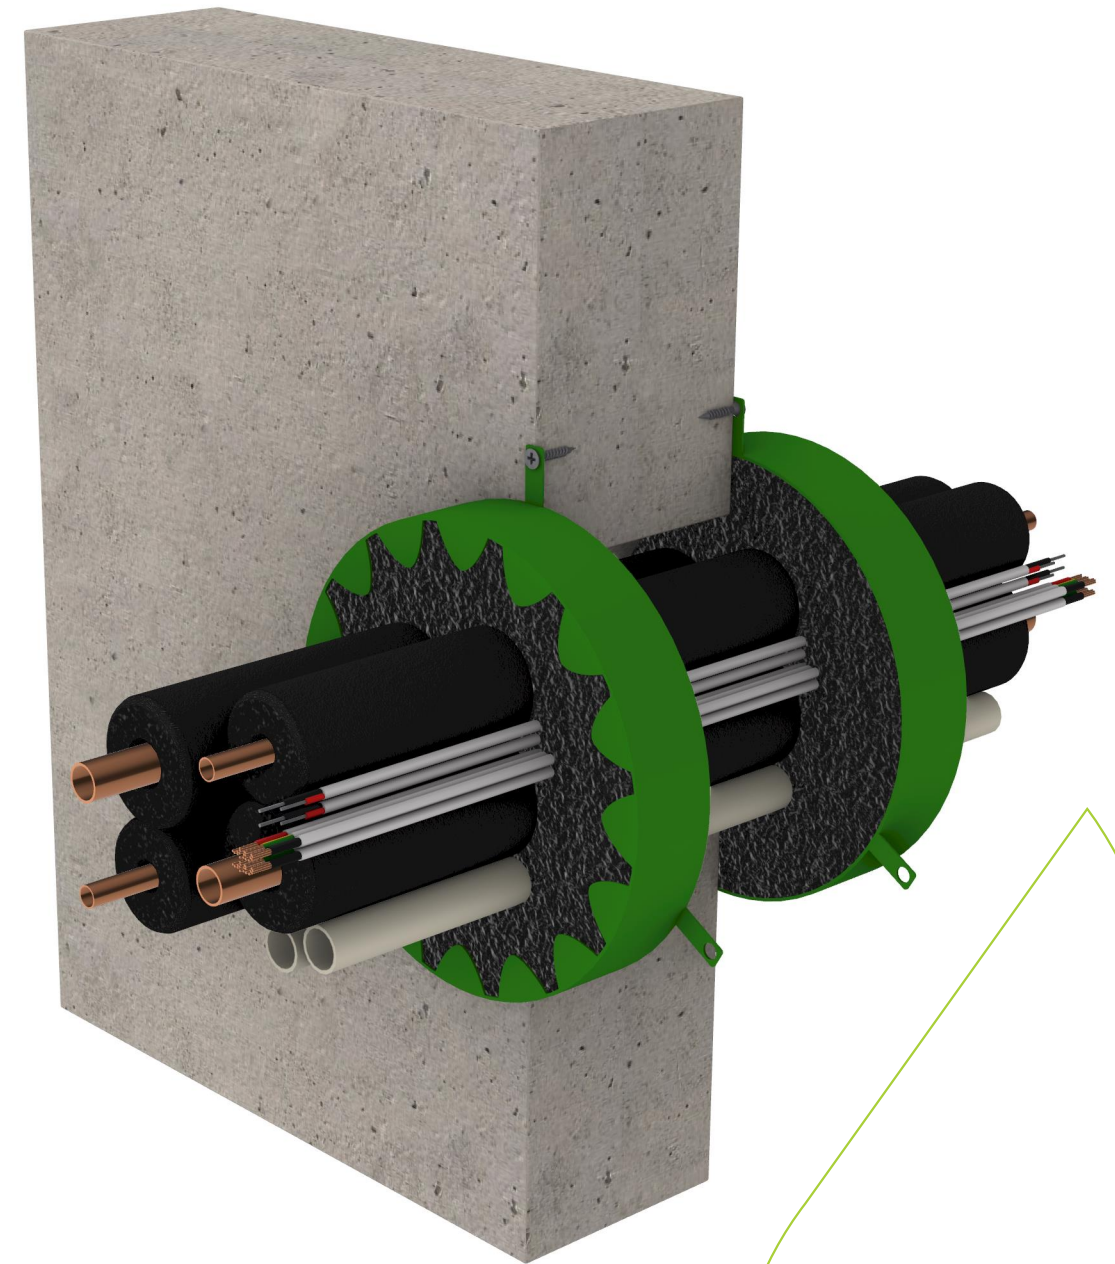


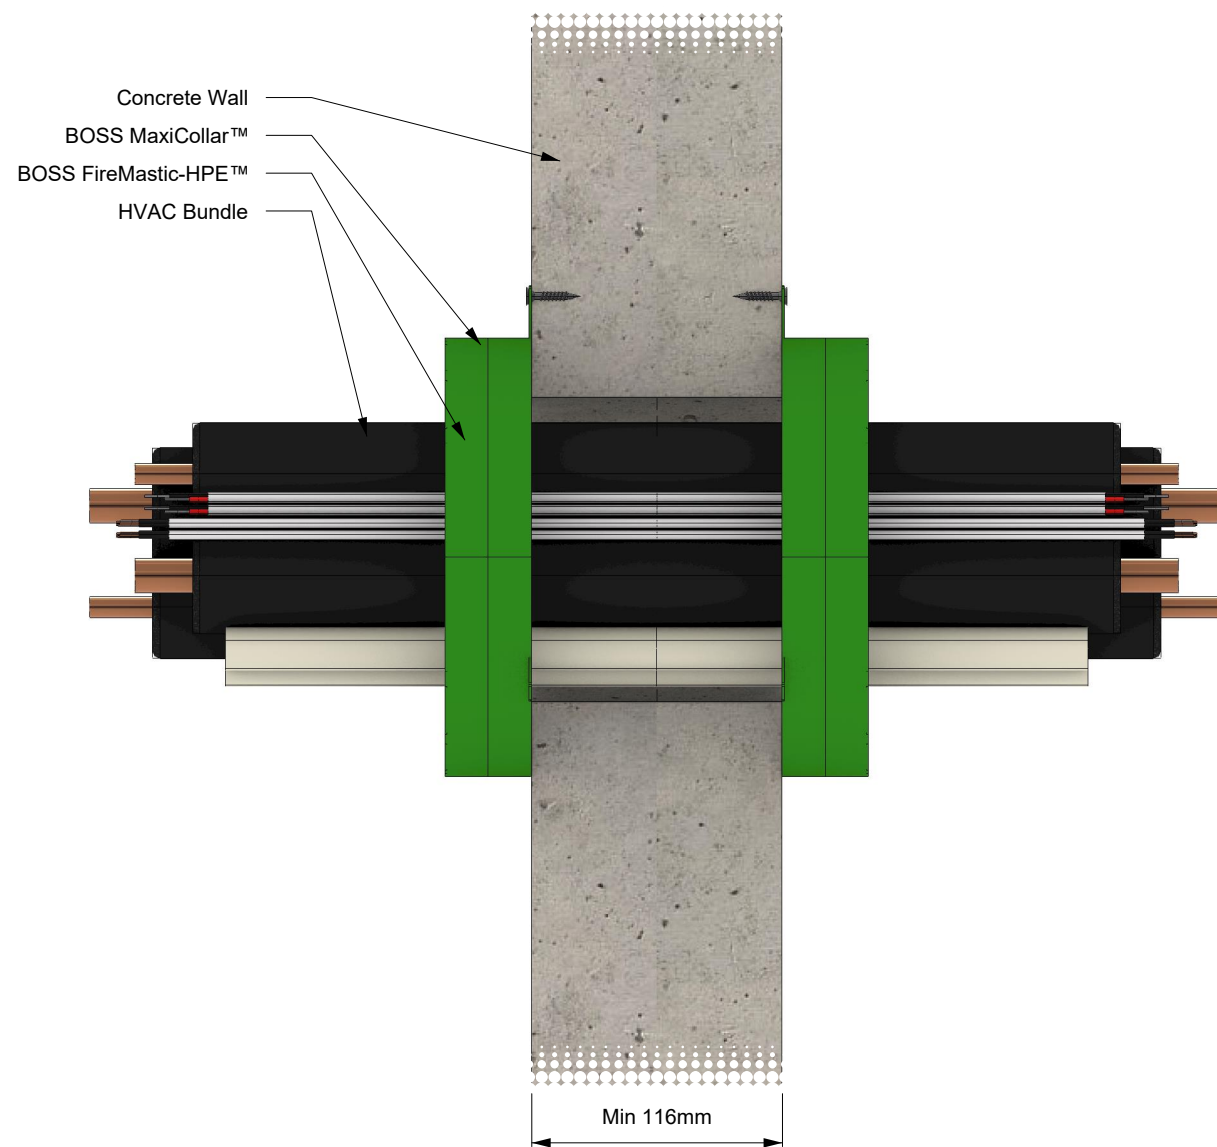

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS MaxiCollar™	-	HVAC Bundle: • 2 x 19.05 mm + 9.52 mm Paircoil with 19 mm thick nitrile rubber insulation • 2 x 2.5 mm² 2C+E TPS Power Cable • 2 x 1.5 mm² control cable • 2 x 20 mm uPVC condensate drain 150 mm BOSS MaxiCollar™ (Shell only) installed on both sides, sealed to its full depth with BOSS FireMastic-HPE™ sealant finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	HVAC	BOSS FireMastic-HPE™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		PF25015 Rev 2	
Substrate:	Concrete wall	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3379.4	
Min Substrate Thickness (mm):	116	140.6	5.1 to 12.9		Date:	22/07/25	Rev:	01
Sealant Depth (mm):	Depth of collar	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.