
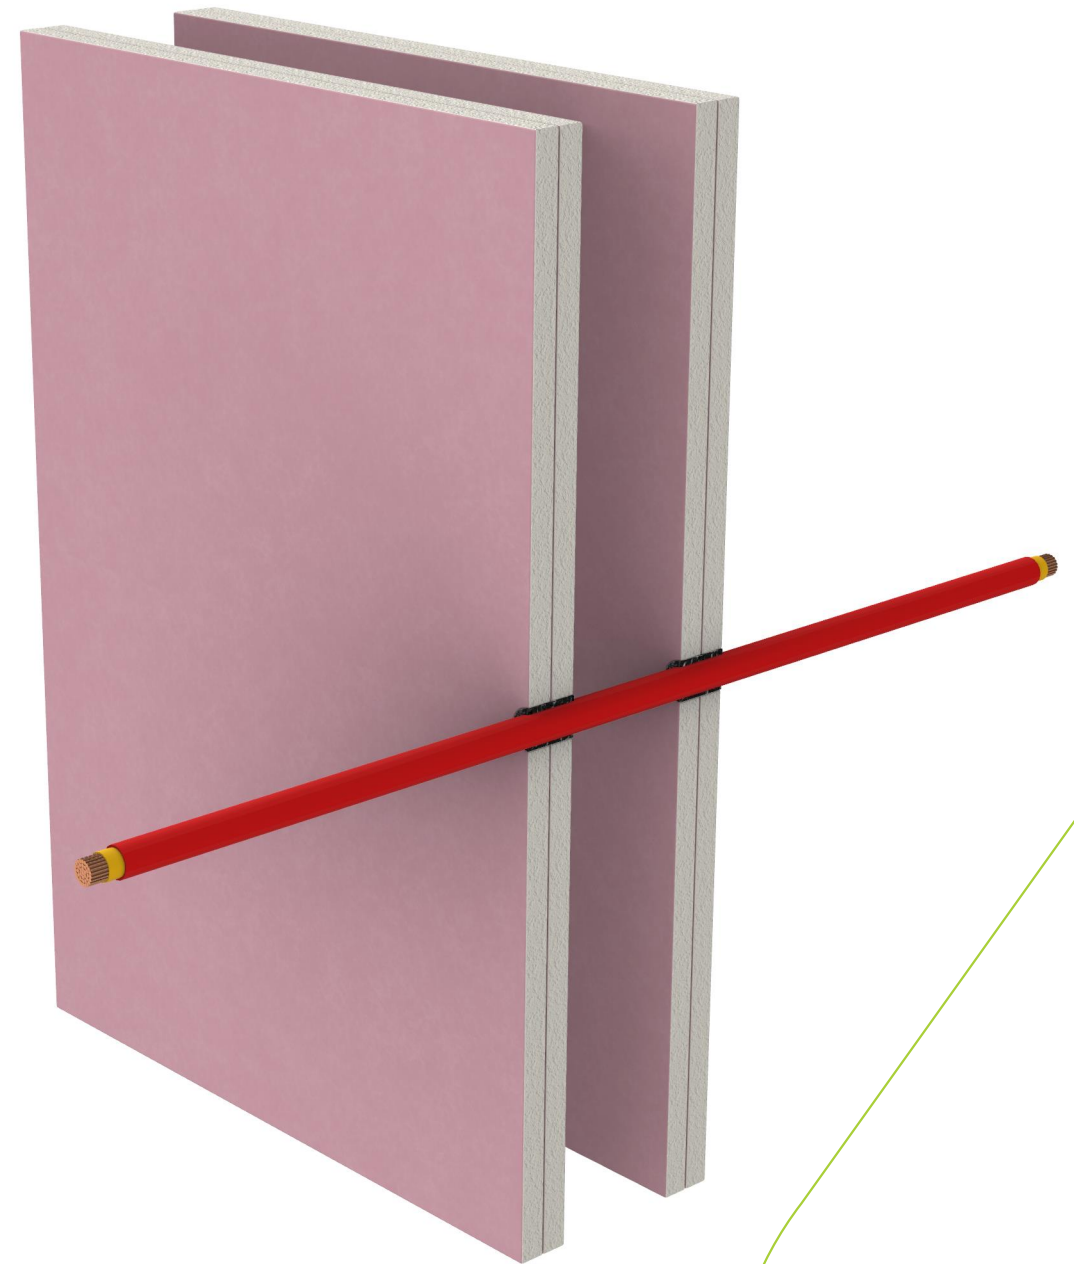


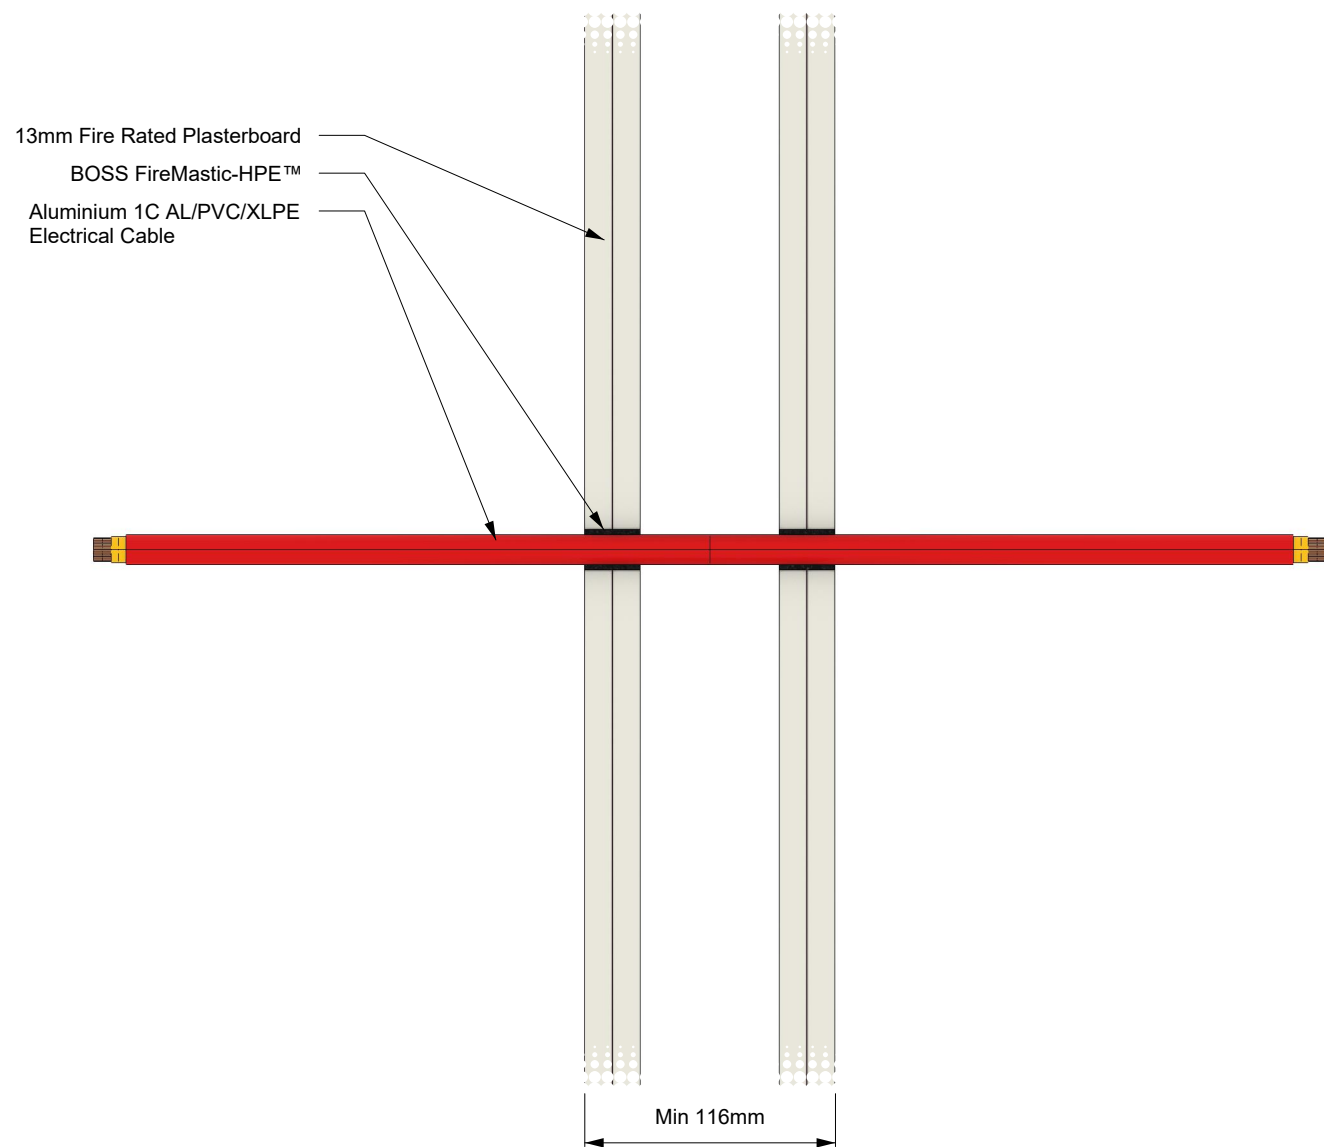

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Wall	BOSS FireMastic-HPE™	-	70 mm2 Aluminium 1C AL/PVC/XLPE electrical cable. BOSS FireMastic-HPE™ sealant 26 mm deep in annular gap finished flush both sides.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005		
Service:	Aluminium Core	-	-		Report Reference:		PF25015 Rev 2		
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3384.2		
Min Substrate Thickness (mm):	116	-	-		ADDITIONAL INFORMATION	Date:	22/07/25	Rev:	01
Sealant Depth (mm):	-	-							
Sealant Fillet (mm):	-								
Wrap Length (mm):	-								
FRL / FRR:	-/120/120								