
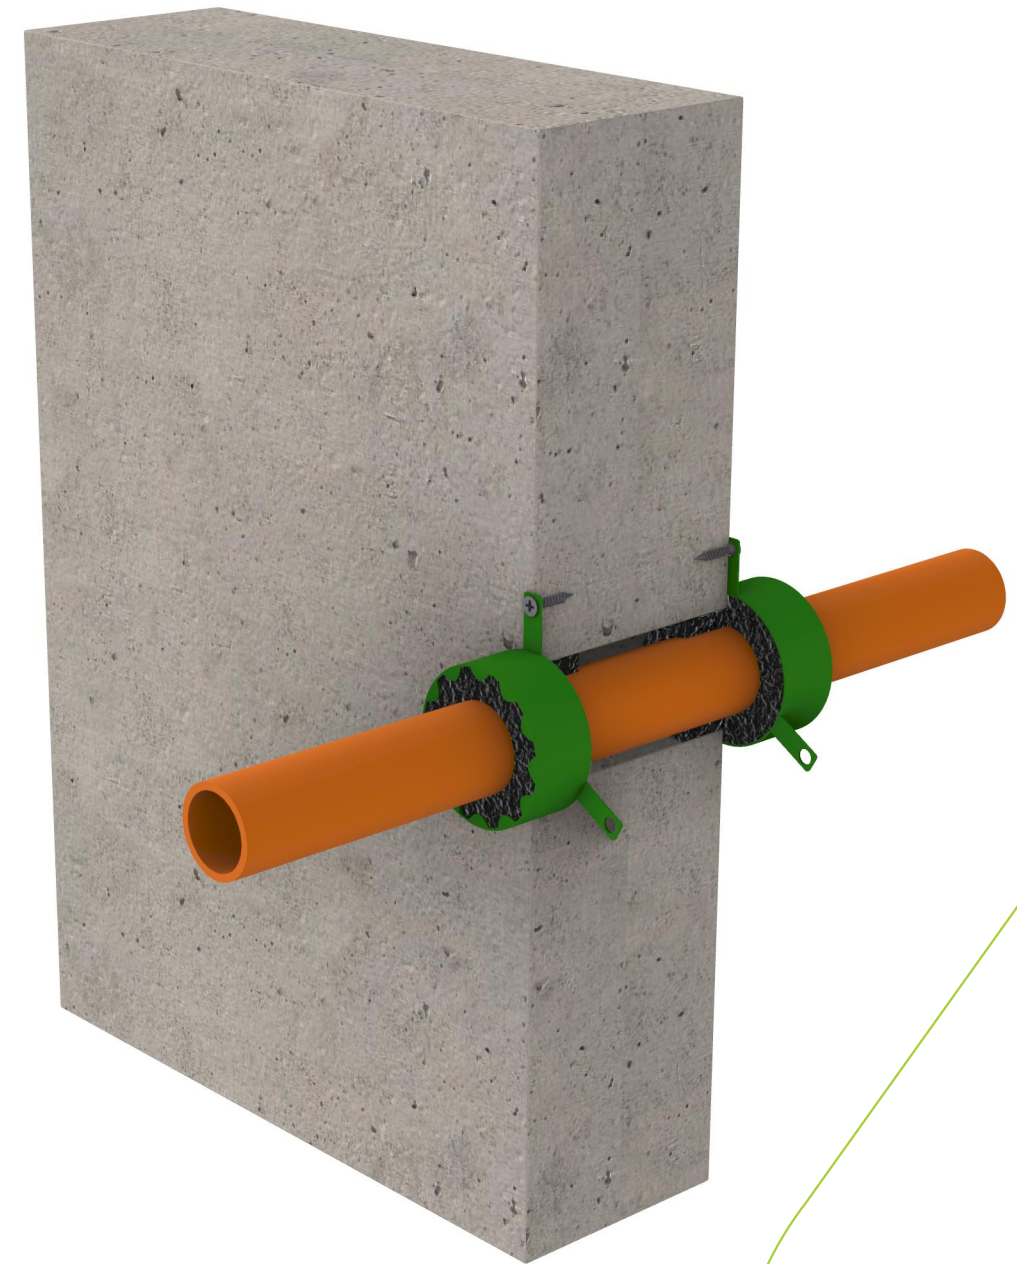


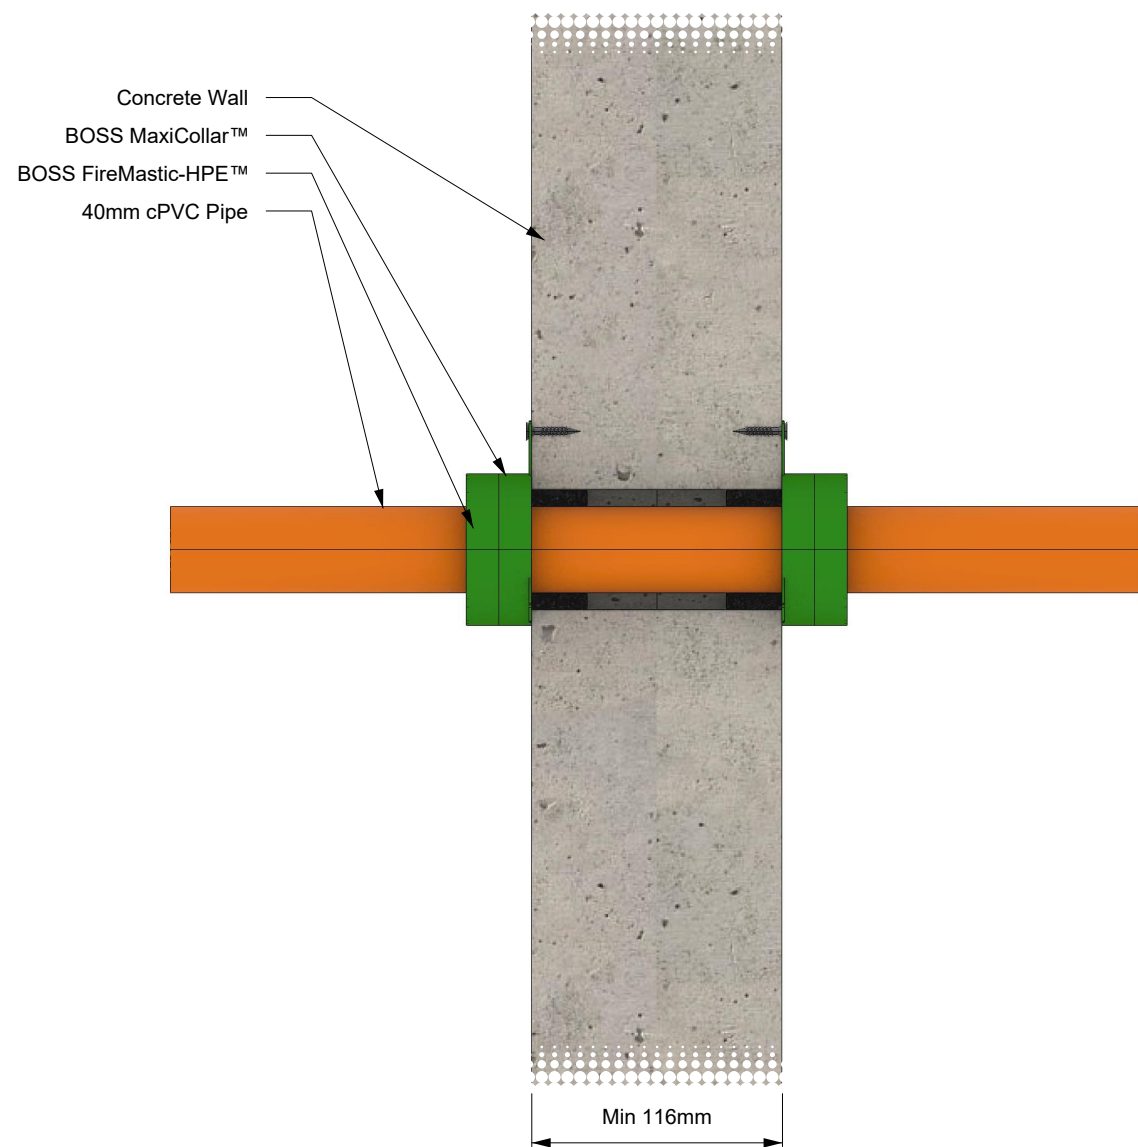

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS MaxiCollar™	-	40 mm cPVC pipe with 3.8 mm wall thickness. 50 mm BOSS MaxiCollar™ (Shell only) installed on both sides, sealed to its full depth with BOSS FireMas-tic-HPE™ sealant finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-HPE™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	CPVC	-	-		Report Reference:		PF25016 Rev 2	
Substrate:	Concrete wall	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3386.4	
Min Substrate Thickness (mm):	116	55.4	2.8 to 4.4		Date:		22/07/25	Rev: 01
Sealant Depth (mm):	Plasterboard 26 and Depth of collar	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.