


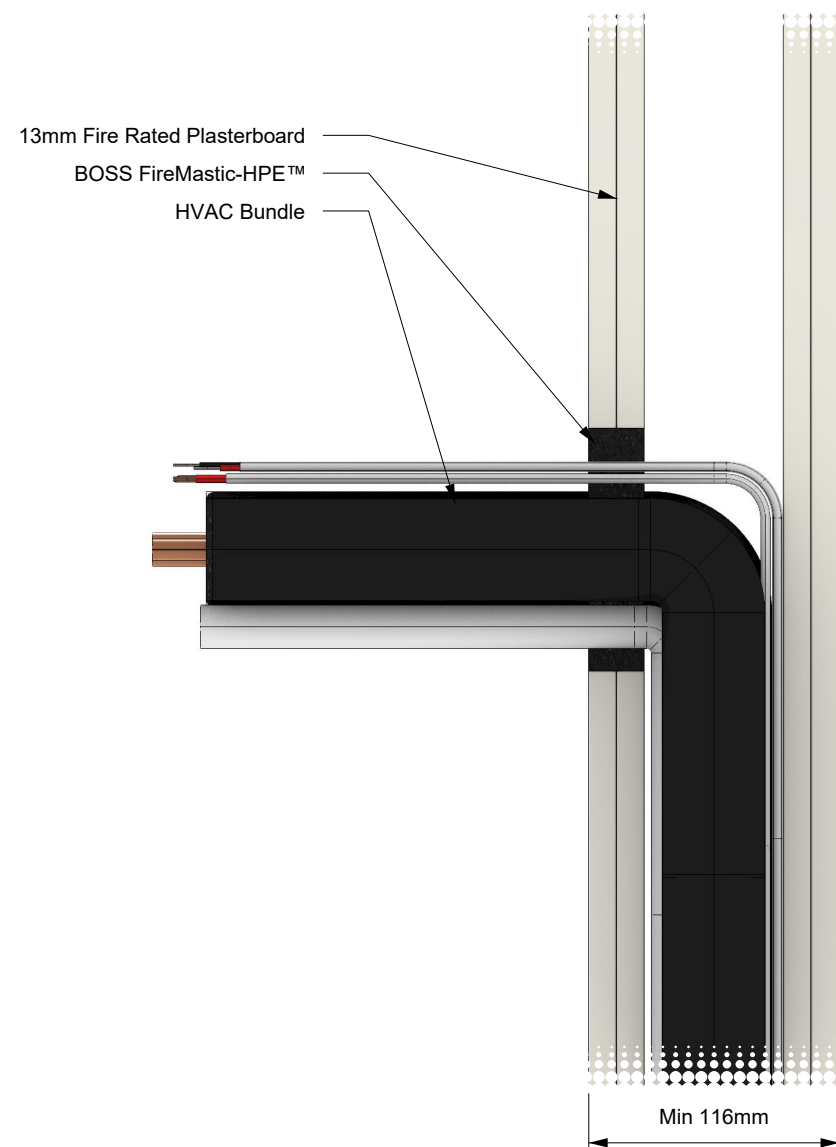

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	1 - Sided penetration - HVAC Bundle: • 1 x 19.05 mm + 9.52 mm Paircoil with 19 mm thick nitrile rubber insulation • 1 x 2.5 mm² 3C+E TPS Power Cable • 1 x 1.5 mm² control cable • 1 x 25 mm uPVC condensate drain Installed penetrating either side of the wall system, with a 90° bend into the cavity. BOSS FireMastic-HPE™ sealant 26 mm deep in annular gap finished flush.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	HVAC	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		PF25016 Rev 2	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3390.2	
Min Substrate Thickness (mm):	116	112	2.8 to 12.1		Date:	22/07/25	Rev:	01
Sealant Depth (mm):	26	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.