
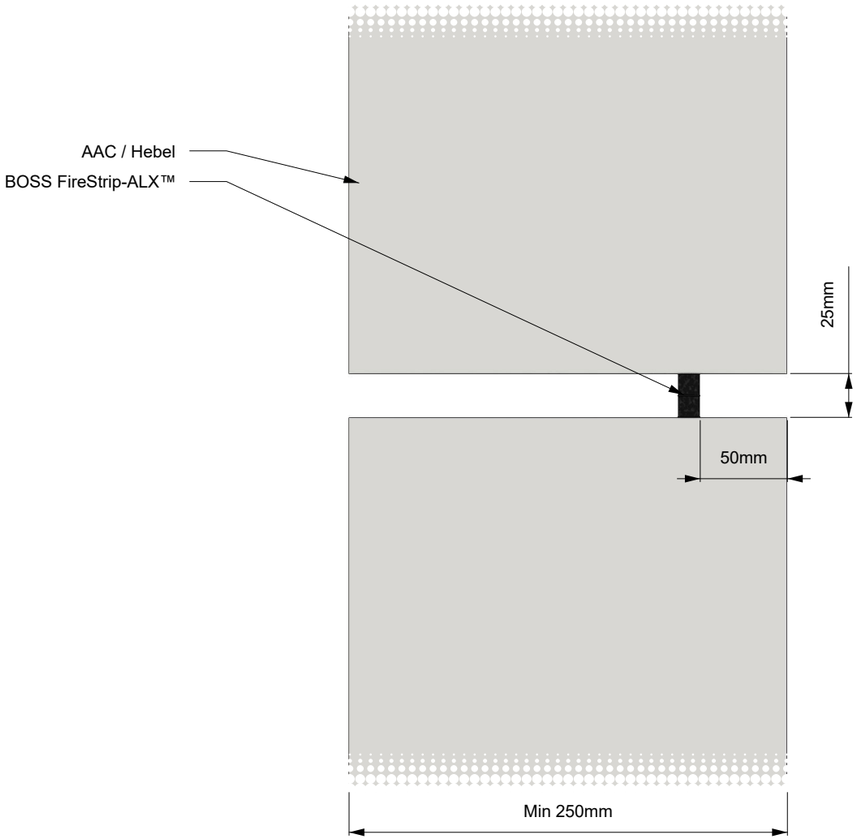


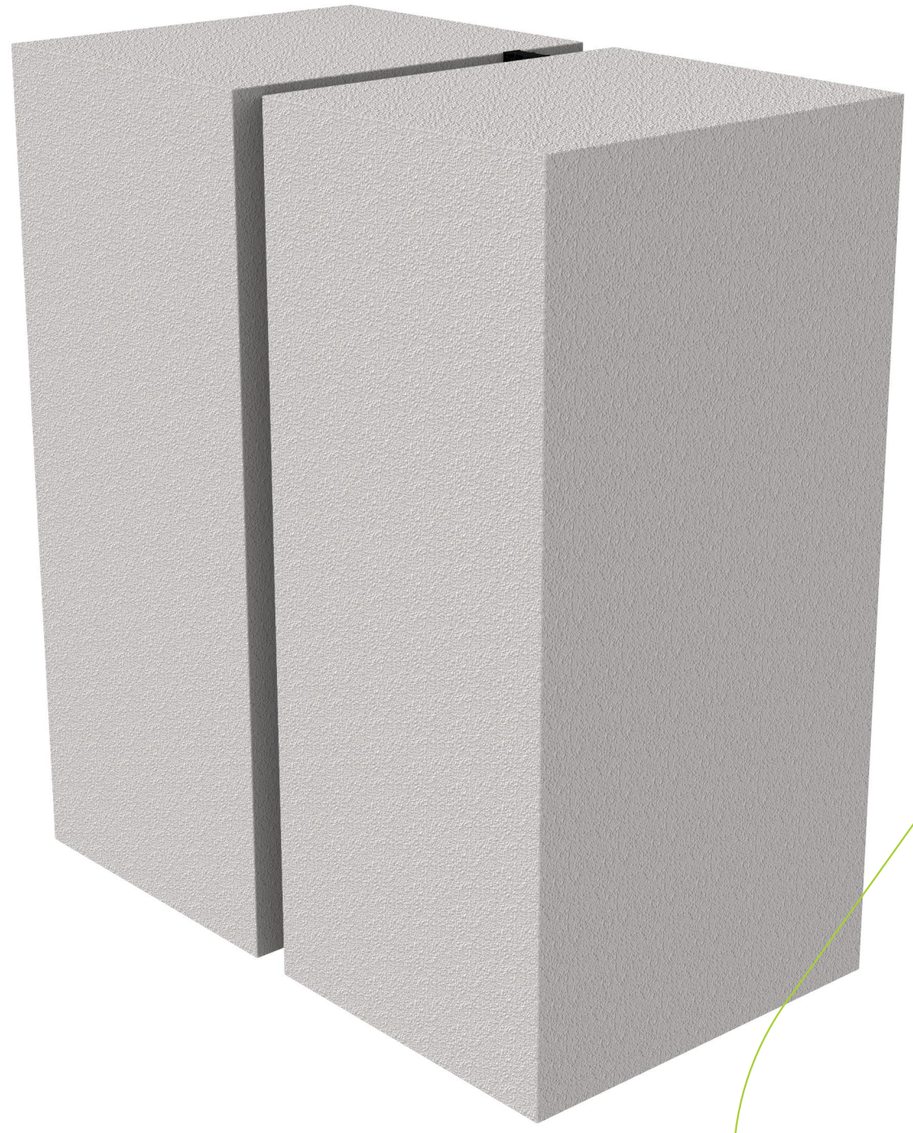

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION	
Orientation:	Wall	BOSS FireStrip-ALX™	-
Trade / Type:	Construction (Linear Gaps / Blank Seals)	-	-
Service:	-	-	-
Substrate:	AAC / Hebel	**APERTURE (mm)**	**ANNULAR GAP (mm)**
Min Substrate Thickness (mm):	250	25	-
Sealant Depth (mm):	-	**ADDITIONAL INFORMATION**	
Sealant Fillet (mm):	-	-	
Wrap Length (mm):	-		
FRL / FRR:	-/120/-		

SERVICE SIZE & DETAILS

29 mm wide × 12 mm deep BOSS FireStrip-ALX™ linear gap seal friction fitted within a 25 mm wide vertical linear gap, positioned nominal 50 mm from the unexposed face of the wall system.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	FAS190039 R2.0		
Drawing Number:	BF-3407.7		
Date:	03/09/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.