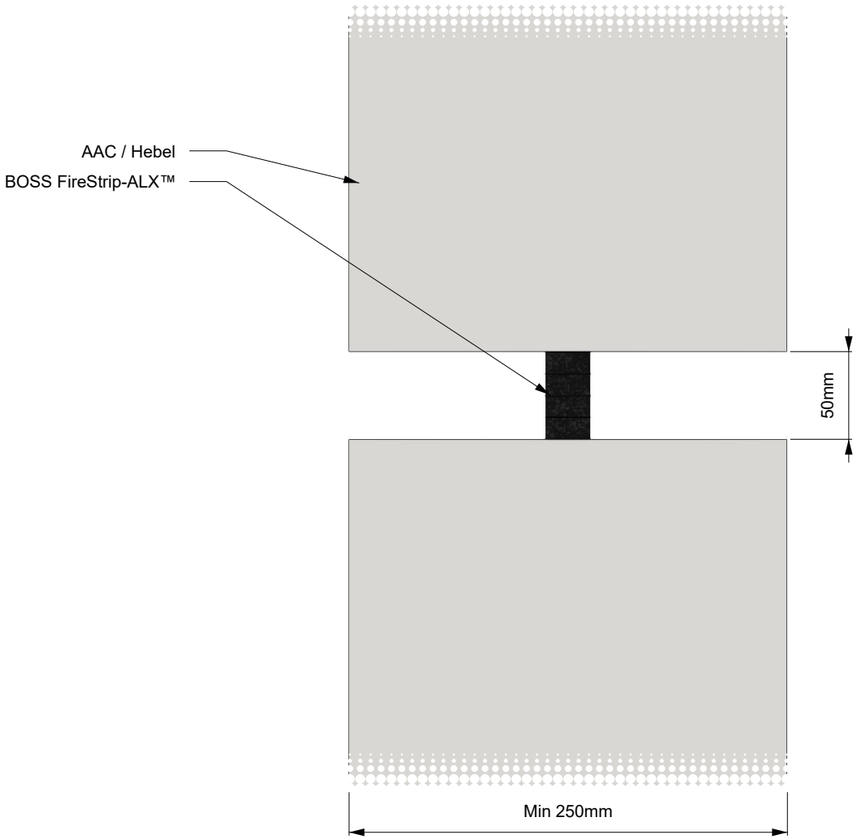
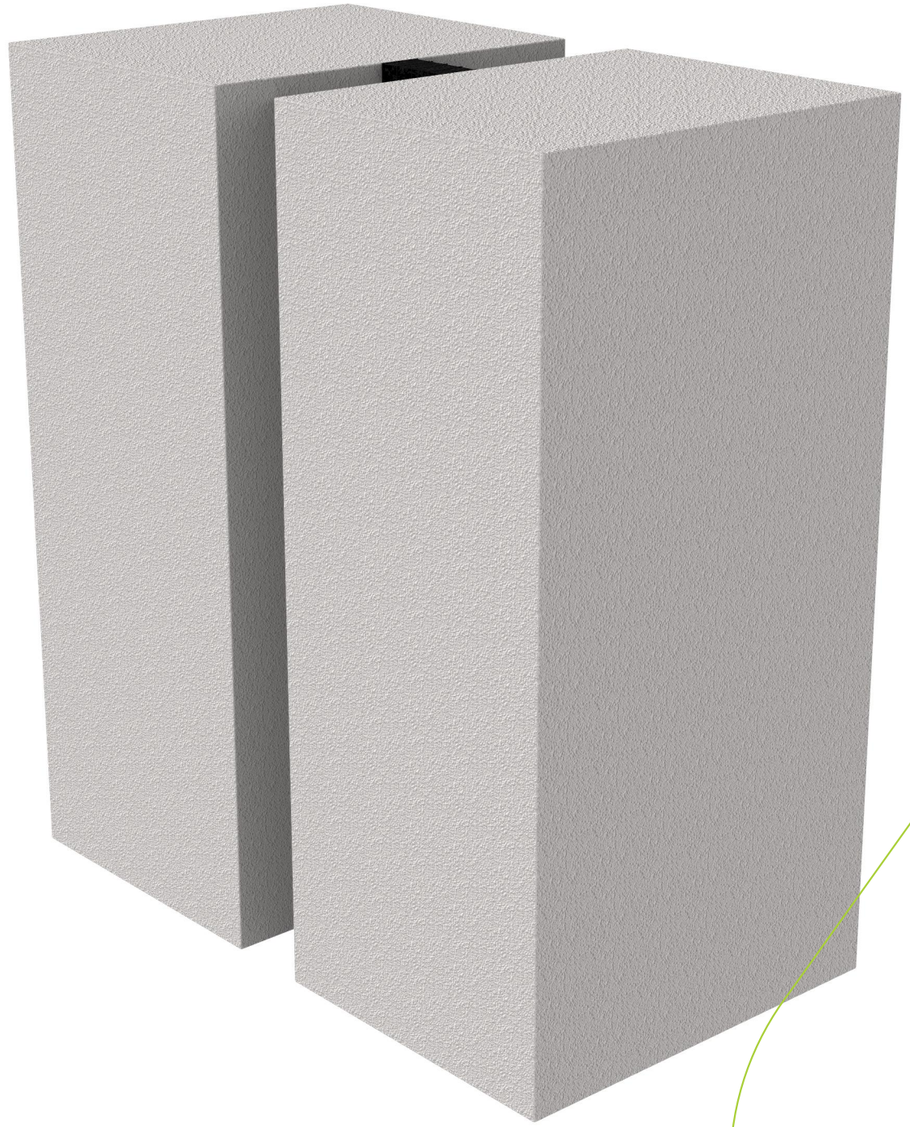


| SYSTEM DESCRIPTION | |
|---|---|
| **Orientation:** | Wall |
| **Trade / Type:** | Construction (Linear Gaps / Blank Seals) |
| **Service:** | - |
| **Substrate:** | AAC / Hebel |
| **Min Substrate Thickness (mm):** | 250 |
| **Sealant Depth (mm):** | - |
| **Sealant Fillet (mm):** | - |
| **Wrap Length (mm):** | - |
| **FRL / FRR:** | -/60/30 |

| FIRE STOPPING INFORMATION | |
|---|---|
| BOSS FireStrip-ALX™ | - |
| - | - |
| - | - |
| **APERTURE (mm)** | **ANNULAR GAP (mm)** |
| 50 | - |
| **ADDITIONAL INFORMATION** | |
| - | |

**SERVICE SIZE & DETAILS**

63.6 mm wide × 25 mm deep BOSS FireStrip-ALX™ linear gap seal friction fitted within a 50 mm wide vertical linear gap, positioned at mid-depth of the wall system.

| SUPPORTING INFORMATION | | | |
|---|---|---|---|
| **Reference Standard:** | AS 1530.4:2014 | | |
| **Supplementary Standard:** | AS 4072.1-2005 | | |
| **Report Reference:** | FAS190039 R2.0 | | |
| **Drawing Number:** | BF-3411.7 | | |
| **Date:** | 03/09/25 | **Rev:** | 01 |

**IMPORTANT:** This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.