
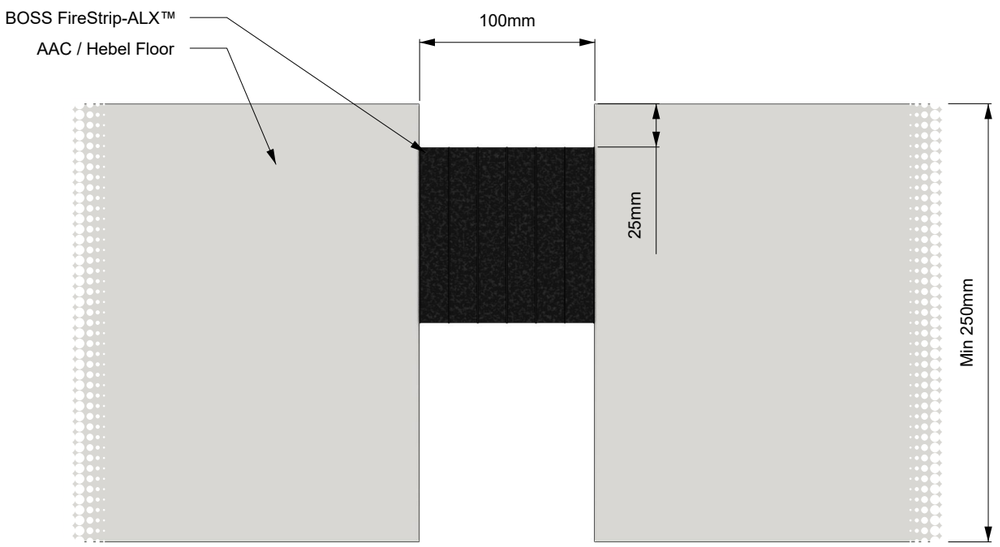


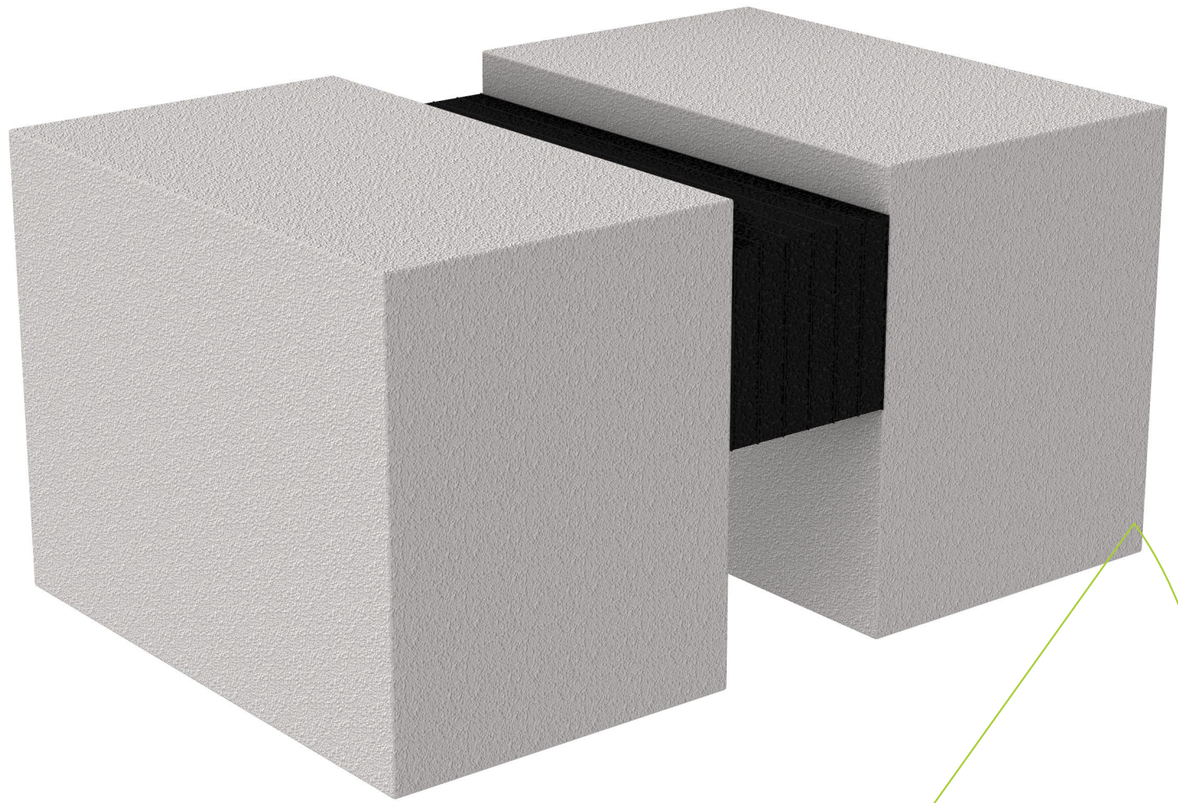

SYSTEM DESCRIPTION	
Orientation:	Floor
Trade / Type:	Construction (Linear Gaps / Blank Seals)
Service:	-
Substrate:	AAC / Hebel Floor
Min Substrate Thickness (mm):	250
Sealant Depth (mm):	-
Sealant Fillet (mm):	-
Wrap Length (mm):	-
FRL / FRR:	-/120/60

FIRE STOPPING INFORMATION	
BOSS FireStrip-ALX™	-
-	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
100	-
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

126 mm wide × 100 mm deep BOSS FireStrip-ALX™ linear gap seal friction fitted within a 100 mm wide linear gap, positioned 25 mm from the unexposed side of the floor system.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	FAS190039 R2.0		
Drawing Number:	BF-3415.26		
Date:	03/09/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.