


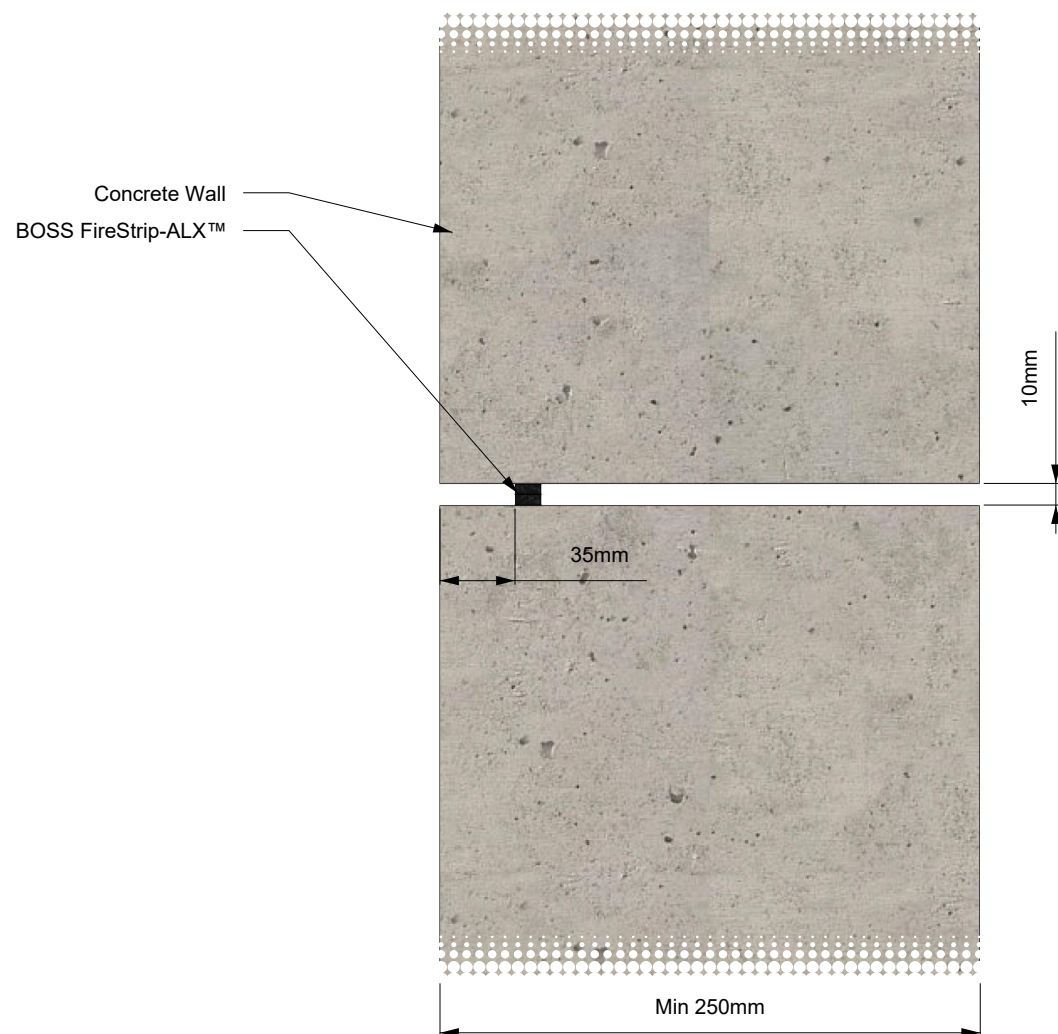

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireStrip-ALX™	-	12 mm wide × 12 mm deep BOSS FireStrip-ALX™ linear gap seal friction fitted within a 10 mm wide vertical linear gap, positioned 35 mm from the exposed side of the wall system.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Construction (Linear Gaps / Blank Seals)	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		FAS190039 R2.0	
Substrate:	Concrete wall	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3416.4	
Min Substrate Thickness (mm):	250	10	-		Date:	03/09/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.