
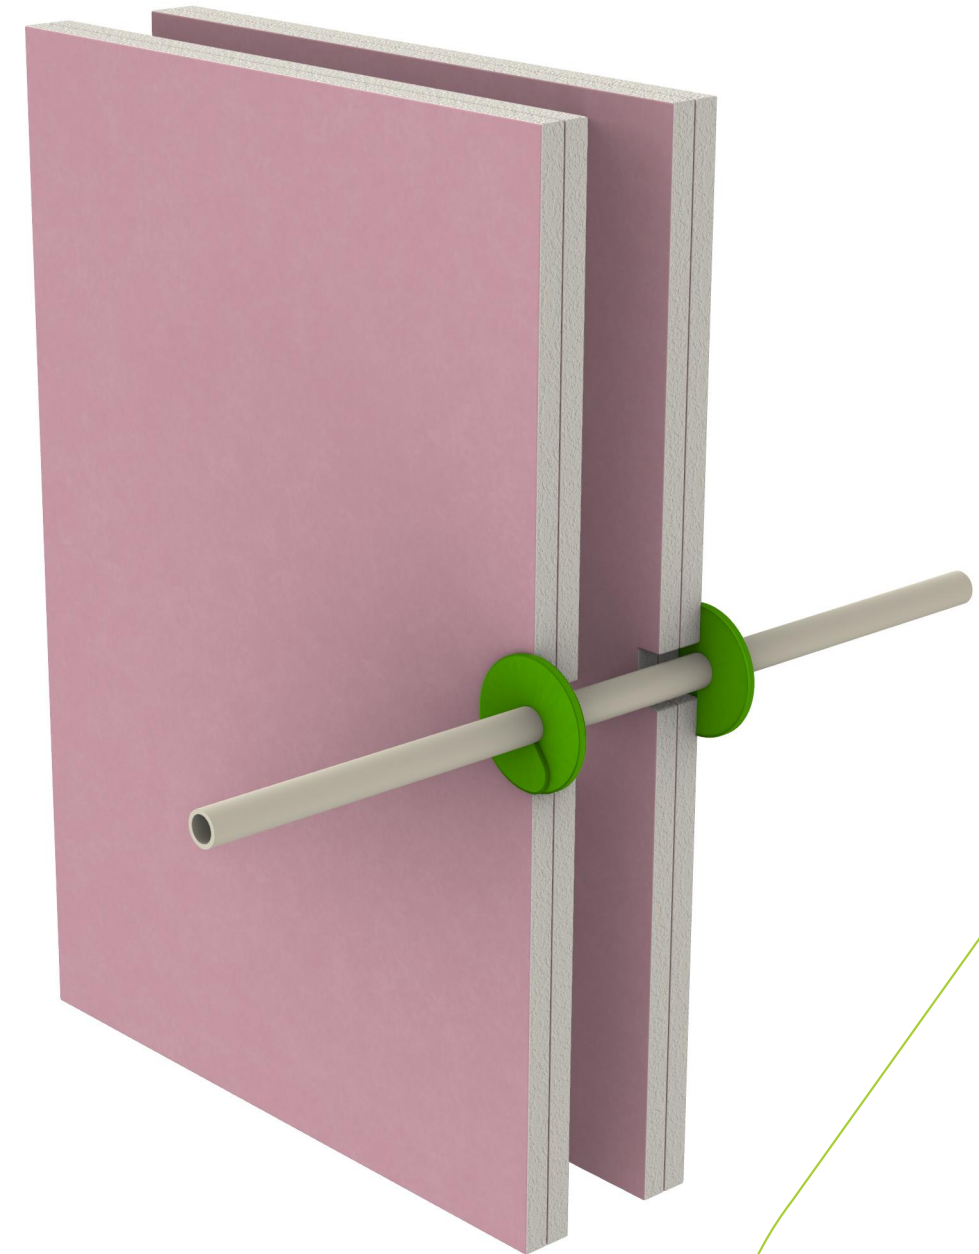


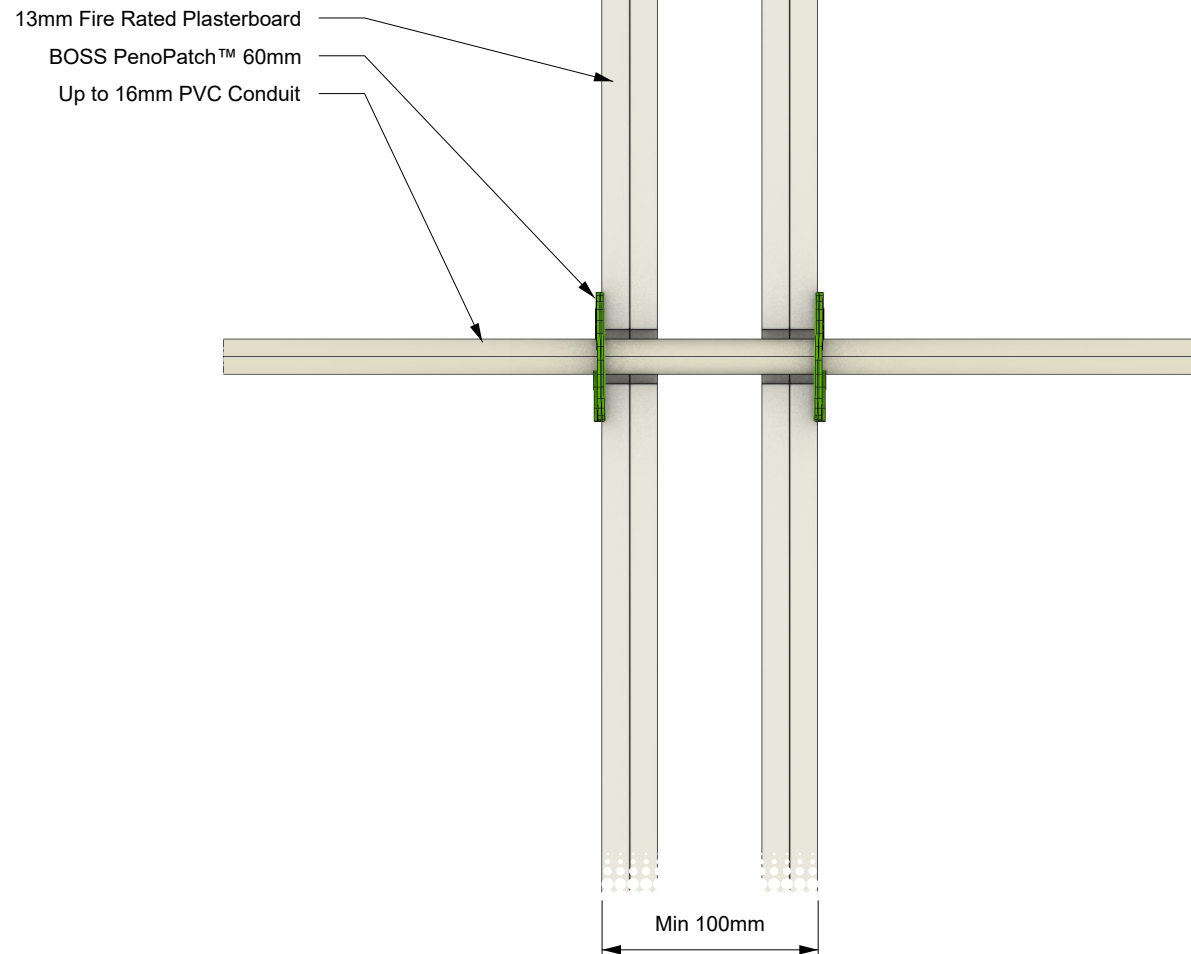

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS PenoPatch™ 60mm	-	Up to 16 mm PVC conduit. Pipe installed in a 25 mm x 25 mm aperture protected by BOSS PenoPatch™ 60mm on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	-	-		Report Reference:		FAS190100 R2.1	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3434.2	
Min Substrate Thickness (mm):	100	25 x 25	-		Date:	06/11/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-	-						
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							