
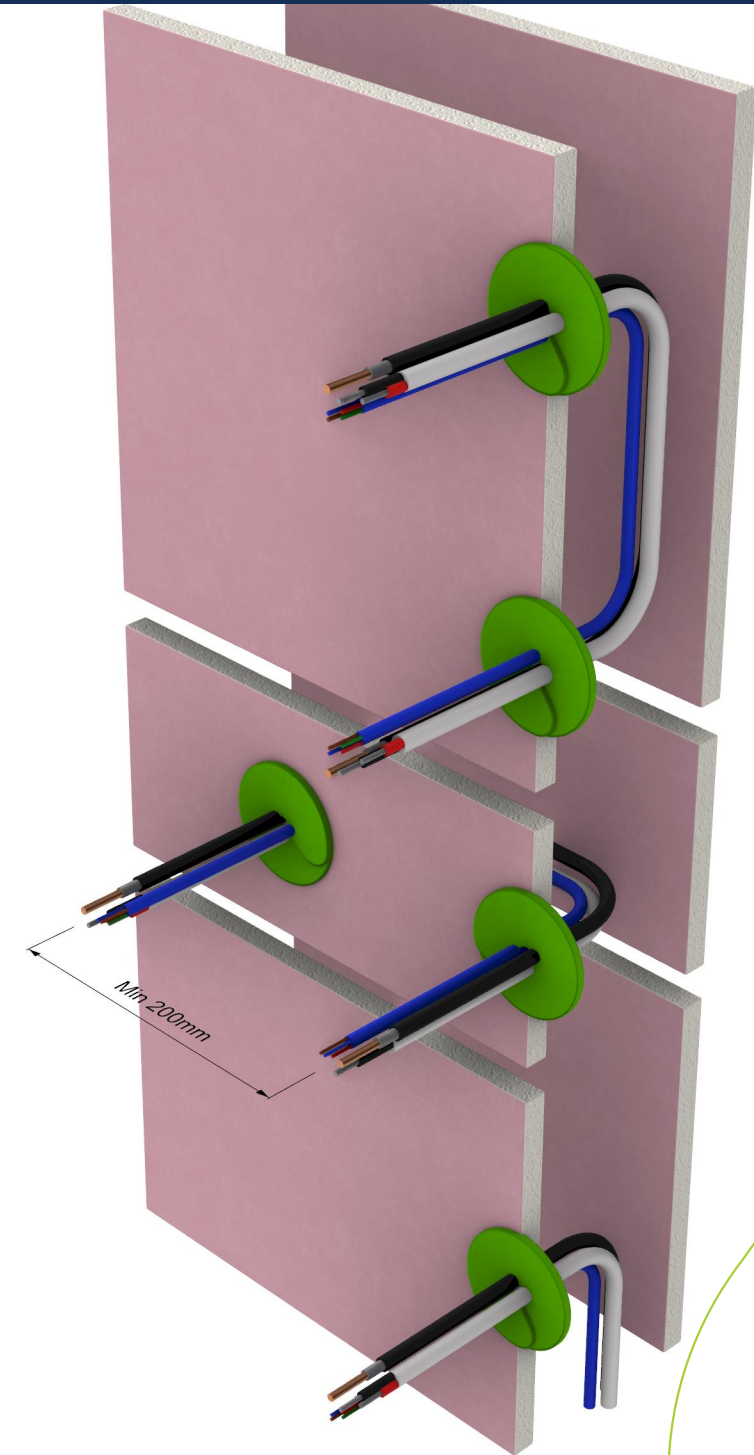


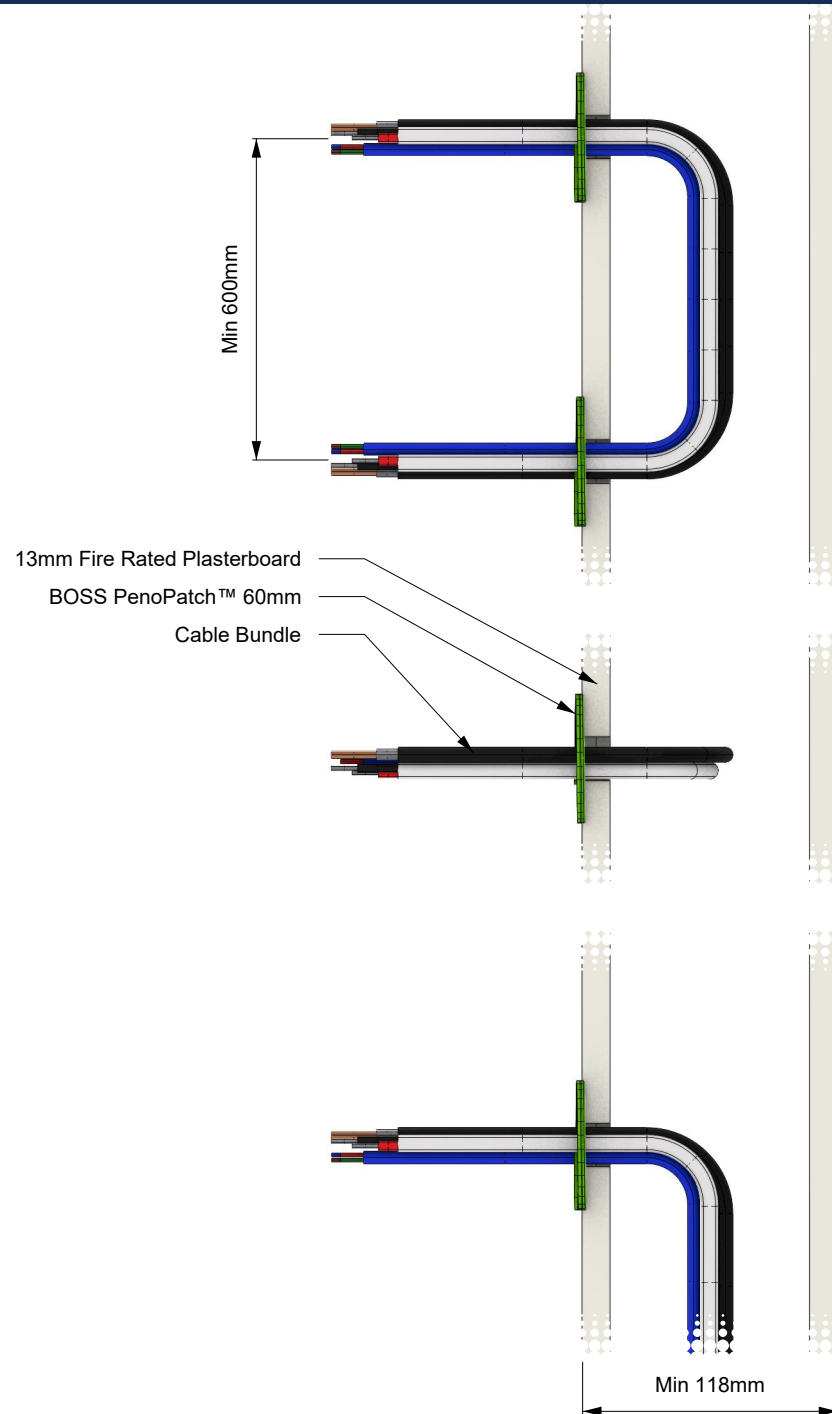

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS PenoPatch™ 60mm	-	1 - Sided penetration - Approved from both directions. Bundle of up to 3 communications cables, including a combination of: • CAT6 cables • 0.75 mm² Fire Alarm cables • Security cables • COAX cables Cable bundle installed in a 20 mm aperture protected by BOSS PenoPatch™ 60mm at all penetration locations.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	CAT	-	-		Report Reference:		FAS190100 R2.1	
Substrate:	Single Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3448.1	
Min Substrate Thickness (mm):	118	20	-		Date:	22/09/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.