
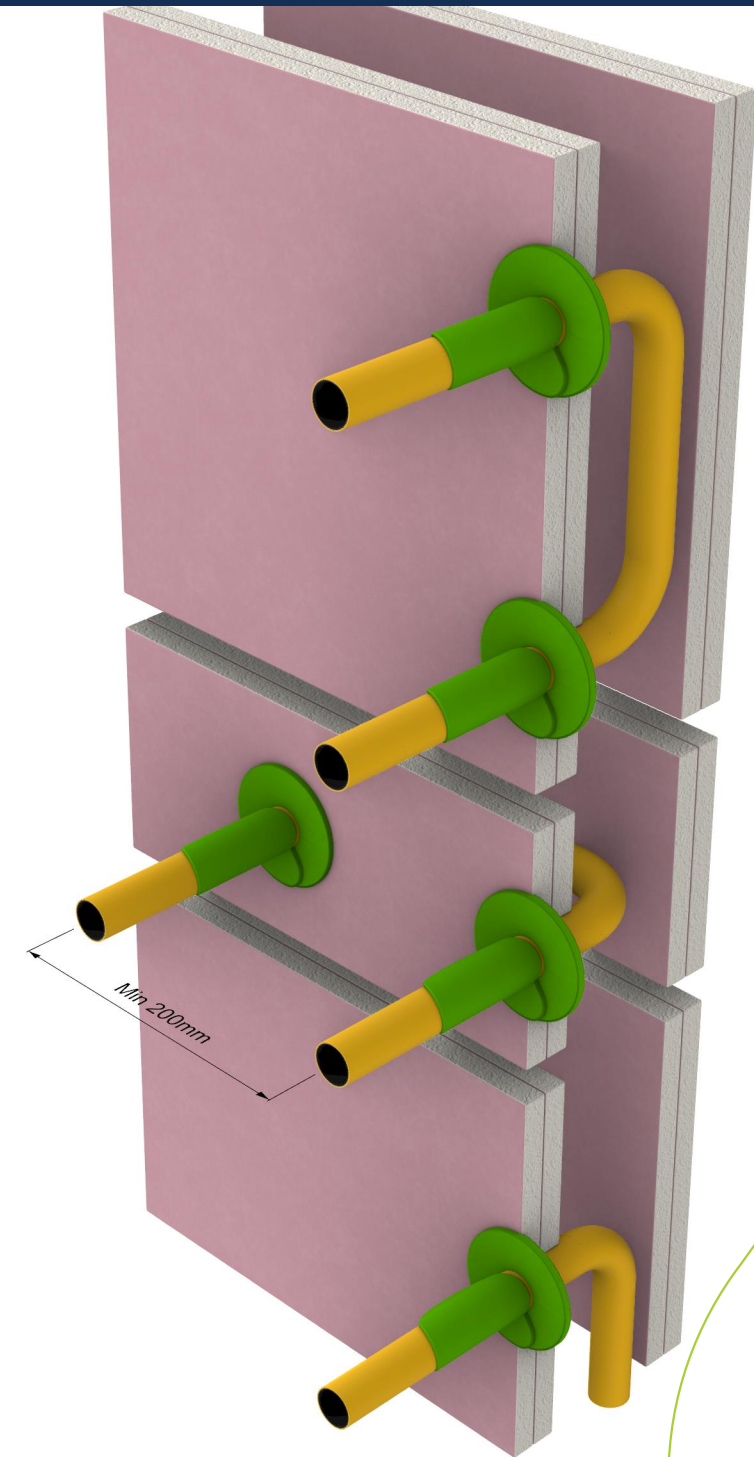


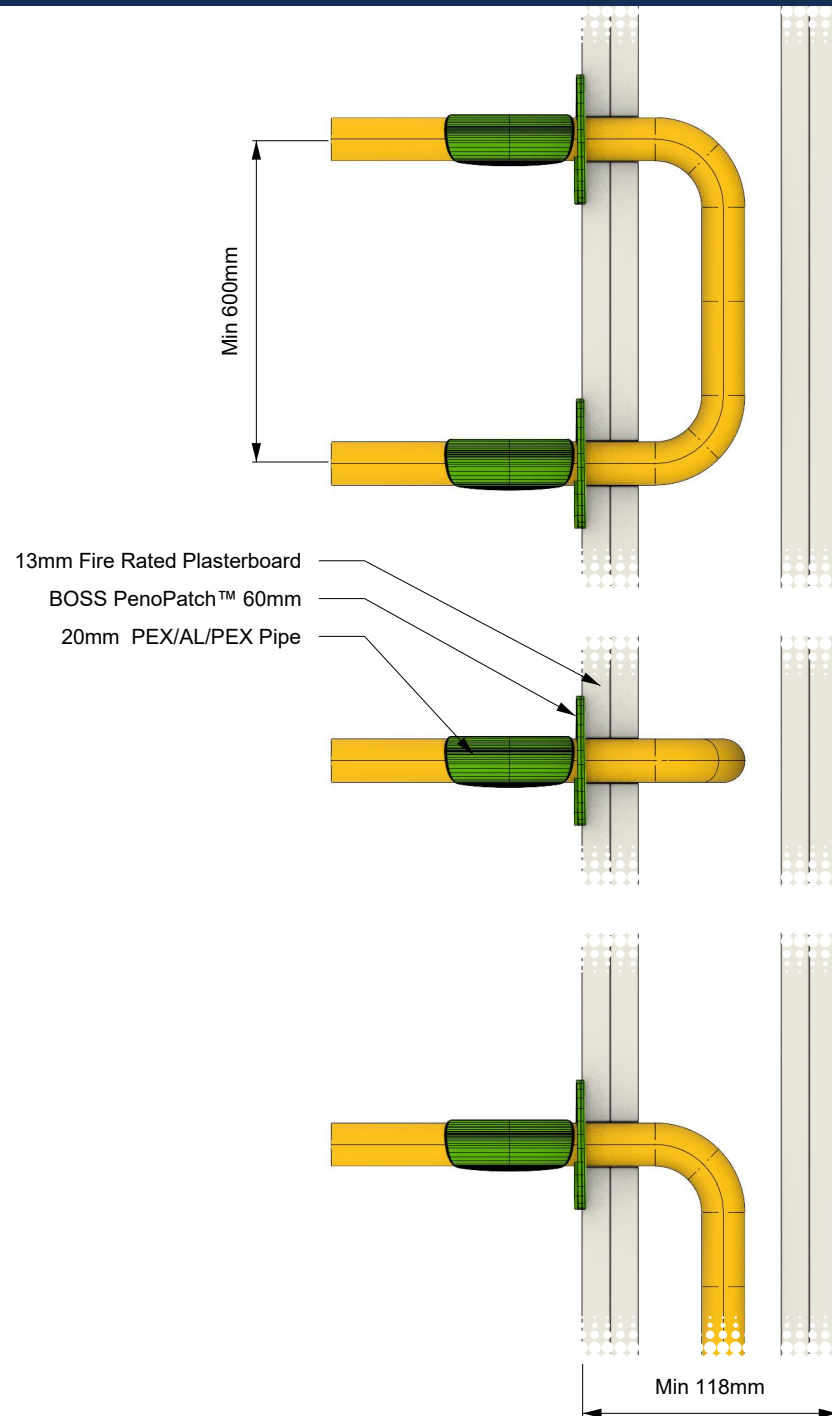

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS PenoPatch™ 60mm	-	1 - Sided penetration - Approved from both directions. 20 mm PEX-AL pipe. Pipe installed in a 21 mm aperture, sealed with BOSS PenoPatch™ 60 mm at all penetration locations, and also wrapped around the service for 60 mm along its length.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PEX-AL	-	-		Report Reference:		FAS190100 R2.1	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3450.2	
Min Substrate Thickness (mm):	118	21	-		Date:	22/09/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/45							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.