
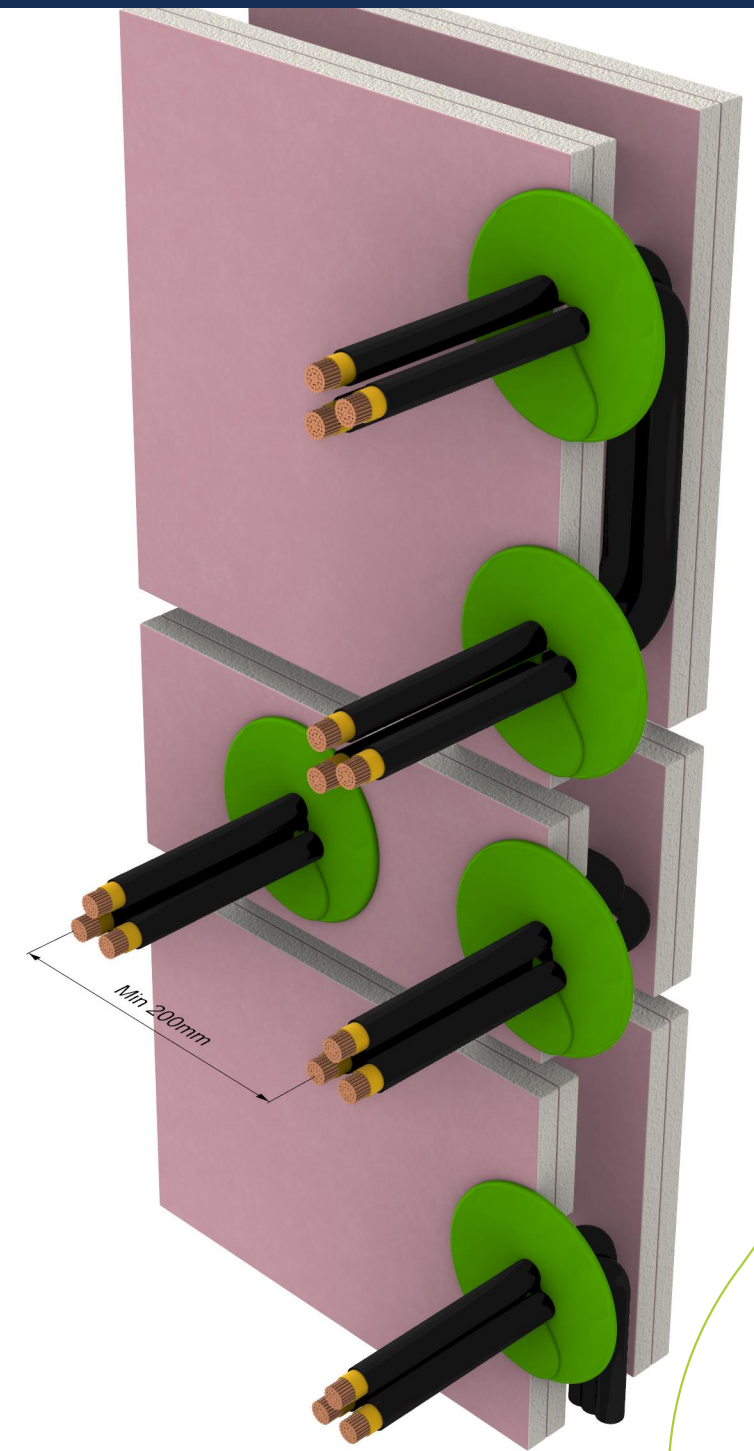


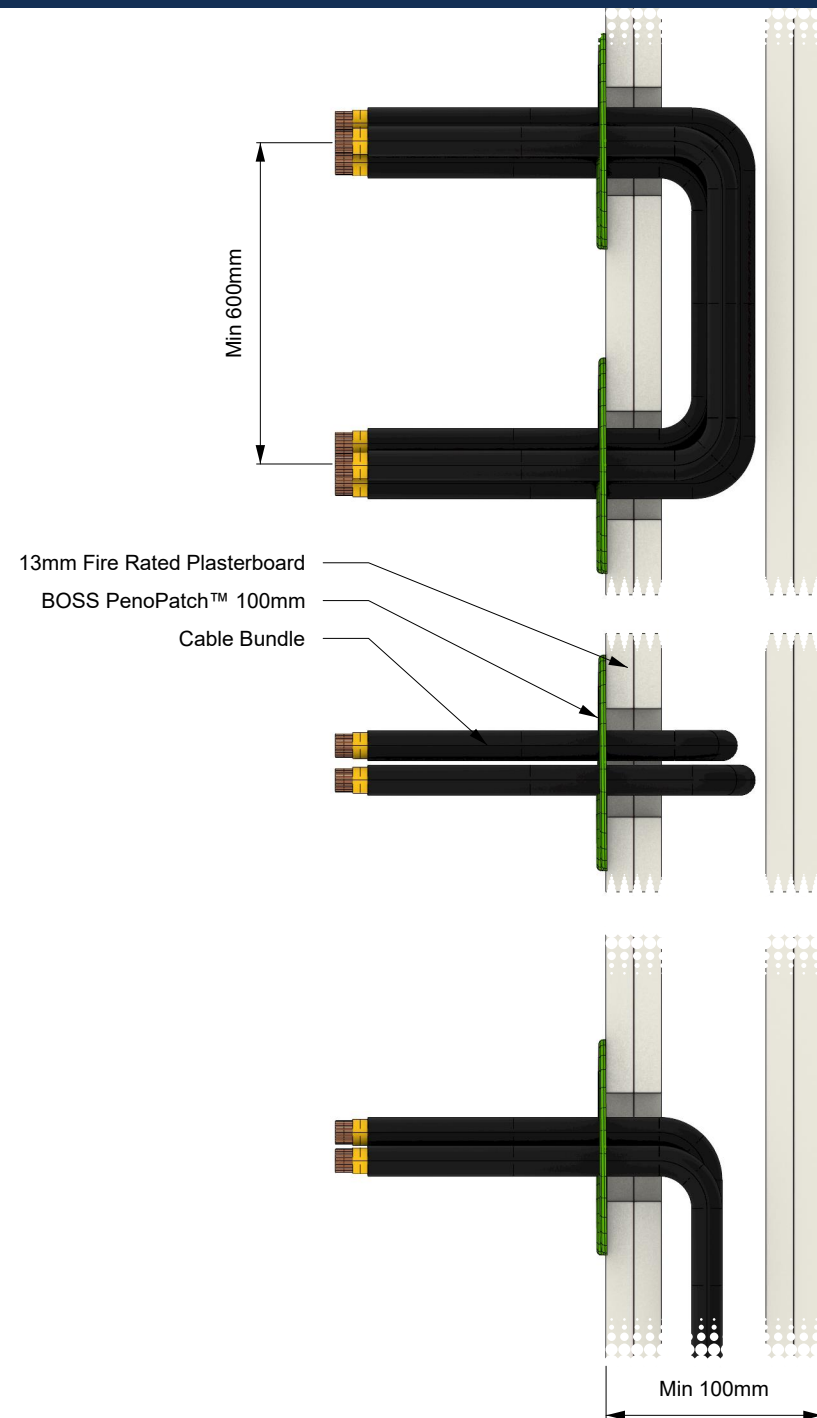

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS PenoPatch™	-	1 - Sided penetration – Approved from both directions. Bundle of 3 - 5 x 1.5 mm², PVC/PVC sheathed power cables. Cables installed in a 50 mm x 50 mm aperture protected by BOSS PenoPatch™ 100mm at all penetration locations.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Multi Core / Orange Circular / Mains	-	-		Report Reference:		FAS190100 R2.1	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3460.2	
Min Substrate Thickness (mm):	100	50 x 50	-		Date:	22/09/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							