
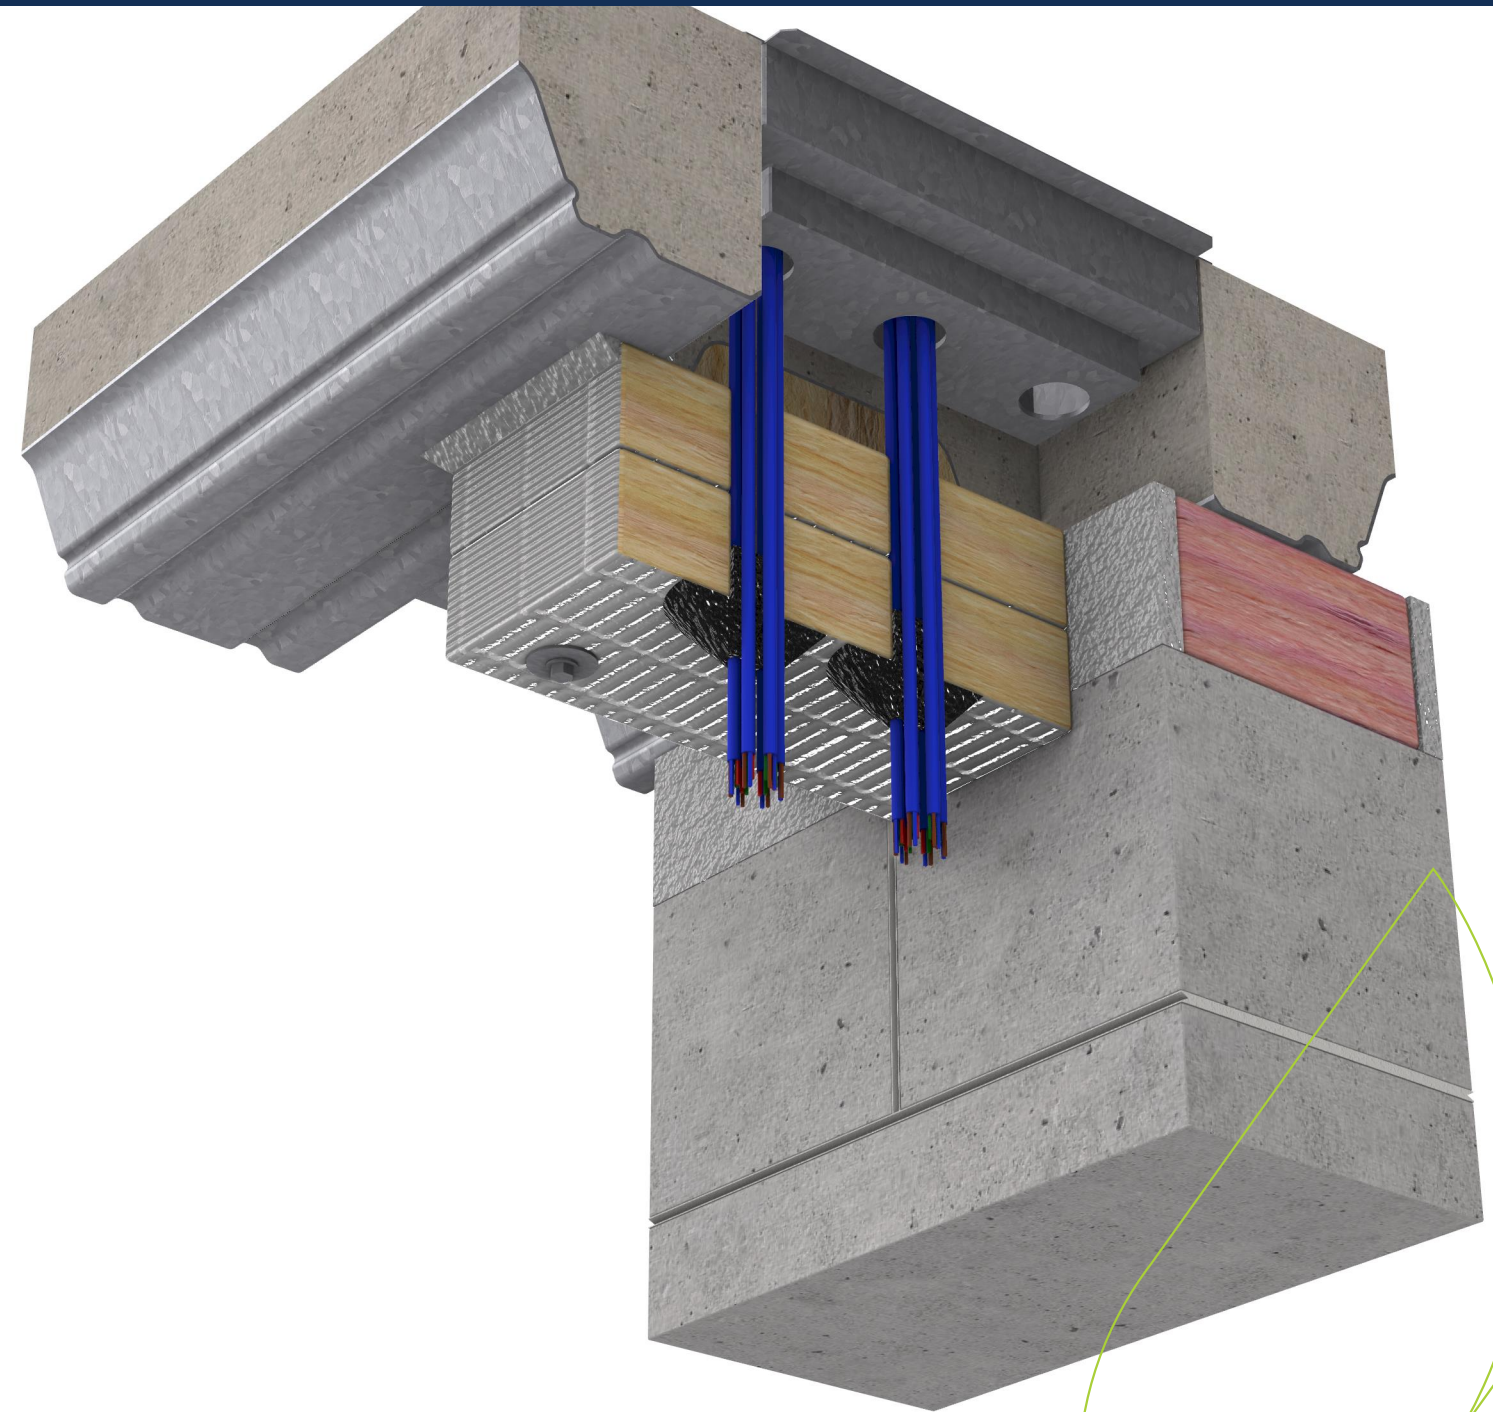


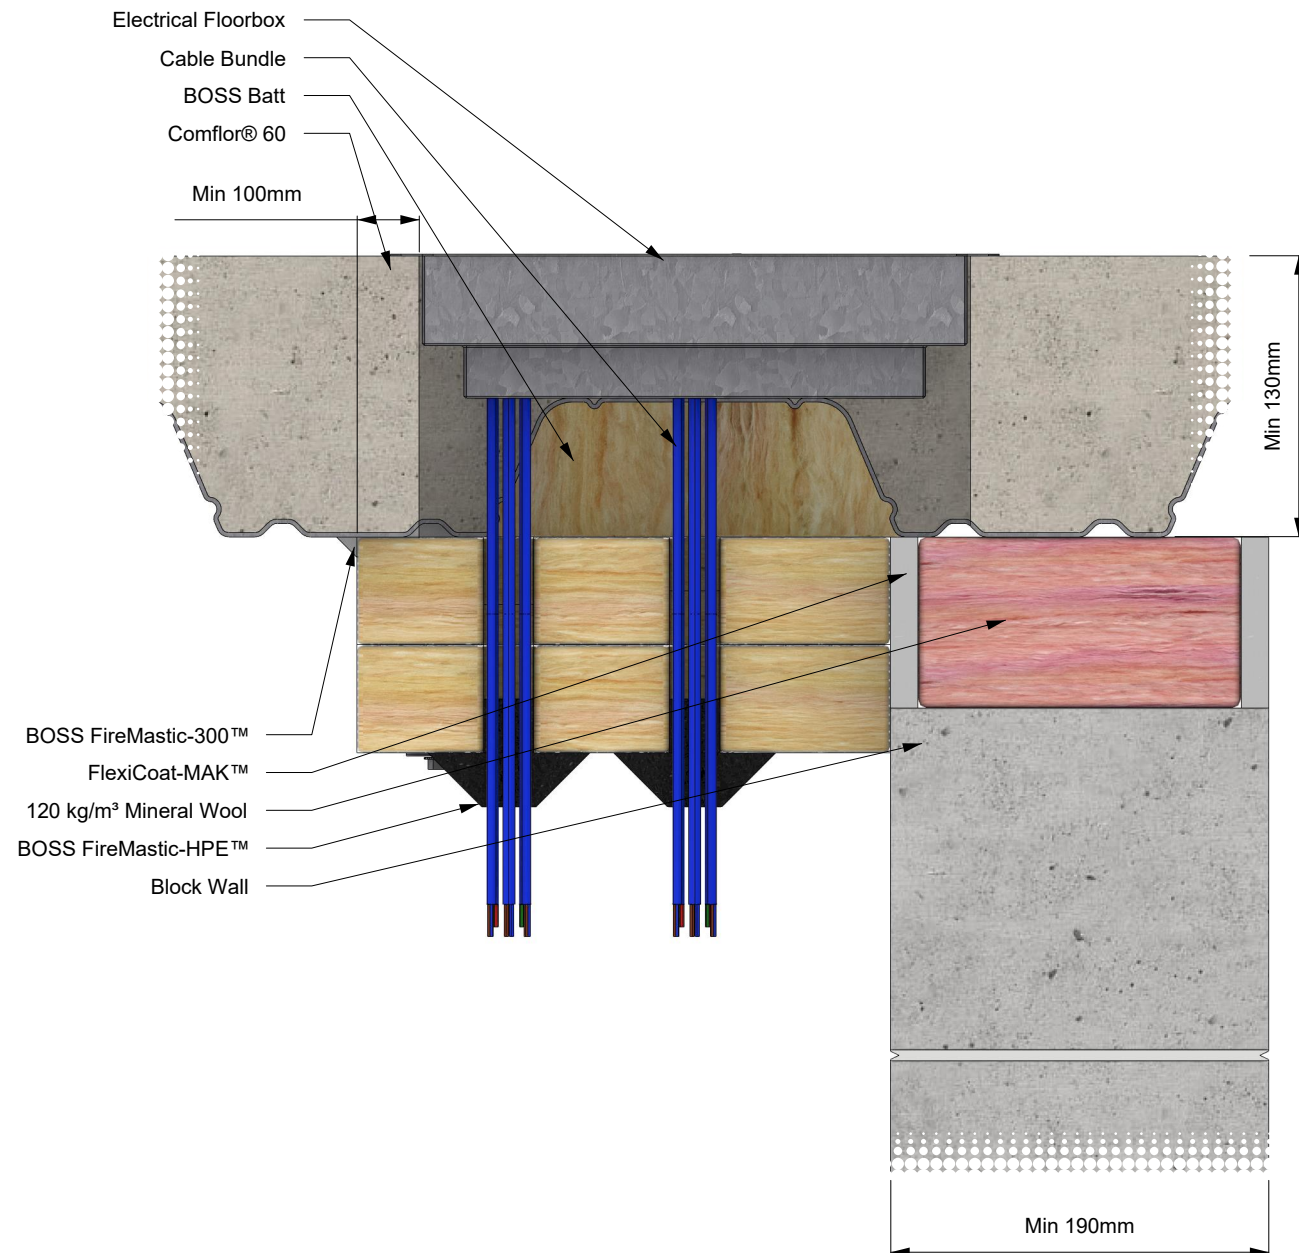

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS Batt™	BOSS FireMastic-300™	Recessed electrical floorbox containing up to three 32 mm diameter cable bundles, including: • Up to 8 × CAT6 cables • Up to 4 × 2C+E PVC-sheathed power cables The floorbox is recessed into the ComFlor® 60 floor from the top side, with cables exiting through the underside. 2-layers of BOSS Batt™ fixed to the underside, with gaps filled to match the floor profile - all edges coated in Ablative Coating. FireMastic-HPE™ applied around cables to 25 mm depth with a 25 × 25 mm fillet to the underside. FireMastic-300™ to the interface of the BOSS Batt™ and floor system.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	GPO	BOSS FireMastic-HPE™	-		Report Reference:		FAS230092 R1.0	
Substrate:	Comflor® 60	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3471.28	
Min Substrate Thickness (mm):	130	-	-		Date:	22/09/25	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	25	-						
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.